




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

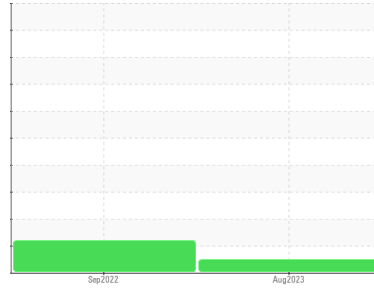

Machine Id
48192426 (S/N RU-8013R)

Component
Hydraulic System

Fluid
MOBIL DTE 24 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0844297	WC0731098	---
Sample Date	Client Info		25 Aug 2023	26 Sep 2022	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		16	---	---
Iron	ppm	ASTM D5185m >150	2	4	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >10	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >25	0	<1	---
Lead	ppm	ASTM D5185m >100	<1	2	---
Copper	ppm	ASTM D5185m >50	6	14	---
Tin	ppm	ASTM D5185m >10	<1	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	---
Barium	ppm	ASTM D5185m	2	2	---
Molybdenum	ppm	ASTM D5185m	<1	<1	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	14	41	---
Calcium	ppm	ASTM D5185m	60	63	---
Phosphorus	ppm	ASTM D5185m	312	334	---
Zinc	ppm	ASTM D5185m	427	467	---
Sulfur	ppm	ASTM D5185m	1112	1689	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	3	6	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	<1	<1	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	2716	▲ 9592	---
Particles >6µm	ASTM D7647	>5000	580	▲ 1347	---
Particles >14µm	ASTM D7647	>640	95	53	---
Particles >21µm	ASTM D7647	>160	44	10	---
Particles >38µm	ASTM D7647	>40	7	0	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	19/16/14	▲ 20/18/13	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.43	0.42	---




OIL ANALYSIS REPORT

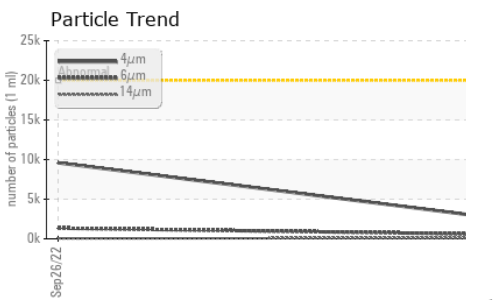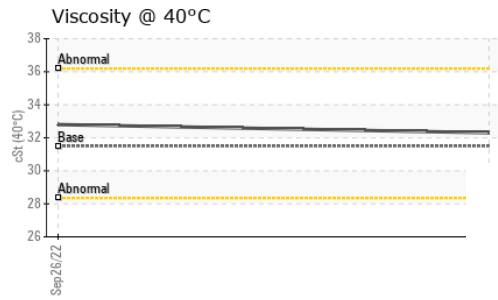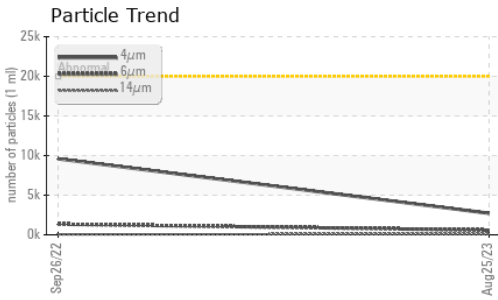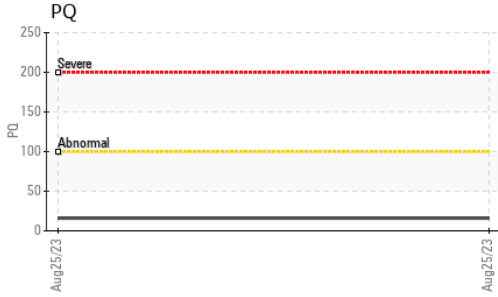





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	32.3	32.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

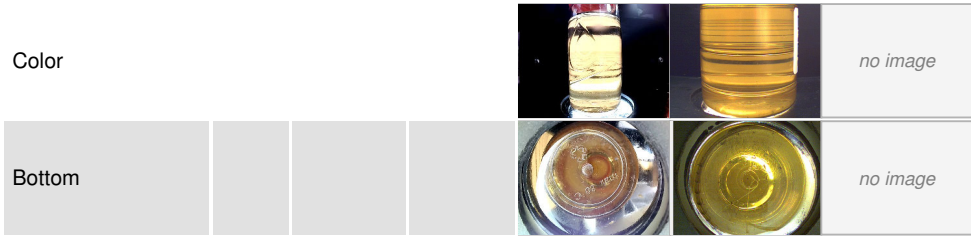

GRAPHS

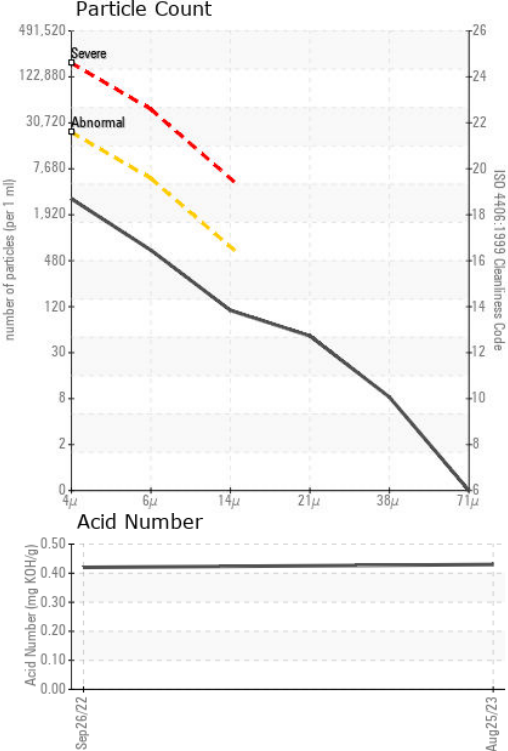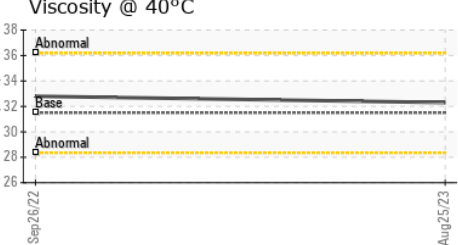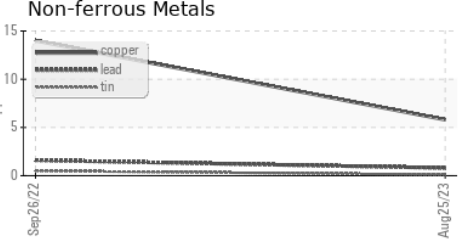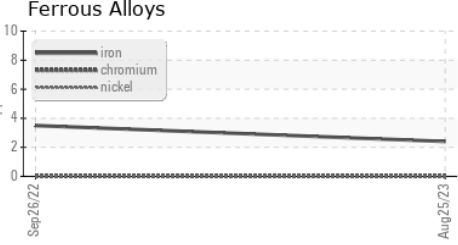

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0844297 **Received** : 30 Aug 2023
Lab Number : **05939057** **Diagnosed** : 06 Sep 2023
Unique Number : 10629669 **Diagnostician** : Doug Bogart
Test Package : PLANT

TE CONNECTIVITY
 719 PEGG RD
 GREENSBORO, NC
 US 27409
 Contact: BILLIE WALLACE
 billie.wallace@te.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)