




PROBLEM SUMMARY

Area
Evp Island
 Machine Id
GOULDS #1 I LST Transfer Pump 0314
 Component
Pump Roller Bearing
 Fluid
MOBIL SHC 626 (2 QTS)

Sample Rating Trend

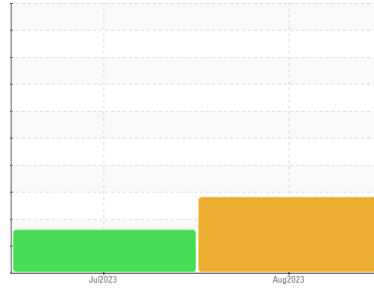


WEAR PARTICLES



COMPONENT CONDITION SUMMARY

▲ Particle Trend

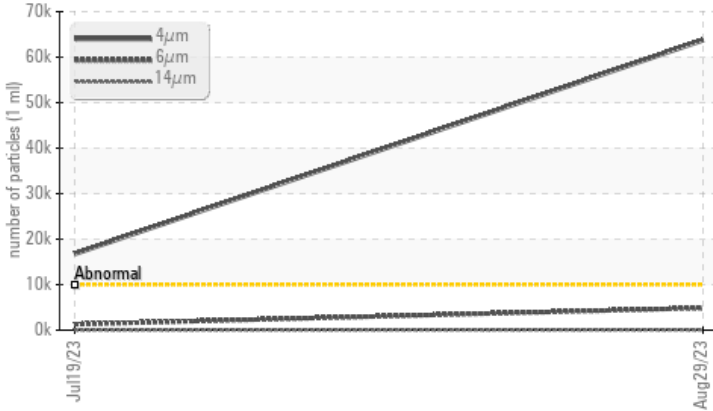

RECOMMENDATION

The oil change at the time of sampling has been noted. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Analytical Ferrography: Results suggest that the condition of this system has deteriorated from the previous sample, with an increase in the contamination volume and commensurate increase in the amount of ferrous wear that is present. It is strongly recommended to investigate the source of contamination and repair it as soon as possible, and once repaired clean the lubricant with filtration if possible. If a fluid change is the only option to remove the debris in this sump, a flush is recommended, using prefiltered lubricant.

PROBLEMATIC TEST RESULTS

| Sample Status | Scale | ASTM | ABNORMAL | ABNORMAL | --- |
|-----------------|------------|------------------------|------------|------------|-----|
| Ferrous Rubbing | Scale 0-10 | *ASTM D7684 | ▲ 4 | ▲ 2 | --- |
| Other | Scale 0-10 | *ASTM D7684 | ▲ 5 | ▲ 4 | --- |
| Particles >4µm | | ASTM D7647 >10000 | ▲ 63710 | ▲ 16734 | --- |
| Particles >6µm | | ASTM D7647 >2500 | ▲ 4864 | 1297 | --- |
| Oil Cleanliness | | ISO 4406 (c) >20/18/14 | ▲ 23/19/13 | ▲ 21/17/12 | --- |

Customer Id: GRAMAC
 Sample No.: WC0824338
 Lab Number: 05939094
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Aaron Black +1
aaron.black@wearcheck.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Filter | --- | --- | ? | We recommend you service the filters on this component. |
| Resample | --- | --- | ? | We recommend an early resample to monitor this condition. |

HISTORICAL DIAGNOSIS

CONTAMINANT



19 Jul 2023 Diag: Aaron Black

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Analytical Ferrography: Results confirm an elevated particle count with contamination and ferrous rubbing wear slightly elevated from typical in this system. Investigate the source of contamination and correct it if possible. There is no abnormal or failure-type wear present, so correcting the contamination present should bring the system back into a regular wear pattern. All component wear rates are normal. The analytical ferrographic results are normal indicating no abnormal wear in the system. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

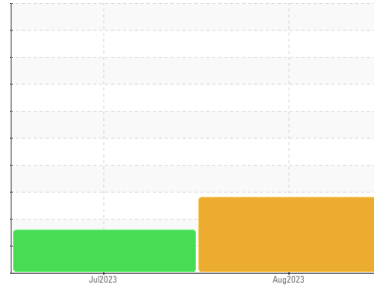

WEAR PARTICLES



Area

Evp Island

Machine Id

GOULDS #1 I LST Transfer Pump 0314

Component

Pump Roller Bearing

Fluid

MOBIL SHC 626 (2 QTS)

DIAGNOSIS

▲ Recommendation

The oil change at the time of sampling has been noted. We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Analytical Ferrography: Results suggest that the condition of this system has deteriorated from the previous sample, with an increase in the contamination volume and commensurate increase in the amount of ferrous wear that is present. It is strongly recommended to investigate the source of contamination and repair it as soon as possible, and once repaired clean the lubricant with filtration if possible. If a fluid change is the only option to remove the debris in this sump, a flush is recommended, using prefiltered lubricant.

▲ Wear

Wear particle analysis indicates that the ferrous rubbing particles are abnormal.

▲ Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Oil Condition

The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info | | WC0824338 | WC0824318 | --- |
| Sample Date | Client Info | | 29 Aug 2023 | 19 Jul 2023 | --- |
| Machine Age | mths | Client Info | 0 | 0 | --- |
| Oil Age | mths | Client Info | 1 | 3 | --- |
| Oil Changed | Client Info | | Changed | Not Changd | --- |
| Sample Status | | | ABNORMAL | ABNORMAL | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|------------|-----------------|--------------|----------|----------|
| PQ | ASTM D8184 | | 20 | 9 | --- |
| Iron | ppm | ASTM D5185m >20 | 14 | 8 | --- |
| Chromium | ppm | ASTM D5185m >20 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m >20 | 0 | <1 | --- |
| Titanium | ppm | ASTM D5185m | <1 | 0 | --- |
| Silver | ppm | ASTM D5185m | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m >20 | <1 | 0 | --- |
| Lead | ppm | ASTM D5185m >20 | 3 | 7 | --- |
| Copper | ppm | ASTM D5185m >20 | 2 | 11 | --- |
| Tin | ppm | ASTM D5185m >20 | 0 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | 0 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | 0 | <1 | --- |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | --- |
| Calcium | ppm | ASTM D5185m | 1 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | 459 | 429 | --- |
| Zinc | ppm | ASTM D5185m | 17 | 12 | --- |
| Sulfur | ppm | ASTM D5185m | 63 | 267 | --- |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >15 | 3 | 3 | --- |
| Sodium | ppm | ASTM D5185m | <1 | 3 | --- |
| Potassium | ppm | ASTM D5185m >20 | 1 | 0 | --- |






FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-------------------|------------|----------|
| Particles >4µm | ASTM D7647 | >10000 | ▲ 63710 | ▲ 16734 | --- |
| Particles >6µm | ASTM D7647 | >2500 | ▲ 4864 | 1297 | --- |
| Particles >14µm | ASTM D7647 | >160 | 42 | 26 | --- |
| Particles >21µm | ASTM D7647 | >40 | 13 | 6 | --- |
| Particles >38µm | ASTM D7647 | >10 | 1 | 0 | --- |
| Particles >71µm | ASTM D7647 | >3 | 0 | 0 | --- |
| Oil Cleanliness | ISO 4406 (c) | >20/18/14 | ▲ 23/19/13 | ▲ 21/17/12 | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.47 | 0.31 | --- |


OIL ANALYSIS REPORT

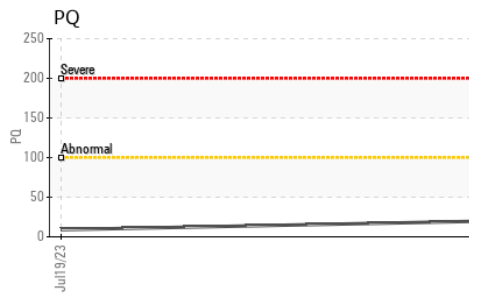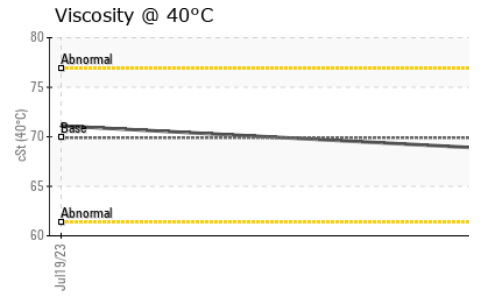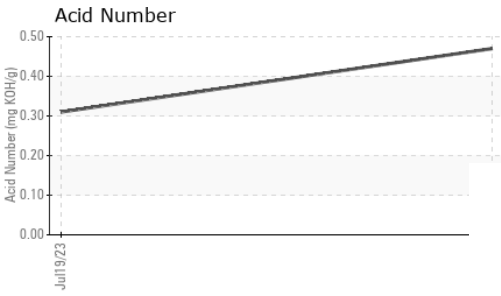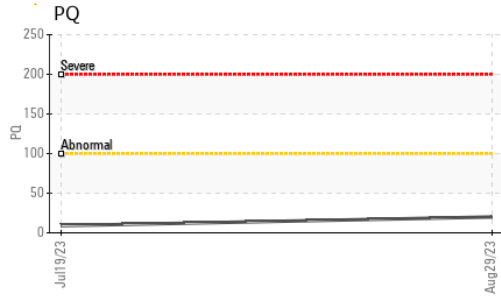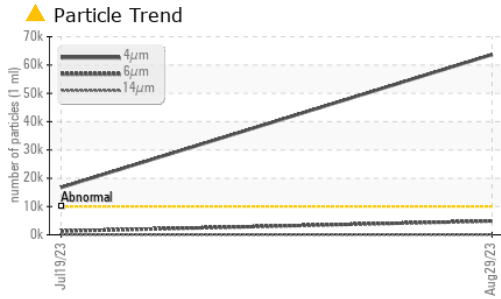





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >2 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 69.9 | 68.8 | 71.1 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

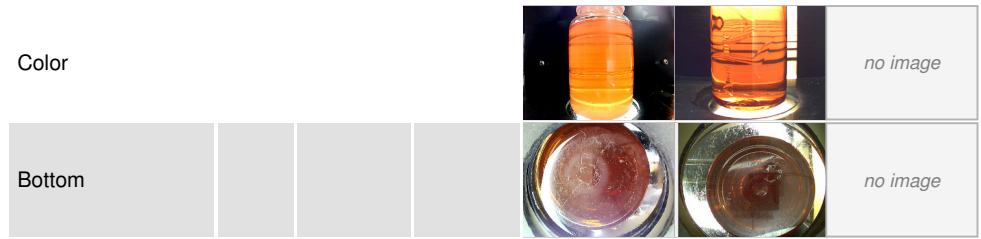

GRAPHS

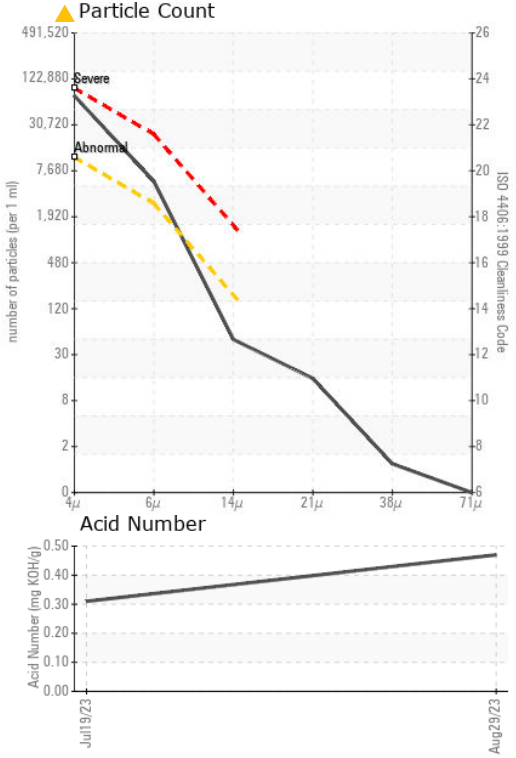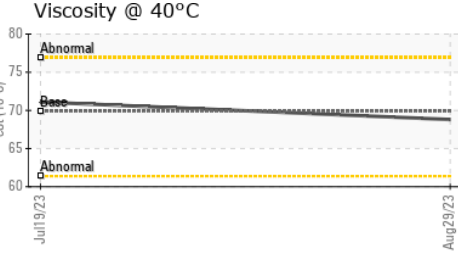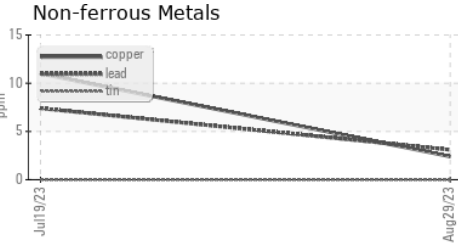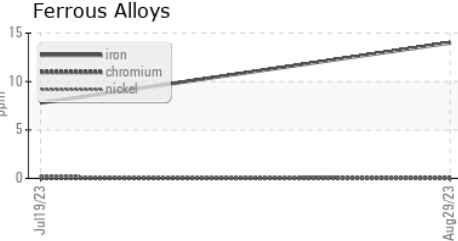


Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0824338 **Received** : 30 Aug 2023
Lab Number : 05939094 **Diagnosed** : 08 Sep 2023
Unique Number : 10629706 **Diagnostician** : Aaron Black
Test Package : PLANT (Additional Tests: A-FERR)

GRAPHIC PACKAGING INTERNATIONAL
 100 GRAPHIC PACKAGING INTERNATIONAL
 MACON, GA
 US 31206
 Contact: DARYL SPRINGER
 daryl.springer@graphicpkg.com
 T: (478)784-3677
 F:


To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Area
Evp Island
 Machine Id
GOULDS #1 I LST Transfer Pump 0314
 Component
Pump Roller Bearing
 Fluid
MOBIL SHC 626 (2 QTS)


Magn: 500x Illum: RW

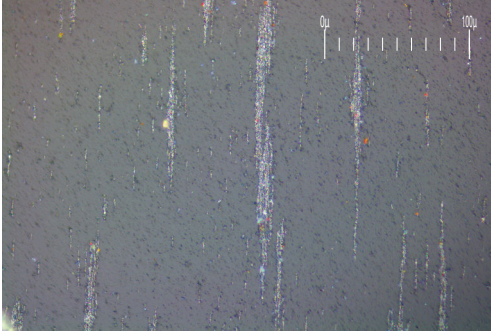


Magn: 500x Illum: RW

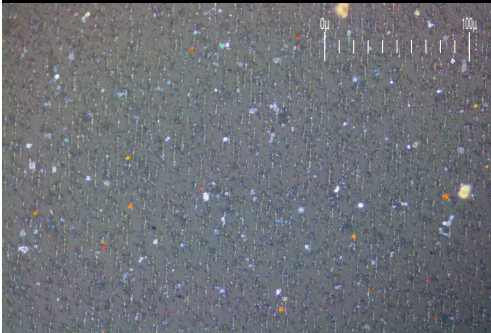

Magn: 500x Illum: RW

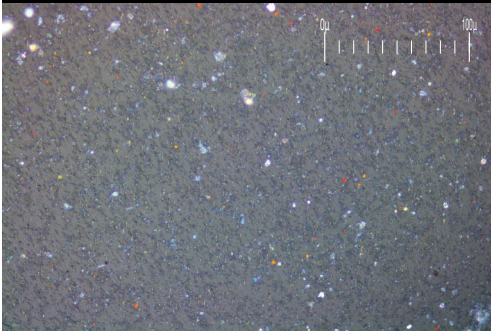

Magn: 100x Illum: RW

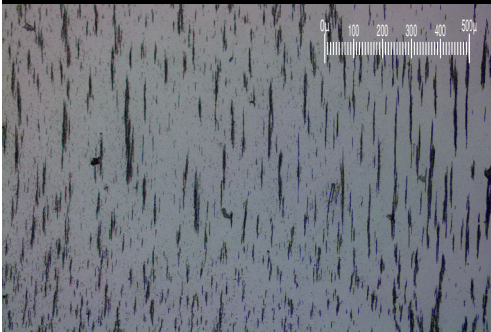

| FERROGRAPHY | method | limit/base | current | history1 | history2 |
|-----------------------|------------------------|------------|---|---|----------|
| Ferrous Rubbing | Scale 0-10 *ASTM D7684 | | ▲ 4 | ■ 2 | |
| Ferrous Sliding | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Cutting | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Rolling | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Break-in | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Spheres | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Black Oxides | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Red Oxides | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Corrosive | Scale 0-10 *ASTM D7684 | | | | |
| Ferrous Other | Scale 0-10 *ASTM D7684 | | | | |
| Nonferrous Rubbing | Scale 0-10 *ASTM D7684 | | | | |
| Nonferrous Sliding | Scale 0-10 *ASTM D7684 | | | | |
| Nonferrous Cutting | Scale 0-10 *ASTM D7684 | | | | |
| Nonferrous Rolling | Scale 0-10 *ASTM D7684 | | | | |
| Nonferrous Other | Scale 0-10 *ASTM D7684 | | | | |
| Carbonaceous Material | Scale 0-10 *ASTM D7684 | | | | |
| Lubricant Degradation | Scale 0-10 *ASTM D7684 | | | | |
| Sand/Dirt | Scale 0-10 *ASTM D7684 | | | | |
| Fibres | Scale 0-10 *ASTM D7684 | | | | |
| Spheres | Scale 0-10 *ASTM D7684 | | | | |
| Other | Scale 0-10 *ASTM D7684 | | ▲ 5 | ▲ 4 | |

WEAR

Wear particle analysis indicates that the ferrous rubbing particles are abnormal.

This page left intentionally blank