




# COOLANT REPORT

Sample Rating Trend

**NORMAL**

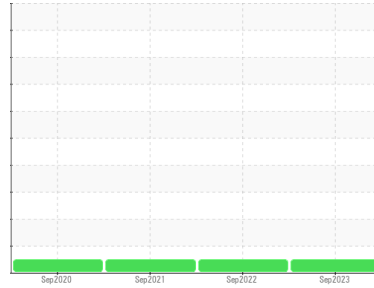

Machine Id  
**MTNGPBL01**

Component  
**Coolant**  
Fluid

**CONVENTIONAL COOLANT (--- GAL)**

## DIAGNOSIS

### Recommendation

The fluid is suitable for further service.

### Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

### Contaminants

There is no indication of any contamination in the coolant.

### Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0775119</b>	WC0675520	WC0566329
Sample Date	Client Info		<b>20 Sep 2023</b>	13 Sep 2022	14 Sep 2021
Machine Age	hrs	Client Info	<b>6648</b>	6648	0
Oil Age	hrs	Client Info	<b>6648</b>	0	0
Oil Changed		Client Info	<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		<b>1.068</b>	1.068	---
pH	Scale 0-14 ASTM D1287		<b>8.71</b>	8.69	8.23
Nitrites	ppm AP-053:2009		<b>1652</b>	1764	524
Reserve Alkalinity	Scale 0-20 *ASTM D1121		<b>---</b>	---	---
Percentage Glycol	% ASTM D3321		<b>50.1</b>	50.1	49
Freezing Point	°F ASTM D3321		<b>-35</b>	-35	-37
Total Dissolved Solids			<b>327.0</b>	398.5	432.5
Carboxylate			<b>n/a</b>	fail	n/a

## CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D6130		<b>67</b>	71	54
Phosphorus	ppm ASTM D6130		<b>1456</b>	983	13
Boron	ppm ASTM D6130		<b>321</b>	357	33
Molybdenum	ppm ASTM D6130		<b>238</b>	261	943

## CORROSION

	method	limit/base	current	history1	history2
Iron	ppm ASTM D6130	>15	<b>&lt;1</b>	0	<1
Aluminum	ppm ASTM D6130	>10	<b>&lt;1</b>	0	<1
Copper	ppm ASTM D6130	>10	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D6130	>10	<b>&lt;1</b>	0	<1
Tin	ppm ASTM D6130	>10	<b>&lt;1</b>	0	<1
Zinc	ppm ASTM D6130		<b>&lt;1</b>	0	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm ASTM D6130		<b>12</b>	3	16

## CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm ASTM D6130		<b>3663</b>	2189	790
Potassium	ppm ASTM D6130		<b>1821</b>	890	4688

## SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm ASTM D6130		<b>&lt;1</b>	0	5
Magnesium	ppm ASTM D6130		<b>&lt;1</b>	<1	2









# COOLANT REPORT

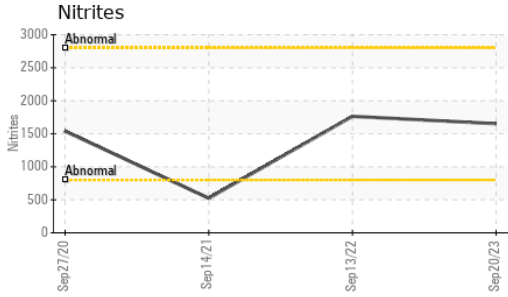

VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual		<b>Pink</b>	Pink	Red
Coolant Appearance	*Visual	Clear	<b>normal</b>	normal	normal
Color					
Bottom					

## GRAPHS

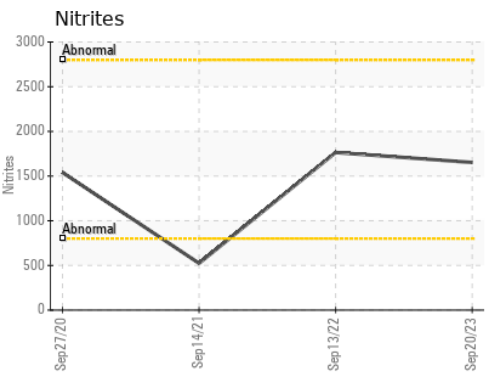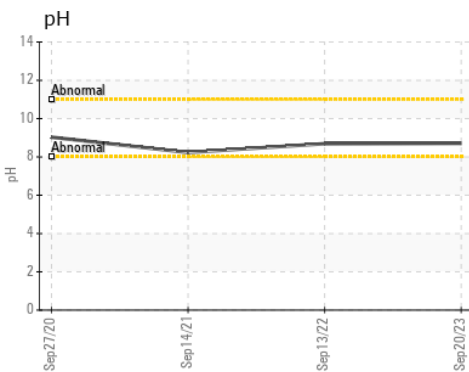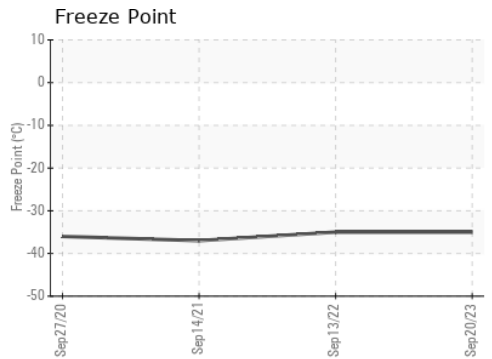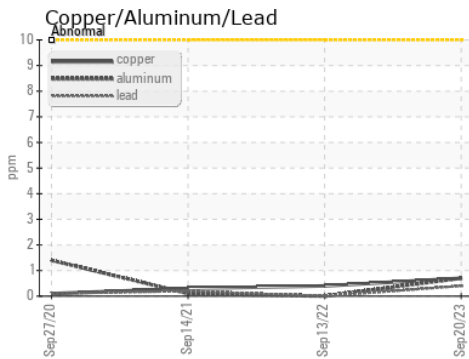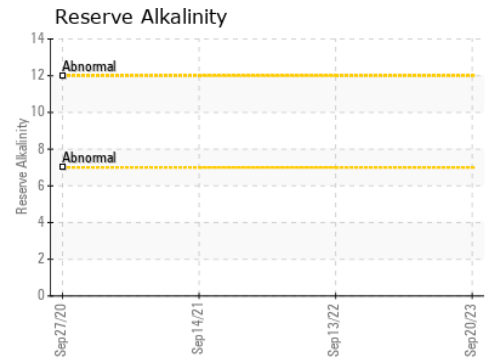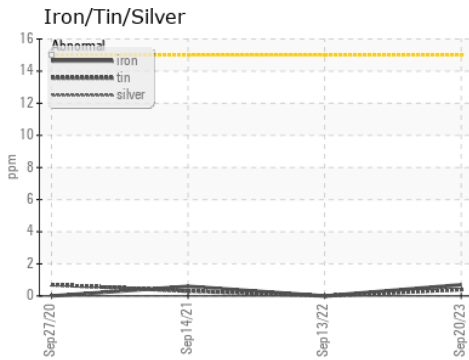

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0775119 **Received** : 22 Sep 2023  
**Lab Number** : 05959317 **Diagnosed** : 26 Sep 2023  
**Unique Number** : 10660530 **Diagnostician** : Doug Bogart  
**Test Package** : COOL- ( Additional Tests: COOL, ICP )

**EDL NA Recips-Morgantown**  
 Morgantown Powerstation, 950 Shiloh  
 Morgantown, PA  
 US 19543  
 Contact: ARON GUNN  
 aron.gunn@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)