

OIL ANALYSIS REPORT

Sample Number

hrs

Sample Date

Machine Age

Sample Rating Trend



Machine Id 6521877 (S/N 1266) Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.




Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	7	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron						
DOIOII	ppm	ASTM D5185m		0	0	0
Barium	ppm ppm	ASTM D5185m ASTM D5185m	90	0 0	0 5	0
			90	-		
Barium	ppm	ASTM D5185m	90	0	5	0
Barium Molybdenum	ppm ppm	ASTM D5185m ASTM D5185m	90 90	0	5 0	0
Barium Molybdenum Manganese	ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	90	0 0 0	5 0 0	0 0 <1
Barium Molybdenum Manganese Magnesium	ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	90	0 0 0 1	5 0 0 4	0 0 <1 9
Barium Molybdenum Manganese Magnesium Calcium	ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	90	0 0 0 1 0	5 0 0 4 0	0 0 <1 9 0
Barium Molybdenum Manganese Magnesium Calcium Phosphorus	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	90	0 0 0 1 0 111	5 0 4 0 197	0 0 <1 9 0 231
Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc	ppm ppm ppm ppm ppm ppm	ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m	90	0 0 0 1 0 111 10	5 0 4 0 197 0	0 0 <1 9 0 231 2


Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	2	1	0
Water	%	ASTM D6304	>0.05	0.005	0.006	0.003
ppm Water	ppm	ASTM D6304	>500	58.6	60.3	31.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm	IESS	ASTM D7647	limit/base	current 1307	history1	980
	IESS					· · · · ·
Particles >4µm	IESS	ASTM D7647		1307		980
Particles >4μm Particles >6μm	1255	ASTM D7647 ASTM D7647	>1300 >80	1307 547		980 284


0 Particles >71µm ASTM D7647 >3 0 ISO 4406 (c) **Oil Cleanliness** >--/17/13 18/16/13 17/15/12 FLUID DEGRADATION 0.51 0.52 0.54 Acid Number (AN) mg KOH/g ASTM D8045 0.4



OIL ANALYSIS REPORT






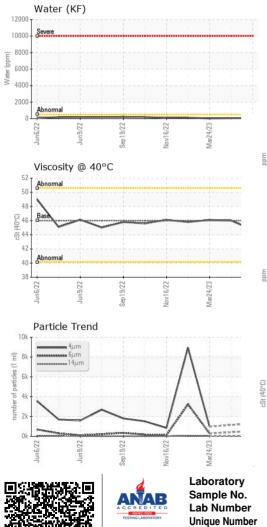

2401141						
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	🔺 MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.7	46.0	46.1
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						

Bottom

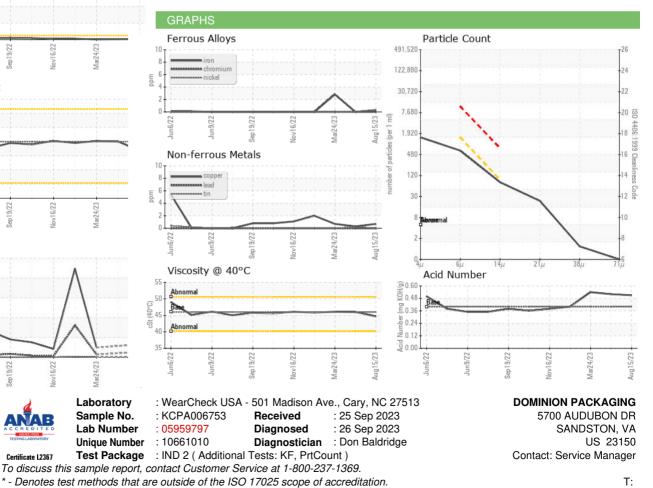

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: Service Manager - DOMSANVA