

OIL ANALYSIS REPORT

Sample Rating Trend



Area WO 68 Machine Id LL 4 - BUFFALO WATER

Non-Drive End Bearing

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05959915		
Sample Date		Client Info		20 Sep 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	ourropt	history1	history2
				current		
Iron	ppm	ASTM D5185m	>20	<1		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	2		
Lead	ppm	ASTM D5185m	>20	5		
Copper	ppm	ASTM D5185m	>20	8		
Tin	ppm	ASTM D5185m	>20	4		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	5	0		
Calcium	ppm	ASTM D5185m	12	<1		
Phosphorus	ppm	ASTM D5185m	400	542		
Zinc	ppm	ASTM D5185m	12	0		
Sulfur	ppm	ASTM D5185m	650	685		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1		
Sodium	ppm	ASTM D5185m	210	2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.50	0.33		
. ,	ing Koning				la la tament	history O
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>2	NEG		
Free Water	scalar	*Visual		NEG		
20:14:45) Rev: 1				Contact/L	ocation: Bill Cox	- UCCORROC



OIL ANALYSIS REPORT

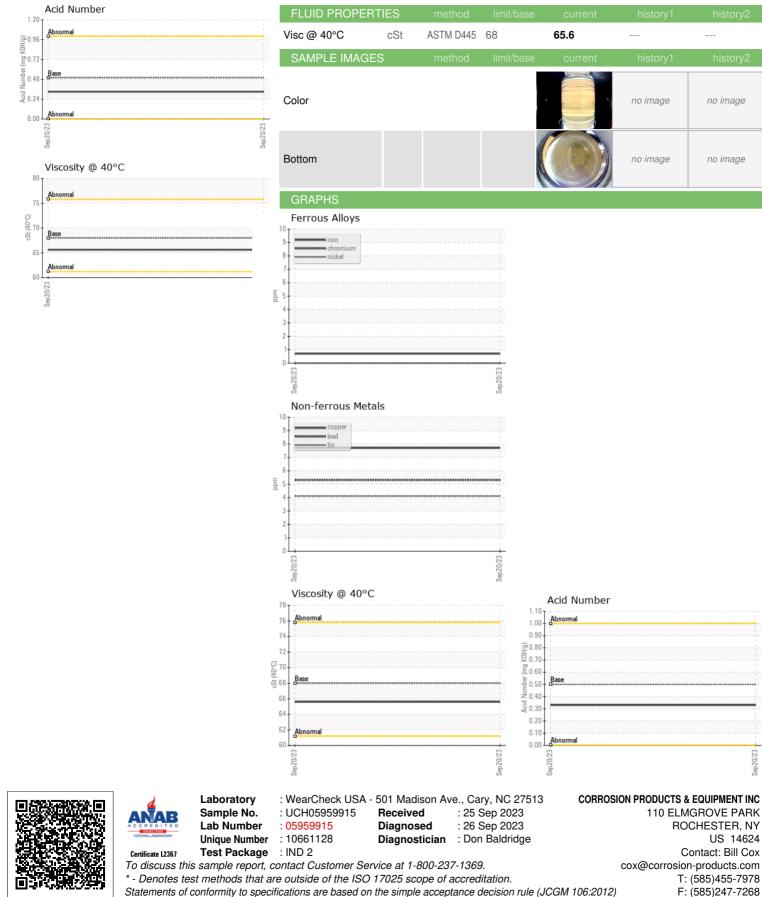

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Bill Cox - UCCORROC

US 14624

no image

no image