


COOLANT REPORT



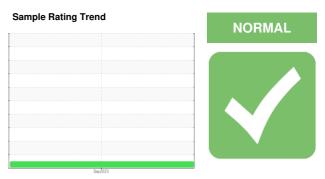

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.


Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORM	MOITAN	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0829187		
Sample Date		Client Info		07 Sep 2023		
Machine Age	hrs	Client Info		191		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		1.076		
рН	Scale 0-14	ASTM D1287		8.63		
Nitrites	ppm	AP-053:2009		412		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		56.8		
Freezing Point	°F	ASTM D3321		-50		
Total Dissolved Solids				472.0		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Red		
Coolant Appearance		*Visual	Clear	normal		
Color					no image	no image
Bottom					no image	no image



COOLANT REPORT

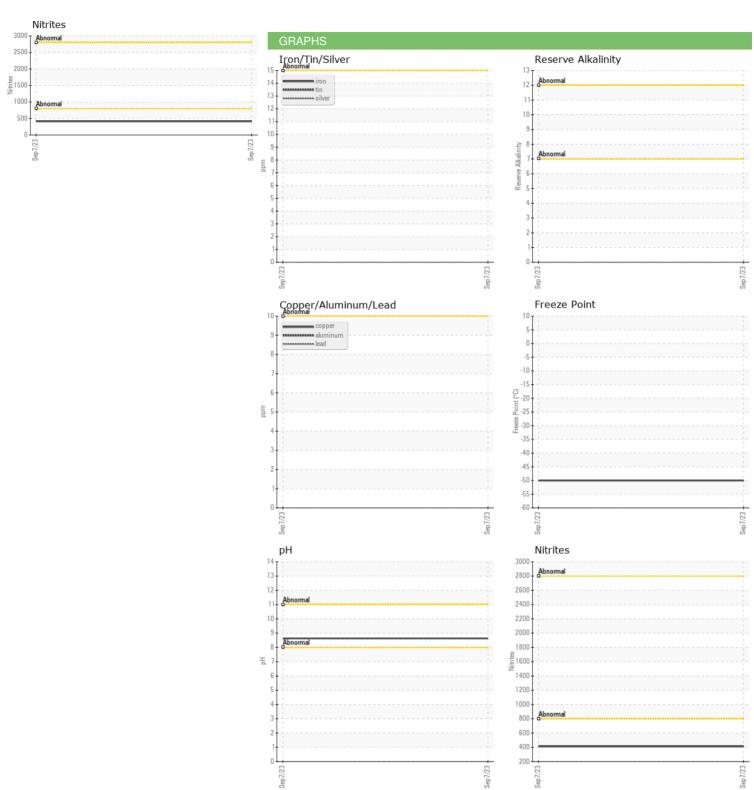





Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10661512

: WC0829187 : 05960299

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received Diagnosed

: 25 Sep 2023 : 28 Sep 2023 Diagnostician : Doug Bogart

Test Package : COOL- (Additional Tests: COOL)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

rmcarthur@bittingelectric.com T: (919)467-9417

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: ROBERT MCARTHUR

ALTERNATIVE POWER

1000 NORTHGATE CT

MORRISVILLE, NC

US 27560