

### **OIL ANALYSIS REPORT**

#### Sample Rating Trend

**NORMAL** 



# ALLISON-CHALMERS U-19 GENERATOR

Component

**R&O OIL ISO 68 (100 GAL)** 

## **Thrust Bearing**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		. I				
CAMPLE INFOR	MATION	ec2005 Dec	2009 Feb2015 Mar201	7 Aug2018 Mar2020 Mar2	022 Sep202	la la la ma O
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0845051	WC0786737	WC0731004
Sample Date		Client Info		12 Sep 2023	02 Mar 2023	16 Sep 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>85	0	0	0
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>40	0	<1	0
Lead	ppm	ASTM D5185m	>60	0	<1	0
Copper	ppm	ASTM D5185m	>7	<1	<1	<1
Tin	ppm	ASTM D5185m	>40	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	<1	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	5	<1	0	<1
Calcium	ppm	ASTM D5185m	5	1	2	0
Phosphorus	ppm	ASTM D5185m	100	6	5	14
Zinc	ppm	ASTM D5185m	25	0	4	0
Sulfur	ppm	ASTM D5185m	1500	63	98	0
CONTAMINANT	S	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	<1	<1	1
Sodium	ppm	ASTM D5185m		3	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	0
FLUID CLEANLI	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		818	570	510
Particles >6µm		ASTM D7647	>1300	176	137	88

9

2

0

0

0.08

17/15/10

ASTM D7647 >160

ASTM D7647 >40

ASTM D7647 >10

ISO 4406 (c) >--/17/14

ASTM D7647 >3

mg KOH/g ASTM D8045

Particles >14µm

Particles >21µm

Particles >38µm

Particles >71µm

Oil Cleanliness

Acid Number (AN)

FLUID DEGRADATION

9

0

0

16/14/10

0.076

6

2

0


0

16/14/10

0.053



### OIL ANALYSIS REPORT

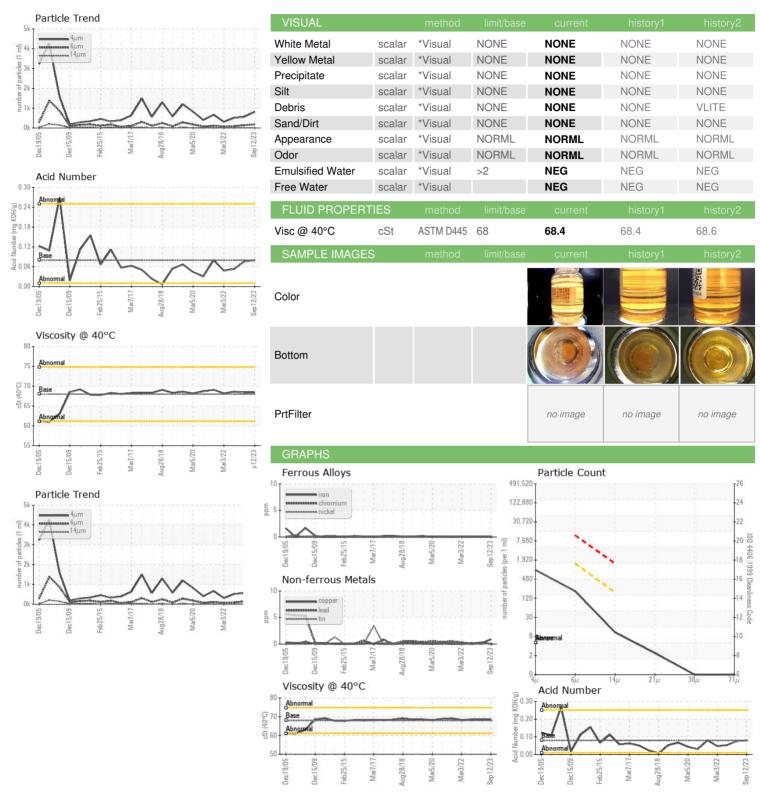





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: 05960555 : 10661768

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Sep 2023 : WC0845051 Diagnosed : 27 Sep 2023 Diagnostician : Don Baldridge

Test Package : PLANT ( Additional Tests: FilterPatch ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NEW YORK POWER AUTHORITY** 

**PO BOX 700** MASSENA, NY US 13662

Contact: ANDY WESTMACOTT Andy.Westmacott@nypa.gov

T: (315)764-6250 F: (315)764-6612

Contact/Location: ANDY WESTMACOTT - NEWMAS