




# OIL ANALYSIS REPORT

Sample Rating Trend

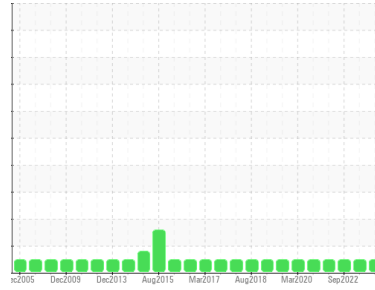

**NORMAL**



## Machine Id **BALDWIN U-22 GENERATOR**

Component  
**Thrust Bearing**  
Fluid  
**NOT GIVEN (2000 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0845045</b>	WC0786731	WC0731010
Sample Date	Client Info			<b>12 Sep 2023</b>	02 Mar 2023	16 Sep 2022
Machine Age	yrs	Client Info		<b>0</b>	0	0
Oil Age	yrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>85	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>40	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>60	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>7	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>40	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	1
Calcium	ppm	ASTM D5185m		<b>10</b>	8	<1
Phosphorus	ppm	ASTM D5185m		<b>10</b>	3	17
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>5310</b>	3936	4767

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>4</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	1	0


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>860</b>	1825	1741
Particles >6µm		ASTM D7647	>1300	<b>244</b>	507	450
Particles >14µm		ASTM D7647	>160	<b>16</b>	27	42
Particles >21µm		ASTM D7647	>40	<b>3</b>	3	10
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/14	<b>17/15/11</b>	18/16/12	18/16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.08</b>	0.119	0.05




# OIL ANALYSIS REPORT


Particle Trend

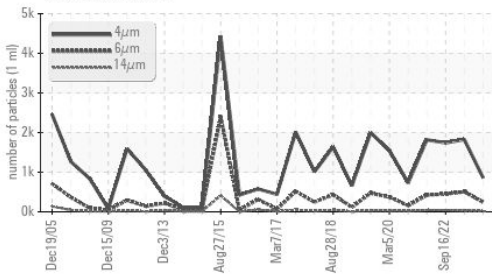


Acid Number

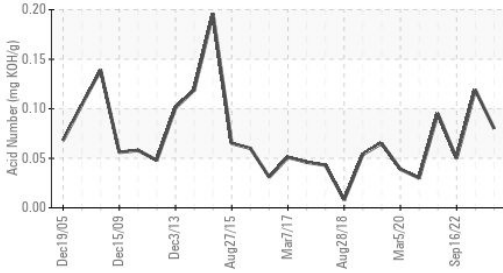

Viscosity @ 40°C

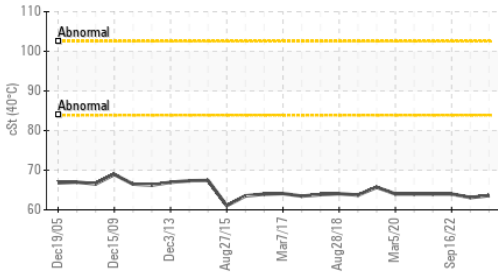

Particle Trend

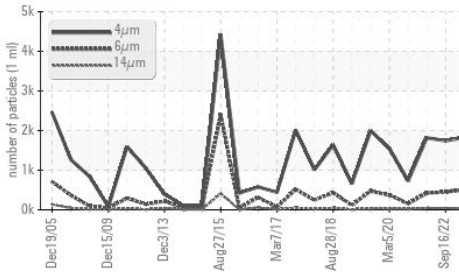

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	63.6	63.1	64.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------






Color

Bottom

PrtFilter

no image      no image      no image

## GRAPHS

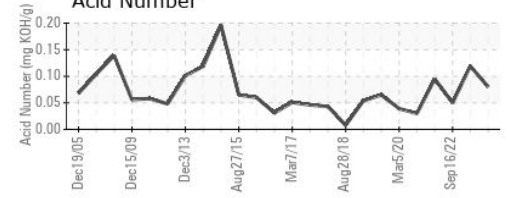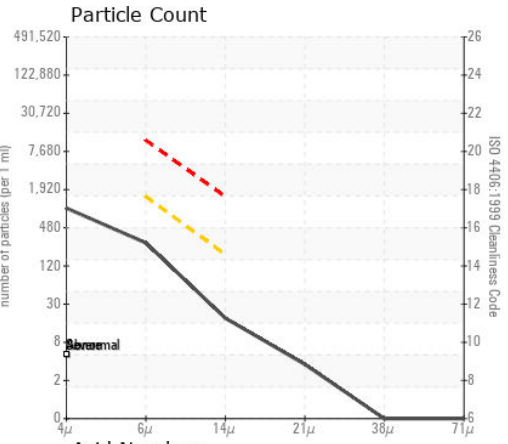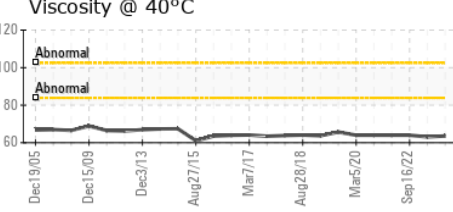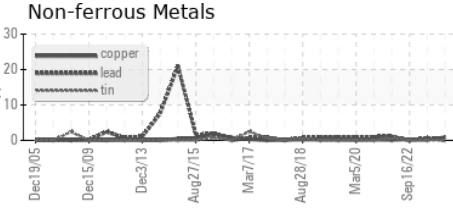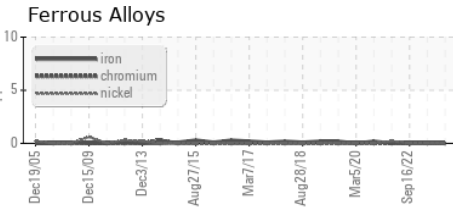

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0845045      Received : 25 Sep 2023  
 Lab Number : 05960561      Diagnosed : 27 Sep 2023  
 Unique Number : 10661774      Diagnostician : Don Baldrige  
 Test Package : PLANT ( Additional Tests: FilterPatch )

**NEW YORK POWER AUTHORITY**  
 PO BOX 700  
 MASSENA, NY  
 US 13662  
 Contact: ANDY WESTMACOTT  
 Andy.Westmacott@nypa.gov  
 T: (315)764-6250  
 F: (315)764-6612

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)