



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**BALDWIN U-30 GENERATOR**

Component  
**Thrust Bearing**

Fluid  
**NOT GIVEN (2000 GAL)**

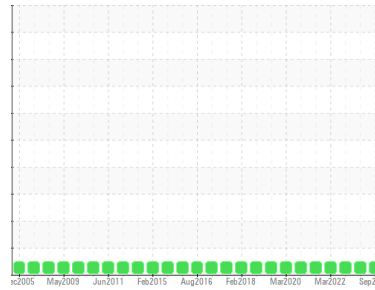

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0845029</b>	WC0786715	WC0731026
Sample Date	Client Info		<b>13 Sep 2023</b>	03 Mar 2023	16 Sep 2022
Machine Age	yrs	Client Info	<b>0</b>	0	0
Oil Age	yrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >85	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >40	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >60	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >7	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	1
Calcium	ppm	ASTM D5185m	<b>10</b>	9	1
Phosphorus	ppm	ASTM D5185m	<b>12</b>	6	20
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	0
Sulfur	ppm	ASTM D5185m	<b>6764</b>	5427	6299

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	1
Sodium	ppm	ASTM D5185m	<b>3</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	0

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>569</b>	462	1135
Particles >6µm	ASTM D7647 >1300		<b>133</b>	95	257
Particles >14µm	ASTM D7647 >160		<b>8</b>	5	22
Particles >21µm	ASTM D7647 >40		<b>1</b>	1	6
Particles >38µm	ASTM D7647 >10		<b>0</b>	0	1
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/14		<b>16/14/10</b>	16/14/10	17/15/12


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.066</b>	0.11	0.065




# OIL ANALYSIS REPORT


**Particle Trend**

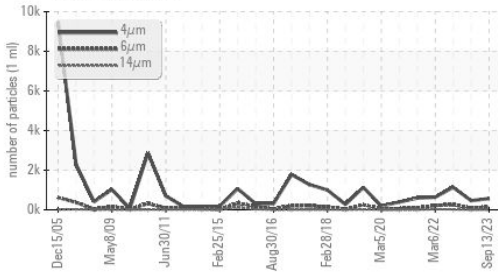


**Acid Number**

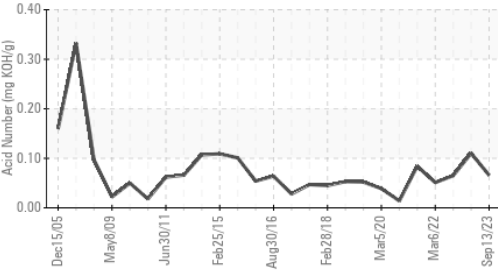

**Viscosity @ 40°C**

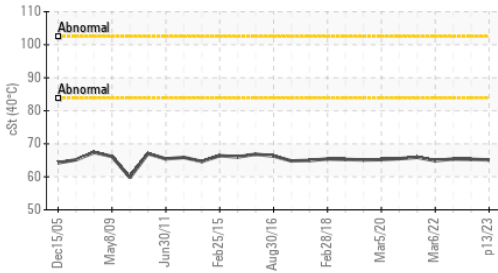

**Particle Trend**

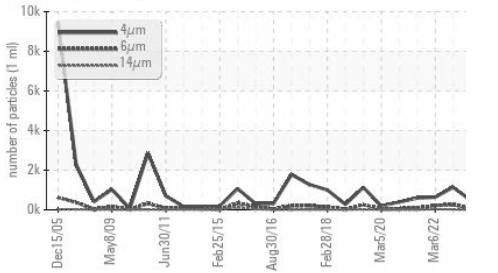

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.1	65.3	65.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------






**Color**

**Bottom**

**PrtFilter**

no image      no image      no image

## GRAPHS

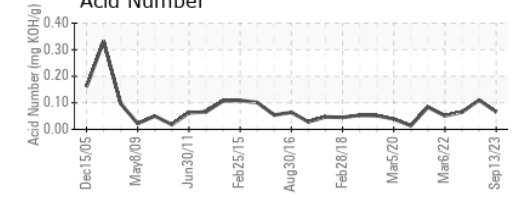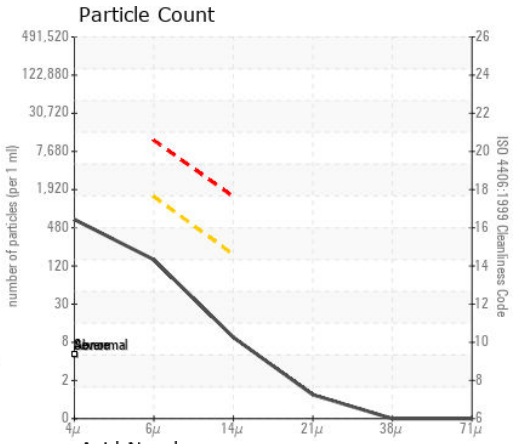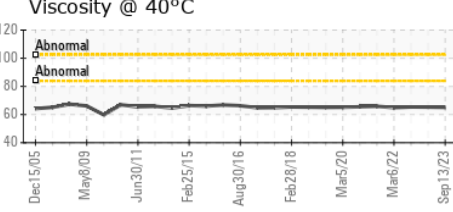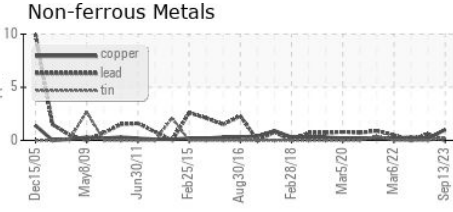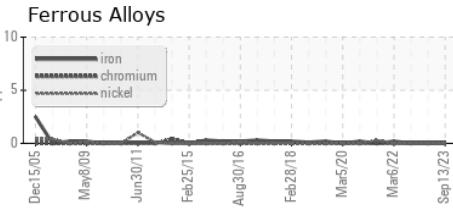

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0845029      **Received** : 25 Sep 2023  
**Lab Number** : 05960577      **Diagnosed** : 27 Sep 2023  
**Unique Number** : 10661790      **Diagnostician** : Don Baldrige  
**Test Package** : PLANT ( Additional Tests: FilterPatch )

**NEW YORK POWER AUTHORITY**  
 PO BOX 700  
 MASSENA, NY  
 US 13662  
 Contact: ANDY WESTMACOTT  
 Andy.Westmacott@nypa.gov  
 T: (315)764-6250  
 F: (315)764-6612

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)