

PROBLEM SUMMARY

Sample Rating Trend


ISO

KAESER SM 10 6138791 (S/N 1032)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

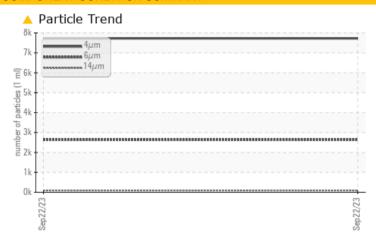

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | | |
|--------------------------|--------------|--------|--------------|--|--|--|--|--|--|--|
| Sample Status | | | ABNORMAL | | | | | | | |
| Particles >6µm | ASTM D7647 | >1300 | 2630 | | | | | | | |
| Particles >14μm | ASTM D7647 | >80 | 92 | | | | | | | |
| Oil Cleanliness | ISO 4406 (c) | >17/13 | 19/14 | | | | | | | |

Customer Id: CARWARKC Sample No.: KCPA006383 Lab Number: 05960620 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend ISO

KAESER SM 10 6138791 (S/N 1032)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| | | | | Sep2023 | | |
|-----------------------|--------|--------------|------------|----------------|----------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCPA006383 | | |
| Sample Date | | Client Info | | 22 Sep 2023 | | |
| Machine Age | hrs | Client Info | | 4560 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 29 | | |
| Tin | ppm | ASTM D5185m | >10 | <1 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 0 | | |
| Molybdenum | ppm | ASTM D5185m | 0 | <1 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | 100 | 9 | | |
| Calcium | ppm | ASTM D5185m | 0 | 3 | | |
| Phosphorus | ppm | ASTM D5185m | 0 | 3 | | |
| Zinc | ppm | ASTM D5185m | 0 | 39 | | |
| Sulfur | ppm | ASTM D5185m | 23500 | 23420 | | |
| CONTAMINANTS | 1 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 1 | | |
| Sodium | ppm | ASTM D5185m | | 4 | | |
| Potassium | ppm | ASTM D5185m | >20 | 1 | | |
| Water | % | ASTM D6304 | >0.05 | 0.006 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 65.7 | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 7725 | | |
| Particles >6µm | | ASTM D7647 | >1300 | ^ 2630 | | |
| Particles >14µm | | ASTM D7647 | >80 | <u> </u> | | |
| Particles >21µm | | ASTM D7647 | >20 | 9 | | |
| Particles >38µm | | ASTM D7647 | >4 | 0 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Oil Cleanliness | | ISO 4406 (c) | >17/13 | △ 19/14 | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| A - ! - ! N ! ! (ANI) | 1/011/ | ACTM DODAE | | 0.22 | | |


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.33



OIL ANALYSIS REPORT

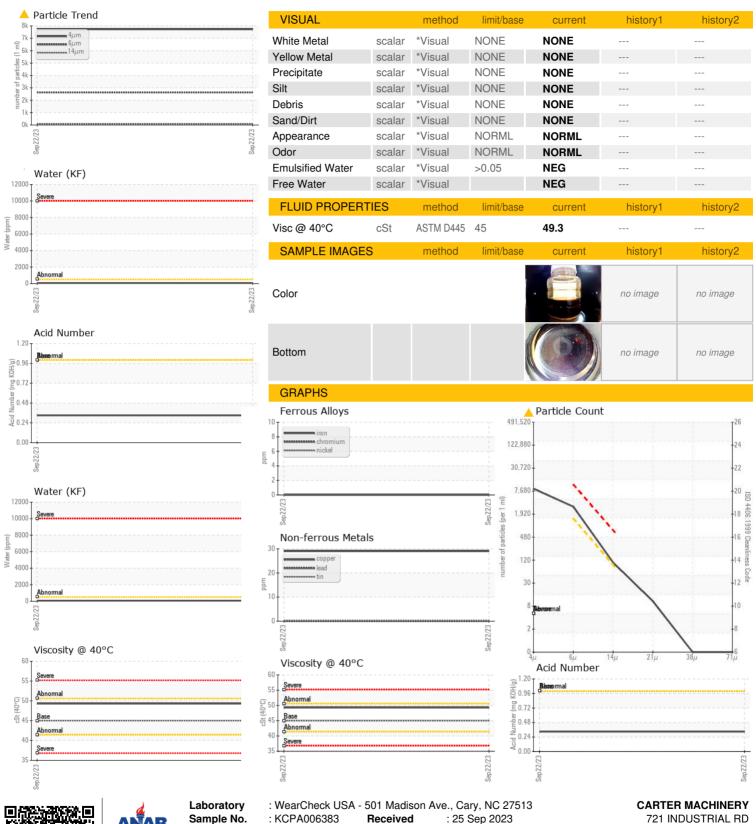



Certificate L2367

Sample No. Lab Number **Unique Number**

: 05960620

: KCPA006383 : 10661833

Received Diagnosed

: 27 Sep 2023 Diagnostician : Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

721 INDUSTRIAL RD WARRENTON, VA US 20186

Contact: Service Manager

T: F: