




PROBLEM SUMMARY

Sample Rating Trend

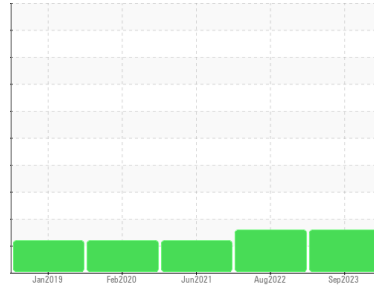


Machine Id
KAESER SM 15 4898283 (S/N 1247)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

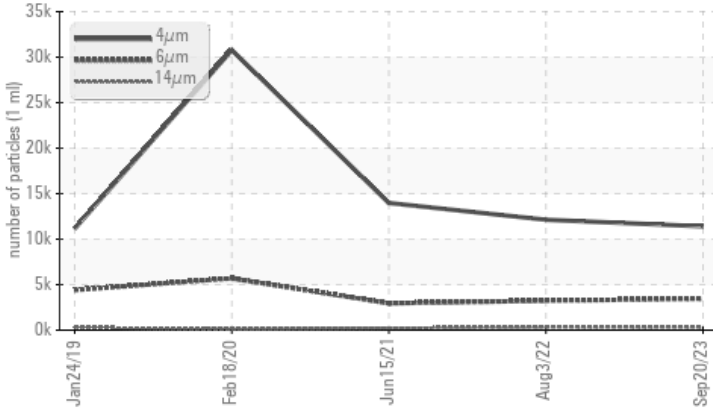

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 3451	▲ 3236	▲ 2952
Particles >14µm	ASTM D7647	>80	▲ 285	▲ 298	▲ 232
Particles >21µm	ASTM D7647	>20	▲ 65	▲ 75	▲ 53
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	▲ 21/19/15	▲ 19/15

Customer Id: SHEBURNC
 Sample No.: KCPA000091
 Lab Number: 05960635
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 Aug 2022 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Jun 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Feb 2020 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

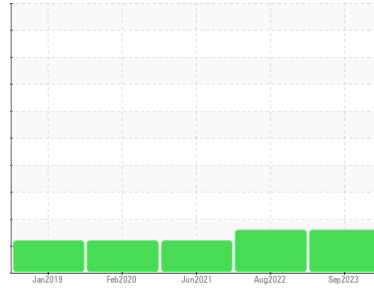

Machine Id
KAESER SM 15 4898283 (S/N 1247)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA000091	KCP50206	KCP36601
Sample Date	Client Info			20 Sep 2023	03 Aug 2022	15 Jun 2021
Machine Age	hrs	Client Info		25585	21317	18790
Oil Age	hrs	Client Info		0	0	7000
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	3	0
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	2	2	3
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	40	24	28
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	84	51	56
Calcium	ppm	ASTM D5185m	0	2	<1	2
Phosphorus	ppm	ASTM D5185m	0	4	6	5
Zinc	ppm	ASTM D5185m	0	0	6	0
Sulfur	ppm	ASTM D5185m	23500	23944	18683	20626

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	2
Sodium	ppm	ASTM D5185m		23	15	20
Potassium	ppm	ASTM D5185m	>20	4	4	2
Water	%	ASTM D6304	>0.05	0.015	0.024	0.036
ppm Water	ppm	ASTM D6304	>500	158.4	245.2	364.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		11404	12131	13974
Particles >6µm		ASTM D7647	>1300	▲ 3451	▲ 3236	▲ 2952
Particles >14µm		ASTM D7647	>80	▲ 285	▲ 298	▲ 232
Particles >21µm		ASTM D7647	>20	▲ 65	▲ 75	▲ 53
Particles >38µm		ASTM D7647	>4	2	3	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/15	▲ 21/19/15	▲ 19/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.39	0.328


OIL ANALYSIS REPORT

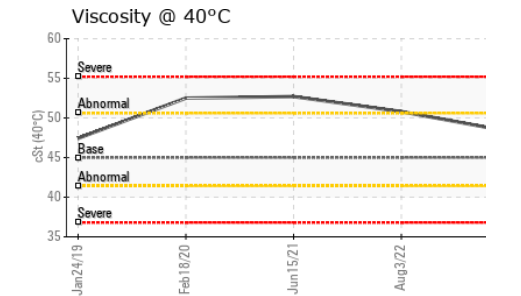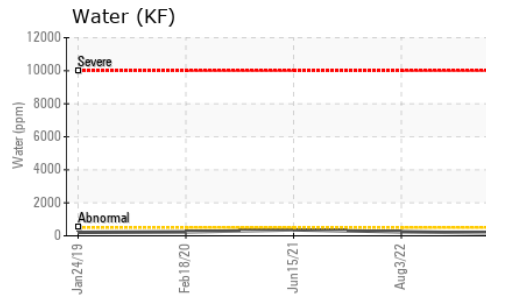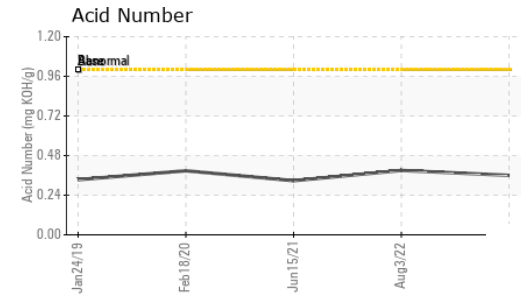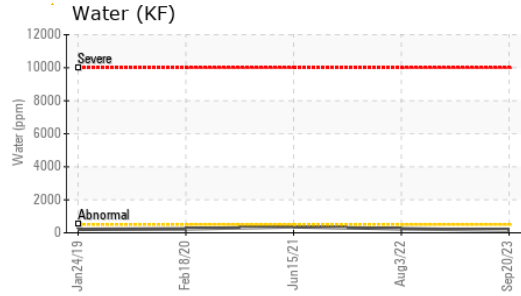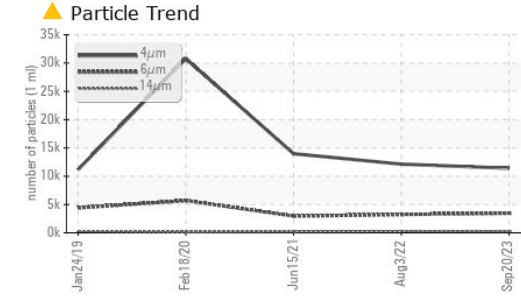





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.3	50.8	52.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

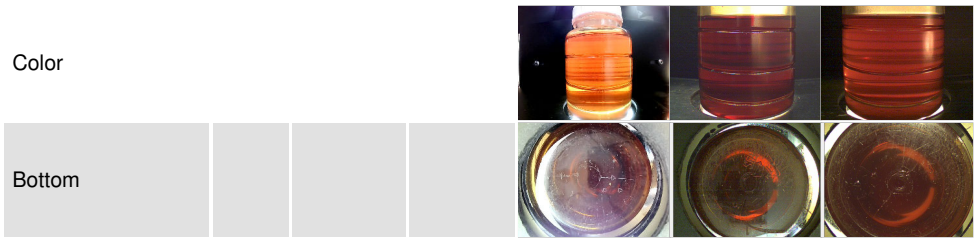

GRAPHS

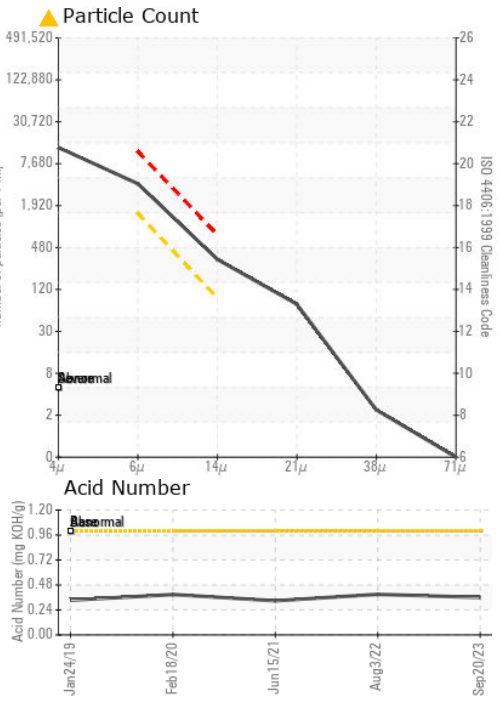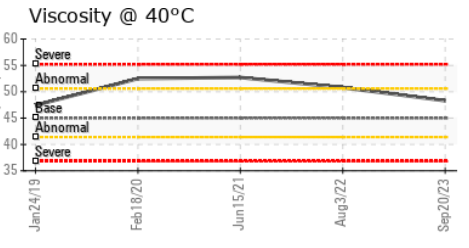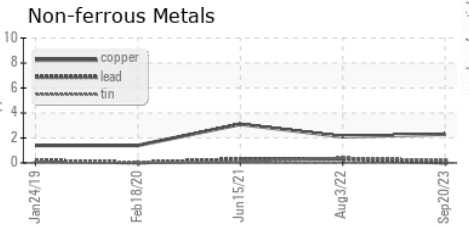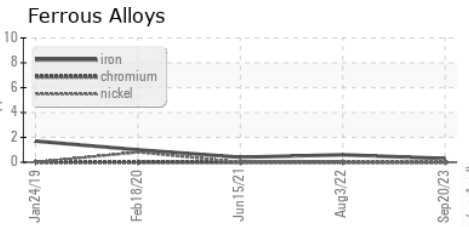

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000091 **Received** : 25 Sep 2023
Lab Number : 05960635 **Diagnosed** : 27 Sep 2023
Unique Number : 10661848 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SHEETZ DISTRIBUTION
 1737 WHITES KENNEL RD
 BURLINGTON, NC
 US 27215
 Contact: K LANE
 KLANE@SHEETZ.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)