

PROBLEM SUMMARY

KAESER 4969907


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Sample Rating Trend ISO Septimoral Septimo

COMPONENT CONDITION SUMMARY

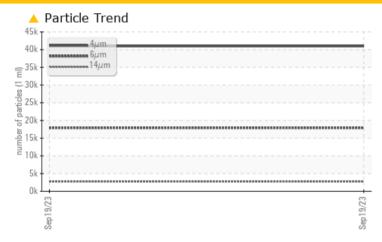

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL						
Particles >6µm	ASTM D7647	>1300	17916						
Particles >14µm	ASTM D7647	>80	2697						
Particles >21µm	ASTM D7647	>20	△ 603						
Particles >38µm	ASTM D7647	>4	<u> </u>						
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> 23/21/19</u>						

Customer Id: FOXMAR Sample No.: KCP34628 Lab Number: 05960650 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

T San



ISO

Machine Id

KAESER 4969907

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
		Client Info	minu bass	KCP34628		
Sample Number		Client Info				
Sample Date	hrs	Client Info		19 Sep 2023 48602		
Machine Age	hrs	Client Info		0		
Oil Age Oil Changed	1115	Client Info		N/A		
		Ciletit IIIIO		ABNORMAL		
Sample Status				ADNONWAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	13		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	4		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	4		
Zinc	ppm	ASTM D5185m	0	24		
Sulfur	ppm	ASTM D5185m	23500	24810		
CONTAMINANTS	i	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.005		
ppm Water	ppm	ASTM D6304	>500	50.7		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		40966		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	2697		
Particles >21µm		ASTM D7647	>20	603		
Particles >38µm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 23/21/19		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
4 1 1 1 1 (41)	1/011/	4 OTH 4 DOG 45	4.0	0.20		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.39



OIL ANALYSIS REPORT

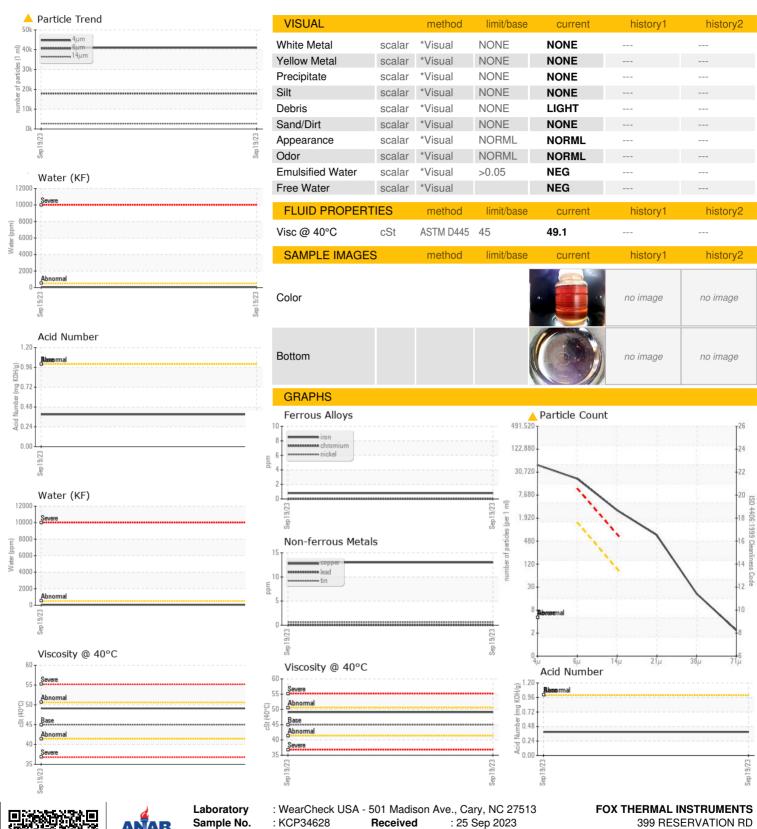



Certificate L2367

Sample No. Lab Number **Unique Number**

: KCP34628 : 05960650 : 10661863

Received Diagnosed

: 27 Sep 2023 Diagnostician : Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

399 RESERVATION RD MARINA, CA US 93933

Contact: Service Manager ABAGAEU@FOXTHERMAL.COM

T:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: