




# PROBLEM SUMMARY


Sample Rating Trend

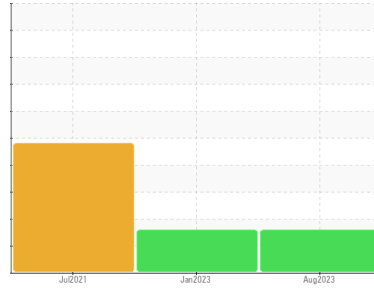

Machine Id  
**6413310 (S/N 1131)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

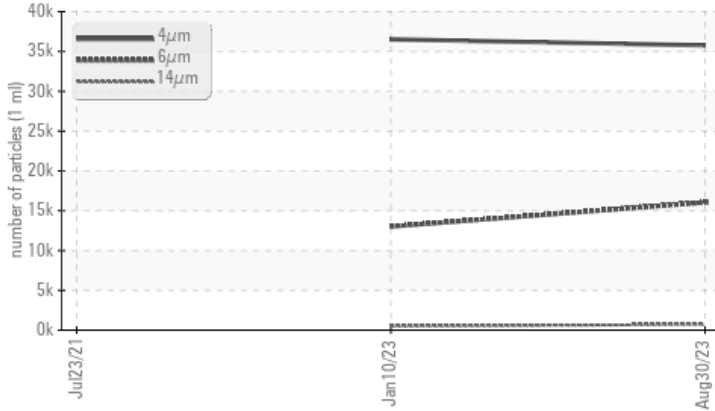

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>16046</b>	▲ 13018	---
Particles >14µm	ASTM D7647	>80	▲ <b>716</b>	▲ 506	---
Particles >21µm	ASTM D7647	>20	▲ <b>109</b>	▲ 68	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/21/17</b>	▲ 22/21/16	---

Customer Id: BRAEASMA  
 Sample No.: KCPA003521  
 Lab Number: 05960652  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 10 Jan 2023 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 23 Jul 2021 Diag: Doug Bogart

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. Free water present. There is a light concentration of water present in the oil. Additive levels indicate the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

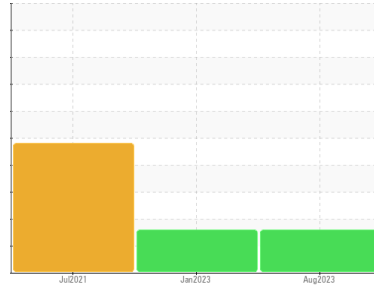

ISO



Machine Id  
**6413310 (S/N 1131)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

**DIAGNOSIS**

▲ **Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA003521</b>	KCP52066	KCP42075
Sample Date	Client Info			<b>30 Aug 2023</b>	10 Jan 2023	23 Jul 2021
Machine Age	hrs	Client Info		<b>28500</b>	25557	17730
Oil Age	hrs	Client Info		<b>0</b>	7827	6745
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>6</b>	5	6
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>13</b>	5	5
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	2
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>1</b>	0	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	500	<b>311</b>	205	▲ 122
Zinc	ppm	ASTM D5185m		<b>317</b>	222	▲ 124
Sulfur	ppm	ASTM D5185m		<b>1502</b>	270	▲ 859


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>4</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	4
Water	%	ASTM D6304	>0.05	<b>0.001</b>	0.003	▲ 0.117
ppm Water	ppm	ASTM D6304	>500	<b>7.2</b>	28.6	▲ 1170

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>35763</b>	36519	---
Particles >6µm		ASTM D7647	>1300	▲ <b>16046</b>	▲ 13018	---
Particles >14µm		ASTM D7647	>80	▲ <b>716</b>	▲ 506	---
Particles >21µm		ASTM D7647	>20	▲ <b>109</b>	▲ 68	---
Particles >38µm		ASTM D7647	>4	<b>4</b>	3	---
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>22/21/17</b>	▲ 22/21/16	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>0.64</b>	0.42	0.338

# OIL ANALYSIS REPORT


## ▲ Particle Trend

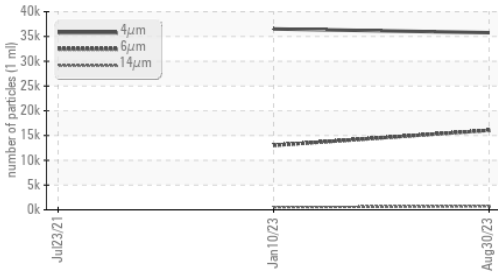


## Water (KF)

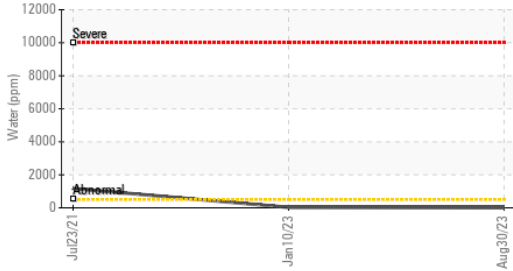


## Acid Number

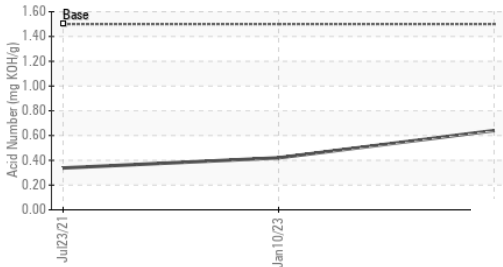

## Water (KF)

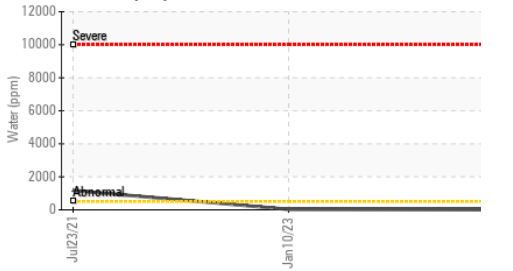

## Viscosity @ 40°C

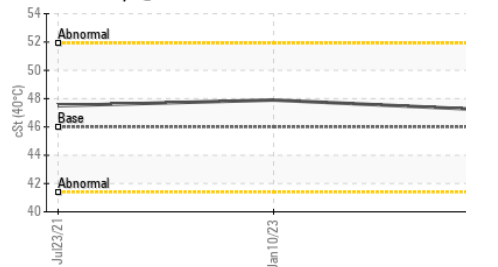


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	▲ 1.0


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.2	47.9	47.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


### Ferrous Alloys

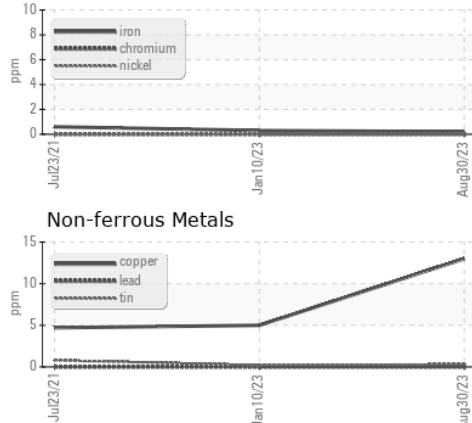


### Non-ferrous Metals

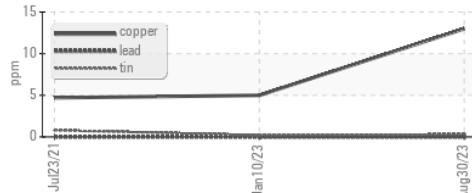


### Viscosity @ 40°C

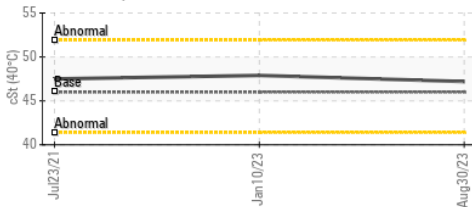

### ▲ Particle Count

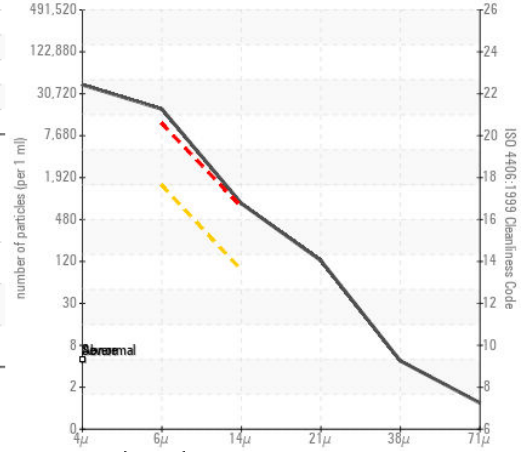

### Acid Number

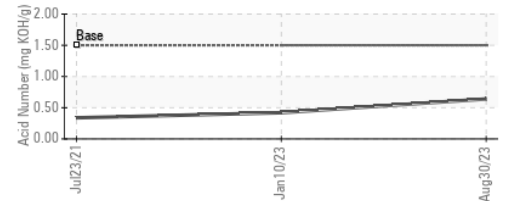

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA003521 **Received** : 25 Sep 2023  
**Lab Number** : 05960652 **Diagnosed** : 27 Sep 2023  
**Unique Number** : 10661865 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**BRADY ENTERPRISES**  
 45 FINNELL DR  
 EAST WEYMOUTH, MA  
 US 02189

Contact: S GOUPIL  
 SGOUPIL@BRADYENTERPRISES.COM

T:  
 F: