


PROBLEM SUMMARY

Sample Rating Trend




ISO

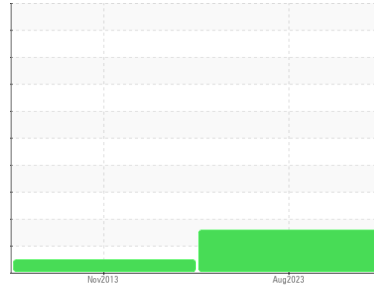

Machine Id
KAESER SM10 4509064 (S/N 1004)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

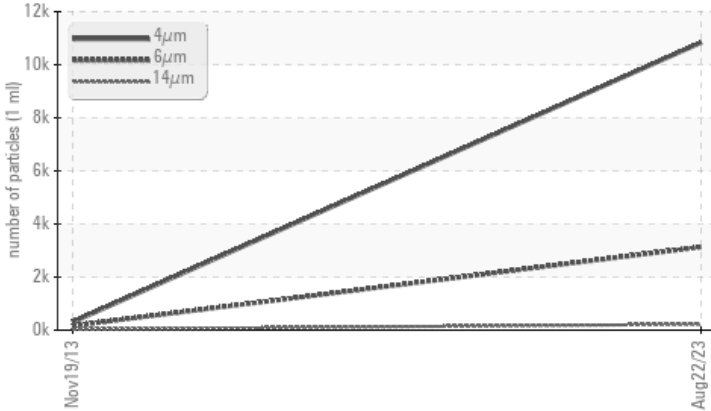

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 3130	163	---
Particles >14µm	ASTM D7647	>80	▲ 223	27	---
Particles >21µm	ASTM D7647	>20	▲ 50	9	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	15/12	---

Customer Id: CALPOT
Sample No.: KC05960653
Lab Number: 05960653
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

19 Nov 2013 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER SM10 4509064 (S/N 1004)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

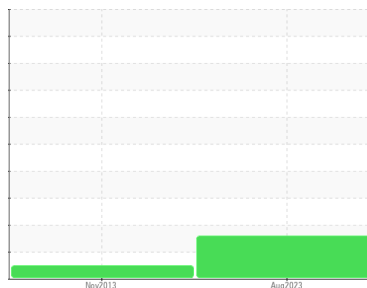

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC05960653	KC41883	---
Sample Date	Client Info			22 Aug 2023	19 Nov 2013	---
Machine Age	hrs	Client Info		19815	1802	---
Oil Age	hrs	Client Info		0	1802	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	<1	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	3	1	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	0	4	---
Molybdenum	ppm	ASTM D5185m	0	<1	<1	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	100	60	78	---
Calcium	ppm	ASTM D5185m	0	2	2	---
Phosphorus	ppm	ASTM D5185m	0	6	2	---
Zinc	ppm	ASTM D5185m	0	0	7	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		22	16	---
Potassium	ppm	ASTM D5185m	>20	4	1	---
Water	%	ASTM D6304	>0.05	0.018	0.018	---
ppm Water	ppm	ASTM D6304	>500	184.3	180	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10836	300	---
Particles >6µm		ASTM D7647	>1300	▲ 3130	163	---
Particles >14µm		ASTM D7647	>80	▲ 223	27	---
Particles >21µm		ASTM D7647	>20	▲ 50	9	---
Particles >38µm		ASTM D7647	>4	2	1	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/15	15/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.361	---

OIL ANALYSIS REPORT

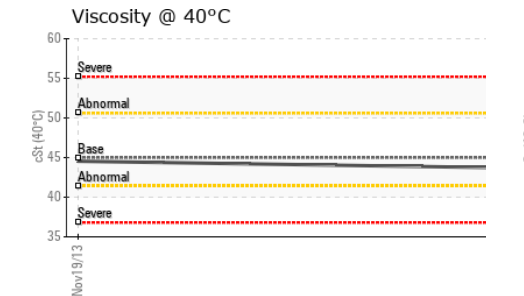
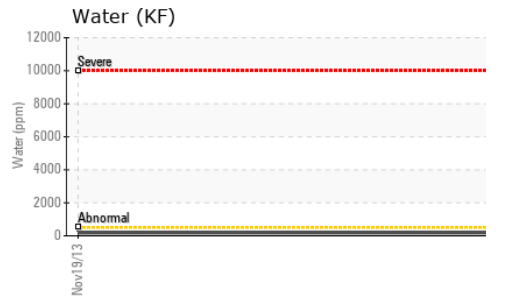
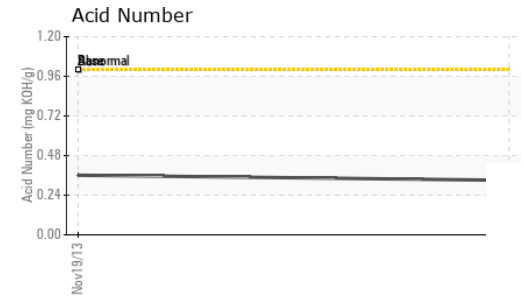
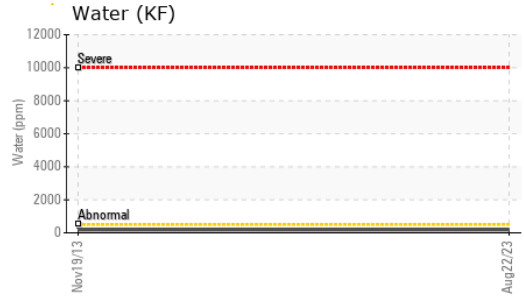
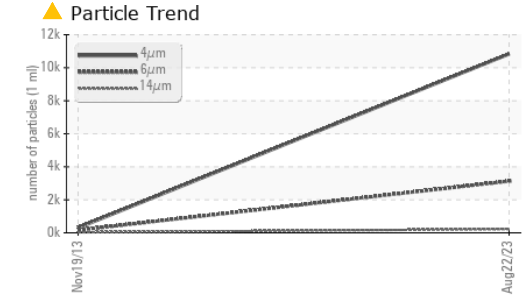


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.7	44.54

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

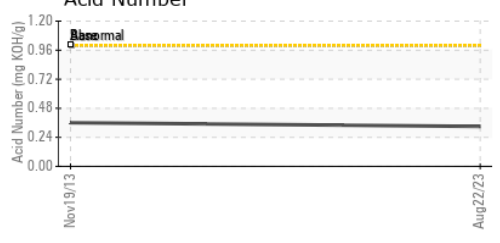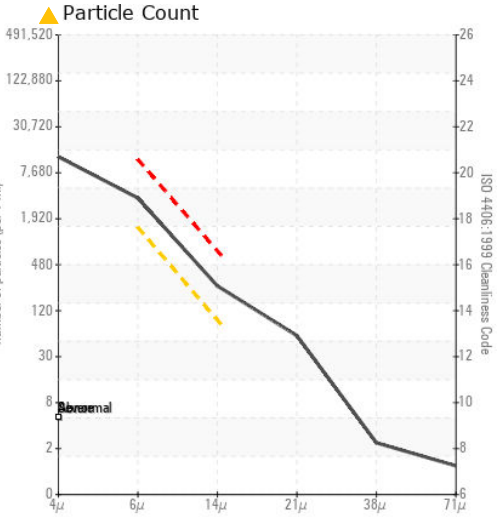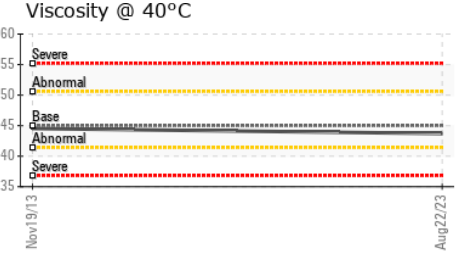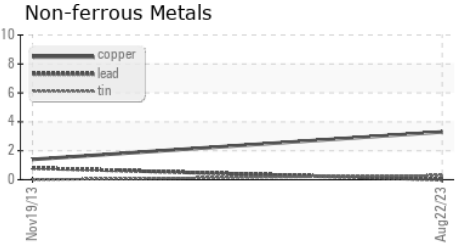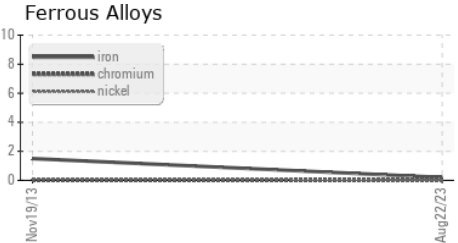

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC05960653
Lab Number : 05960653
Unique Number : 10661866
Test Package : IND 2
Received : 25 Sep 2023
Diagnosed : 27 Sep 2023
Diagnostician : Angela Borella

CALIFORNIA CLOSETS CO
 163 FRICKS LOCK RD
 POTTSTOWN, PA
 US 19465
 Contact: A MALONE
 AMALONE@CALCLOSETS.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)