

PROBLEM SUMMARY

Sample Rating Trend

WATER


7948398 (S/N 1168)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

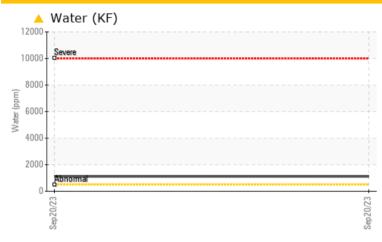

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS										
Sample Status				ABNORMAL						
Water	%	ASTM D6304	>0.05	△ 0.111						
nnm Water	nnm	ASTM D6304	>500	A 1110						

Customer Id: CROVANCA Sample No.: KC126076 Lab Number: 05960657 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

7948398 (S/N 1168)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Sample Rating Trend



DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126076		
Sample Date		Client Info		20 Sep 2023		
Machine Age	hrs	Client Info		3757		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	73		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	6		
Water	%	ASTM D6304	>0.05	<u> </u>		
ppm Water	ppm	ASTM D6304	>500	<u> </u>		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1446		
Particles >6µm		ASTM D7647	>1300	265		
Particles >14μm		ASTM D7647	>80	7		
Particles >21μm		ASTM D7647	>20	1		
Particles >38μm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/10		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.42		



OIL ANALYSIS REPORT

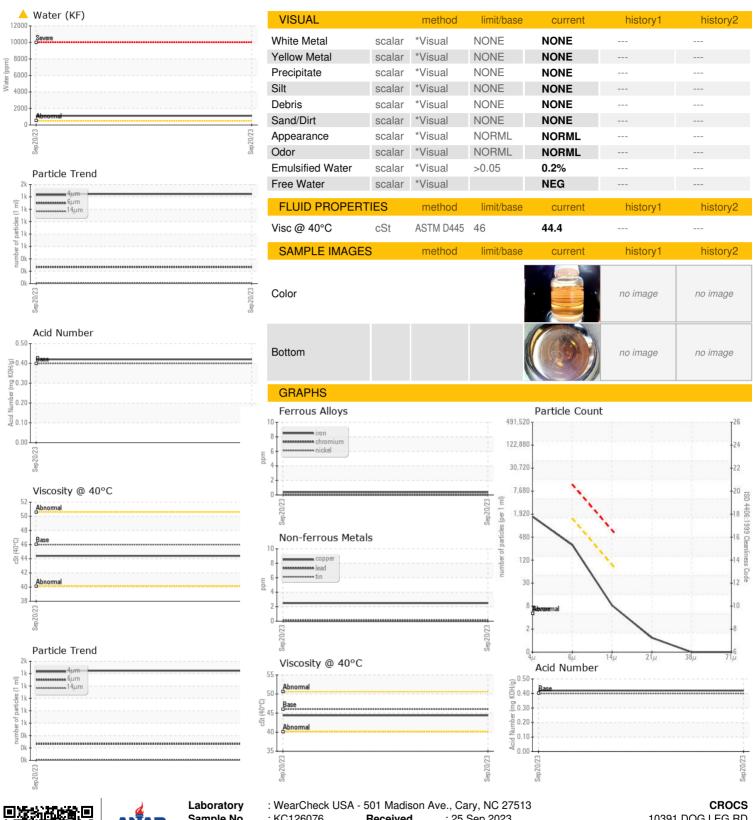



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC126076 : 05960657 : 10661870 : IND 2

: 25 Sep 2023 Received Diagnosed : 29 Sep 2023 Diagnostician

: Jonathan Hester

10391 DOG LEG RD VANDALIA, OH US 45377 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: