


PROBLEM SUMMARY

KAESER SK 20 4514679 (S/N 1195)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

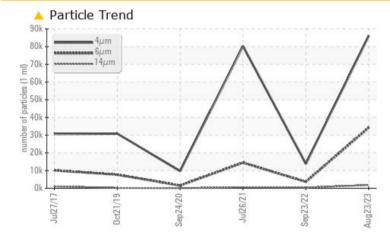

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL		
Particles >6µm	ASTM D7647	>1300	<u> </u>	A 3607	🔺 14465		
Particles >14µm	ASTM D7647	>80	🔺 1817	A 381	6 557		
Particles >21µm	ASTM D7647	>20	<u> </u>	<u> </u>	4 94		
Particles >38µm	ASTM D7647	>4	<u> </u>	3	3		
Oil Cleanliness	ISO 4406 (c)	>/17/13	A 24/22/18	21/19/16	2 1/16		


Customer Id: KRBWRI Sample No.: KCPA000750 Lab Number: 05960661 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

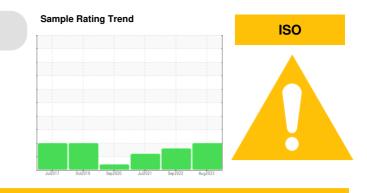

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

23 Sep 2022 Diag: Jonathan Hester




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

26 Jul 2021 Diag: Angela Borella

We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

24 Sep 2020 Diag: Angela Borella





view report



OIL ANALYSIS REPORT

Machine Id KAESER SK 20 4514679 (S/N 1195) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

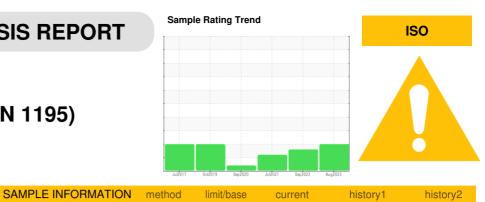


SAMPLE INFOR	VIATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000750	KCP49988	KCP37585
Sample Date		Client Info		23 Aug 2023	23 Sep 2022	26 Jul 2021
Machine Age	hrs	Client Info		42429	37622	31579
Oil Age	hrs	Client Info		0	6500	3000
Oil Changed		Client Info		N/A	Changed	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	0	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	13	10	12
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	15
Barium	ppm	ASTM D5185m	90	0	2	8
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	4
Magnesium	ppm	ASTM D5185m	100	5	1	57
Calcium	ppm	ASTM D5185m	0	<1	0	0
Phosphorus	ppm	ASTM D5185m	0	3	7	2
Zinc	ppm	ASTM D5185m	0	0	0	15
Sulfur	ppm	ASTM D5185m		22313	22308	16578
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		5	0	9
Potassium	ppm	ASTM D5185m	>20	1	<1	0
Water	%	ASTM D6304		0.005	0.008	0.028
ppm Water	ppm	ASTM D6304		52.2	87.2	284.5
FLUID CLEANLIN	VESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		86156	13813	80336
Particles >6µm		ASTM D7647	>1300	A 34293	A 3607	1 4465
Particles >14µm		ASTM D7647	>80	A 1817	A 381	▲ 557
Particles >21µm		ASTM D7647	>20	A 366	<u> </u>	4 94
Particles >38µm		ASTM D7647	>4	<u> </u>	3	3
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	4/22/18	A 21/19/16	2 1/16
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.42	0.378


Report Id: KRBWRI [WUSCAR] 05960661 (Generated: 09/27/2023 14:05:46) Rev: 1


Contact/Location: ? ? - KRBWRI




OIL ANALYSIS REPORT





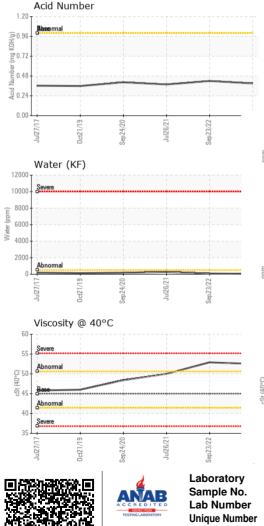

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	52.5	52.9	50.0
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color				3.		



Bottom

