

## **PROBLEM SUMMARY**


Built for a lifetime."

#### Machine Id KAESER SK 20 7789838 (S/N 1575) Component

Compressor



#### COMPONENT CONDITION SUMMARY

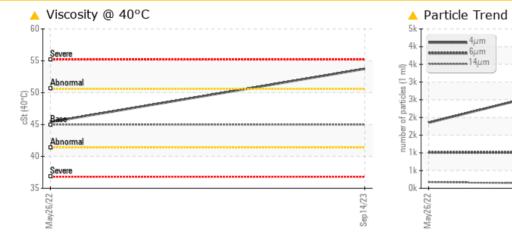

#### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### **PROBLEMATIC TEST RESULTS**

Sample Status				ABNORMAL	ABNORMAL	
Particles >14µm		ASTM D7647	>80	<mark>人</mark> 84	<b>1</b> 72	
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	🔺 18/17/15	
Visc @ 40°C	cSt	ASTM D445	45	<b>6</b> 53.74	45.4	


Customer Id: HOMBRI Sample No.: KCPA001056 Lab Number: 05960669 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 ihester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

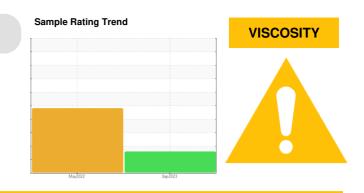

Sep14/23

There are no recommended actions for this sample.

#### HISTORICAL DIAGNOSIS

#### 26 May 2022 Diag: Doug Bogart

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.All component wear rates are normal. There is a high amount of particulates present in the oil. Free water present. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.





### **OIL ANALYSIS REPORT**

#### Sample Rating Trend

VISCOSITY

# KAESER SK 20 7789838 (S/N 1575)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

			Mayzuzz	Sep2023		
SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA001056	KCP49540	
Sample Date		Client Info		14 Sep 2023	26 May 2022	
Machine Age	hrs	Client Info		6556	3770	
Oil Age	hrs	Client Info		0	3770	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
÷			11 11 11			
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	8	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	26	4	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	52	
	ppm			-		
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m	100	<1	<1	
Magnesium	ppm	ASTM D5185m	100	8	57	
Calcium	ppm	ASTM D5185m	0	<1	<1	
Phosphorus	ppm	ASTM D5185m	0	5	16	
Zinc	ppm	ASTM D5185m	0	0	9	
Sulfur	ppm	ASTM D5185m	23500	20843	17403	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		4	2	
Potassium	ppm	ASTM D5185m	>20	2	2	
Water	%	ASTM D6304	>0.05	0.006	▲ 0.283	
ppm Water	ppm	ASTM D6304	>500	67.8	<b>A</b> 2830	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4065	1853	
Particles >6µm		ASTM D7647	>1300	1004	1009	
Particles >14µm		ASTM D7647	>80	▲ 84	▲ 172	
Particles >21µm		ASTM D7647		<u> </u>	▲ 58	
Particles >38µm		ASTM D7647	>4	2	▲ 9	
Particles >71µm		ASTM D7647 ASTM D7647		1	1	
Oil Cleanliness						
		ISO 4406 (c)	>/17/13	<b>19/17/14</b>	▲ 18/17/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.57	



Water (KF)

Abnorma

1200

1000


800


2000


(maa)

Water

## **OIL ANALYSIS REPORT**

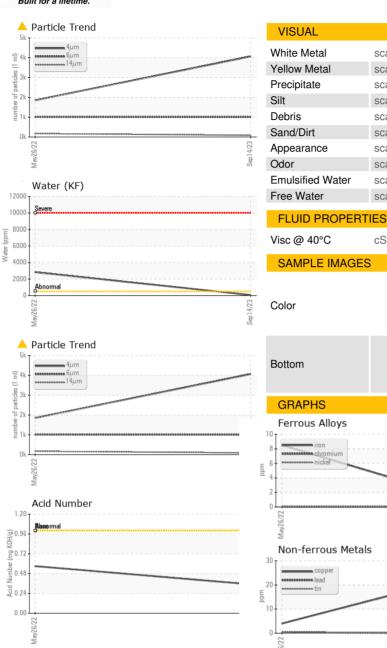

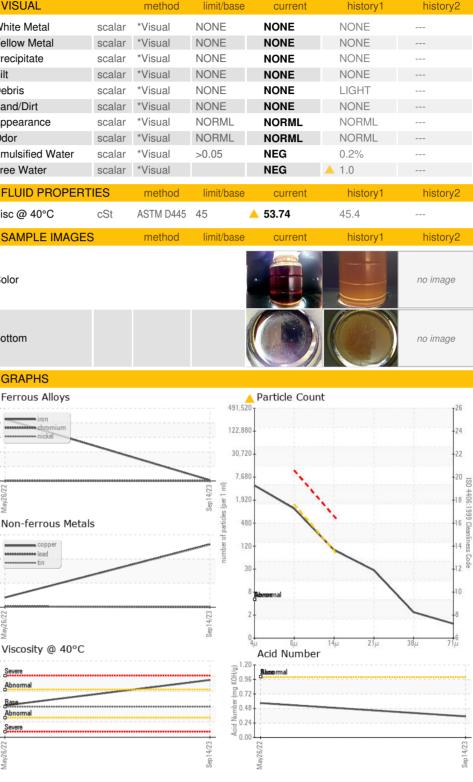

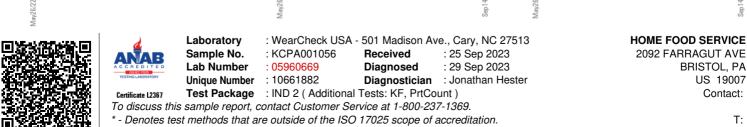

<sup>\* -</sup> Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

60

55

(10°C)

ಕ್ಷ 45

40

35

T: F: