




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**JBS-310Plus-46**  
 Machine Id  
**GARDNER DENVER S064930 - MARTINREA**  
 Component  
**Compressor**

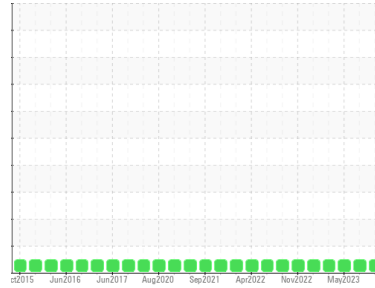

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05960722</b>	UCH05922868	UCH05861996
Sample Date	Client Info			<b>21 Sep 2023</b>	31 Jul 2023	18 May 2023
Machine Age	hrs	Client Info		<b>152330</b>	151420	150345
Oil Age	hrs	Client Info		<b>930</b>	7174	6099
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	2	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.3	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.9	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0.2	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	0.1	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	429	<b>341</b>	319	319
Zinc	ppm	ASTM D5185m	0.3	<b>32</b>	31	23
Sulfur	ppm	ASTM D5185m	1336	<b>853</b>	501	448



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	5	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	<b>0.64</b>	0.80	0.66

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



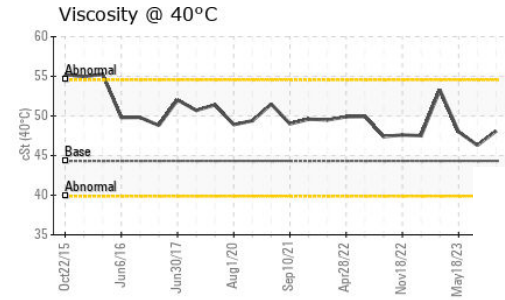
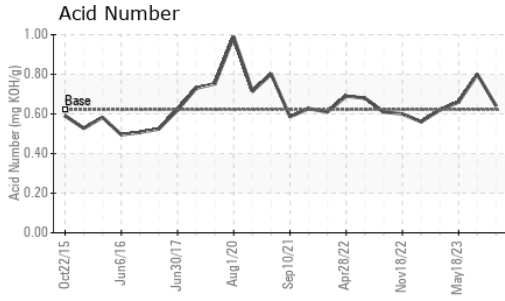


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.32	<b>48.1</b>	46.3	48.0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

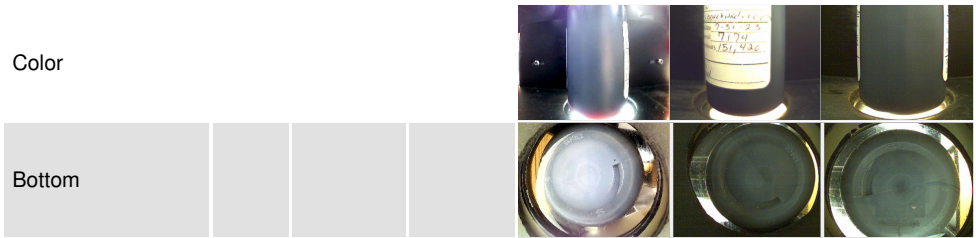

## GRAPHS

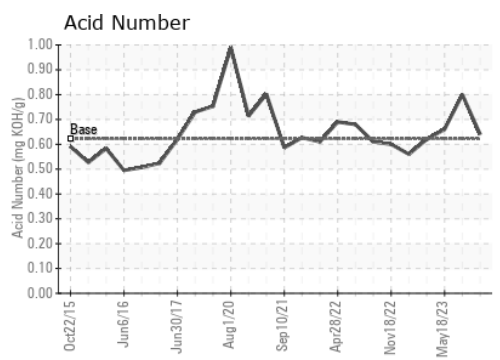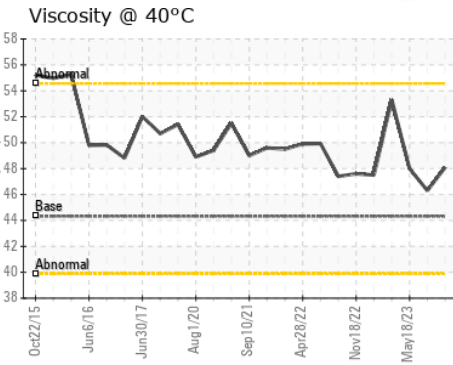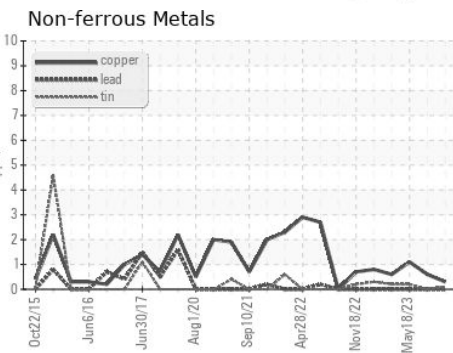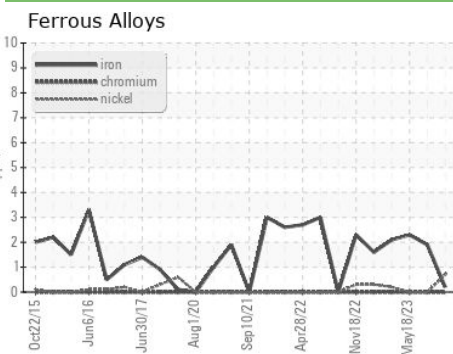

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05960722  
**Lab Number** : **05960722**  
**Unique Number** : 10661935  
**Test Package** : IND 2

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)