




PROBLEM SUMMARY

Sample Rating Trend


ISO

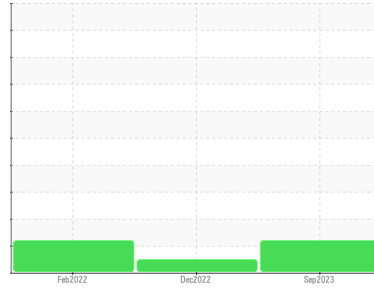

Area
IRON STAR [200006142]
 Machine Id
39WEA88284
 Component
Wind Turbine Gearbox
 Fluid
GEAR OIL (PAO) ISO 320 (--- LTR)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

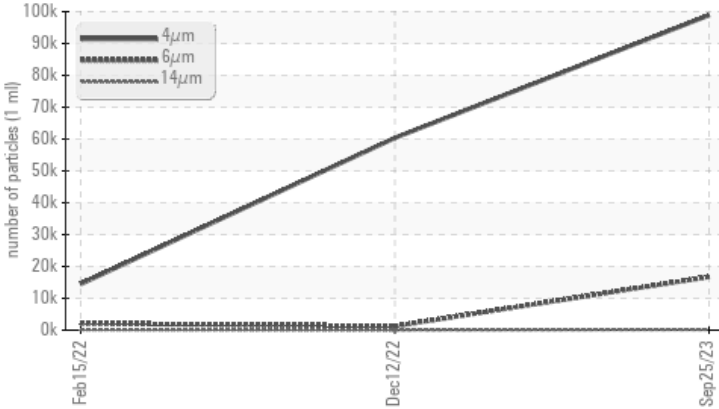

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 16717	1248	▲ 2094
Particles >14µm	ASTM D7647 >160	▲ 171	52	▲ 165
Oil Cleanliness	ISO 4406 (c) >17/14	▲ 21/15	17/13	▲ 21/18/15

Customer Id: NORDEX
 Sample No.: NX05961230
 Lab Number: 05961230
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

12 Dec 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Feb 2022 Diag: Don Baldrige

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

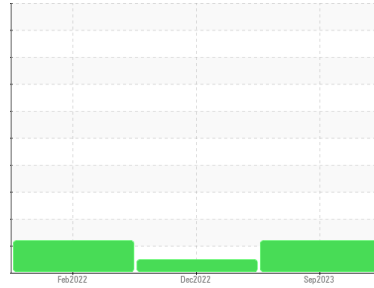

ISO



Area
IRON STAR [200006142]
 Machine Id
39WEA88284
 Component
Wind Turbine Gearbox
 Fluid
GEAR OIL (PAO) ISO 320 (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	NX05961230	NX05739643	NX05491175
Sample Date	Client Info	25 Sep 2023	12 Dec 2022	15 Feb 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>50	18	10	17	
Iron	ppm	ASTM D5185m	>30	23	21	9
Chromium	ppm	ASTM D5185m	>3	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>10	0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>30	0	0	<1
Lead	ppm	ASTM D5185m	>15	0	<1	<1
Copper	ppm	ASTM D5185m	>10	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	25	5	8	10
Barium	ppm	ASTM D5185m	12	0	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	25	0	0	0
Calcium	ppm	ASTM D5185m	25	16	18	20
Phosphorus	ppm	ASTM D5185m	375	210	205	249
Zinc	ppm	ASTM D5185m	25	0	3	0
Sulfur	ppm	ASTM D5185m	4900	5506	5217	4293

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+15	8	8	8
Sodium	ppm	ASTM D5185m		2	3	2
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.02	0.002	0.006	0.001
ppm Water	ppm	ASTM D6304	>200	24.4	64.7	6.9

FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647		98896	60353	14471
Particles >6µm	ASTM D7647	>1300	▲ 16717	1248	▲ 2094
Particles >14µm	ASTM D7647	>160	▲ 171	52	▲ 165
Particles >21µm	ASTM D7647	>40	34	12	▲ 28
Particles >38µm	ASTM D7647	>10	1	0	2
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>17/14	▲ 21/15	17/13	▲ 21/18/15

FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.10	0.36	0.33	0.41




OIL ANALYSIS REPORT

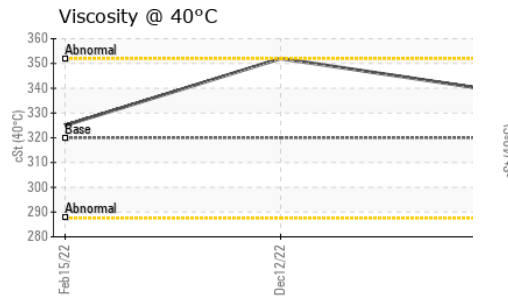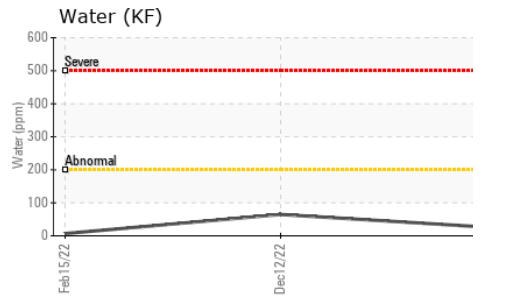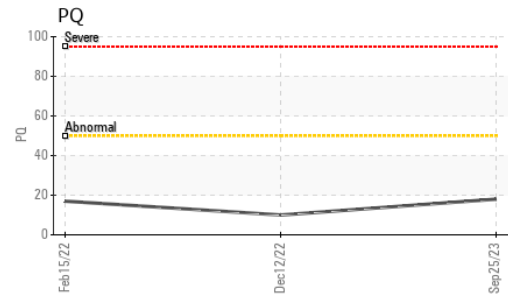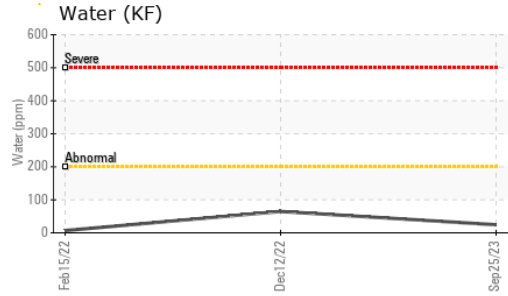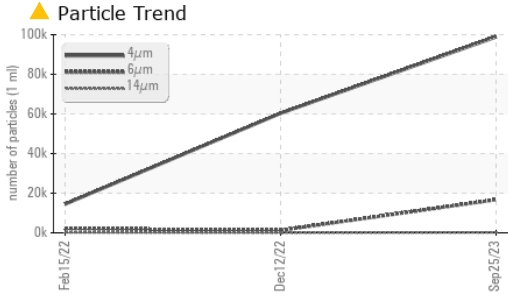






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	339	352	325

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

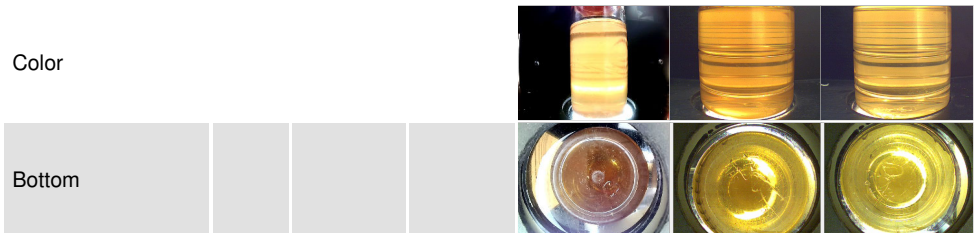

GRAPHS

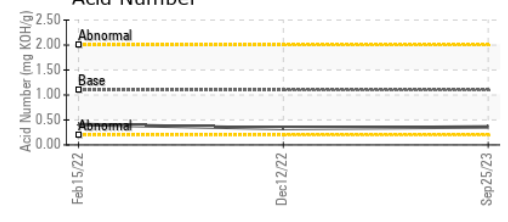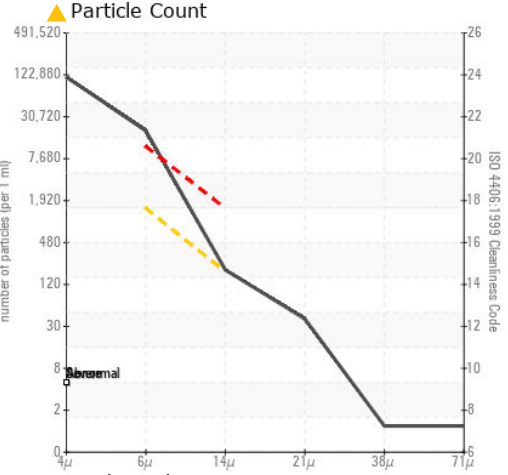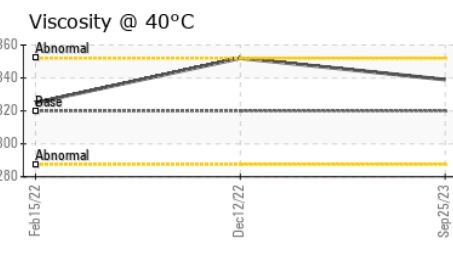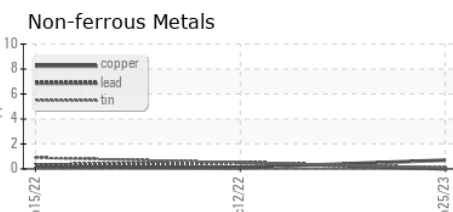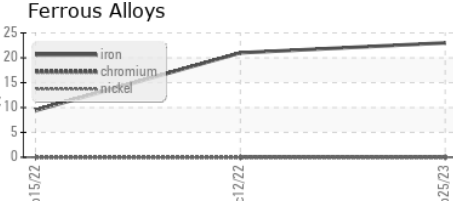

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX05961230 **Received** : 26 Sep 2023
Lab Number : 05961230 **Diagnosed** : 27 Sep 2023
Unique Number : 10662443 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)