


PROBLEM SUMMARY

KAESER ASD 40 5416472 (S/N 1124)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

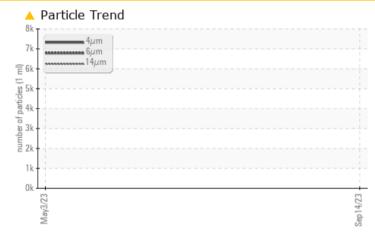

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL ABNOR	RMAL
Particles >6µm	ASTM D7647 >130	0 🔺 2309	
Particles >14µm	ASTM D7647 >80	<u> </u>	
Particles >21µm	ASTM D7647 >20	<u>▲</u> 60	
Oil Cleanliness	ISO 4406 (c) >/1	7/13 🔺 20/18/15	


Customer Id: UNIUNICA Sample No.: KCPA003668 Lab Number: 05961256 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

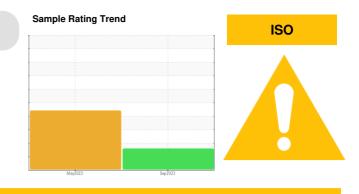

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 May 2023 Diag: Don Baldridge

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.





OIL ANALYSIS REPORT

KAESER ASD 40 5416472 (S/N 1124)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

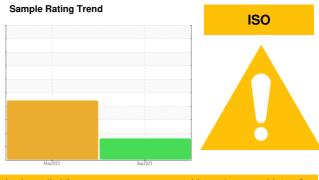



SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003668	KCP52374	
Sample Date		Client Info		14 Sep 2023	03 May 2023	
Machine Age	hrs	Client Info		51689	48736	
Oil Age	hrs	Client Info		0	48736	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	3	8	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	<1	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	0	18	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	2	<1	
Zinc	ppm	ASTM D5185m	0	0	48	
Sulfur	ppm	ASTM D5185m	23500	21016	21619	
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	4	
Potassium	ppm	ASTM D5185m	>20	0	3	
Water	%	ASTM D6304	>0.05	0.004	0 .188	
ppm Water	ppm	ASTM D6304	>500	47.6	1 880	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7536		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.49	0.32	




Built for a lifetime.

OIL ANALYSIS REPORT





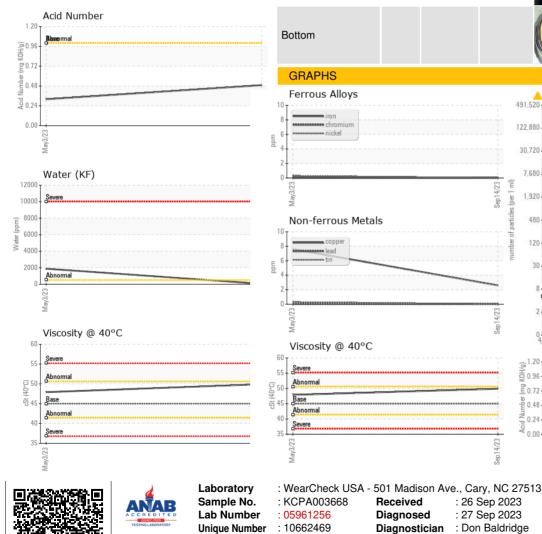

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	🔺 MODER	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	🔺 HAZY	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%	
Free Water	scalar	*Visual		NEG	▲ 1.0	
FLUID PROPER	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.9	47.9	
SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Color				a.		no image
Bottom						no image
GRAPHS			-			
Ferrous Alloys				Particle Coun	t	
iron			491,520) 		T ²⁶
chromium			122,880			-24
nickel						
			30,720	1		-22
			7,680			-20 2
May3/23			Sep 14/23 (per 1 ml			-18
M			Sep .	//	N .	10 0
Non-ferrous Meta	ls		pitred 480		$\overline{\ }$	-18 c -18 c -16 c -14 gg
copper			Sep14/23 8ep14/23 156'1 ml) 156'1 ml)			-14 8
tin						-12
			30	1		12 4
				Abrevenal		10
					,	
May3/22			Sep14/23			
			Sel) 4μ 6μ	14µ 21µ	38µ 71µ
Viscosity @ 40°C				Acid Number		т. — — т." Г
Severe) HO 0.96 س 0.72	Basermal		
Abnormal			Q 0.96			
			5.0.74			

-e 0.48

0.00

Mav3

Acid Nu 0.24

Sep14/23 -

: 26 Sep 2023

: 27 Sep 2023

Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Base

Seve

Abnorma

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

4/23

Sep.

UNIVERSAL STUDIOS

UNIVERSAL CITY, CA

Contact: Service Manager

100 UNIVERSAL CITY PLAZA

Certificate L2367

Contact/Location: Service Manager - UNIUNICA

US 91608