

# **PROBLEM SUMMARY**

Sample Rating Trend




SL4-4 ASSET 8416 (S/N C0125000493)

**Vacuum Pump** 

**USPI 1580-150 (11 GAL)** 

# **COMPONENT CONDITION SUMMARY**

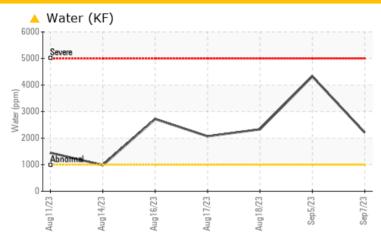

# RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL				
Water	%	ASTM D6304	>.1	<b>△</b> 0.220	<b>△</b> 0.432	<b>△</b> 0.233				
ppm Water	ppm	ASTM D6304	>1000	<b>2209.4</b>	<b>▲</b> 4323.9	<b>2334.0</b>				

Customer Id: CAMLES\_USP Sample No.: USPM27242 Lab Number: 05961265 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

# HISTORICAL DIAGNOSIS

# 05 Sep 2023 Diag: Doug Bogart

#### WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 18 Aug 2023 Diag: Doug Bogart

#### WATER



We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service. pH measured at 7.0.



# 17 Aug 2023 Diag: Doug Bogart

#### WATER




We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



**WATER** 

# SL4-4 ASSET 8416 (S/N C0125000493)

Vacuum Pump

**USPI 1580-150 (11 GAL)** 

# **DIAGNOSIS**

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

# Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2023	Aug2023 Aug2023	Aug2023 Aug2023 Sep2023	Sep2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM27242	USPM27243	USPM27244
Sample Date		Client Info		07 Sep 2023	05 Sep 2023	18 Aug 2023
Machine Age	hrs	Client Info		767	728	0
Oil Age	hrs	Client Info		39	0	106
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	4	0	2
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		1	5	<1
Calcium	ppm	ASTM D5185m		0	1	<1
Phosphorus	ppm	ASTM D5185m		1716	1645	1757
Zinc	ppm	ASTM D5185m		1	0	17
Sulfur	ppm	ASTM D5185m		1352	1300	1380
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	27	2	23
Sodium	ppm	ASTM D5185m		2	2	2
Potassium	ppm	ASTM D5185m	>20	4	4	2
Water	%	ASTM D6304	>.1	<b>△</b> 0.220	△ 0.432	<b>△</b> 0.233
ppm Water	ppm	ASTM D6304	>1000	<b>2209.4</b>	▲ 4323.9	<u>▲</u> 2334.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	3712	<b>△</b> 35639	930
Particles >6µm		ASTM D7647	>1300	1084	<u></u> 7710	280
Particles >14μm		ASTM D7647	>160	40	<u></u> 538	23
Particles >21µm		ASTM D7647	>40	10	<u>▲</u> 154	6
Particles >38μm		ASTM D7647	>10	1	10	0
Particles >71µm		ASTM D7647	>3	0	2	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	19/17/12	<u>22/20/16</u>	17/15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.756	0.96	0.75



# **OIL ANALYSIS REPORT**



\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: