


## **OIL ANALYSIS REPORT**

#### **Sample Rating Trend**



NORMAL



# **GARDNER DENVER GD-2 (R-150)**

Component

Compressor

**GARDNER DENVER AEON 9000 SP (6 GAL)** 

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

L)		Dec2019	Nov2020 Jul2021	Dec2021 Aug2022	Sep 2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0001896	USP248089	USP242959
Sample Date		Client Info		25 Sep 2023	05 May 2023	21 Aug 2022
Machine Age	hrs	Client Info		35270	32879	27962
Oil Age	hrs	Client Info		5000	4500	7000
Oil Changed	0	Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	0	0
Tin	ppm	ASTM D5185m	>15	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	800	694	732	626
Zinc	ppm	ASTM D5185m	0	0	0	2
Sulfur	ppm	ASTM D5185m	0	13	0	15
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6	4	2
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	0	1	<1
Water	%	ASTM D6304	>0.1	0.015	0.020	0.037
ppm Water	ppm	ASTM D6304	>1000	150.4	204.9	379.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	530	1391	4202
Particles >6µm		ASTM D7647	>2500	104	231	590
Particles >14μm		ASTM D7647	>320	8	12	14
Particles >21µm		ASTM D7647	>80	2	1	3
Particles >38µm		ASTM D7647	>20	1	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	18/15/11	19/16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.170	0.35	0.26	0.25



## **OIL ANALYSIS REPORT**

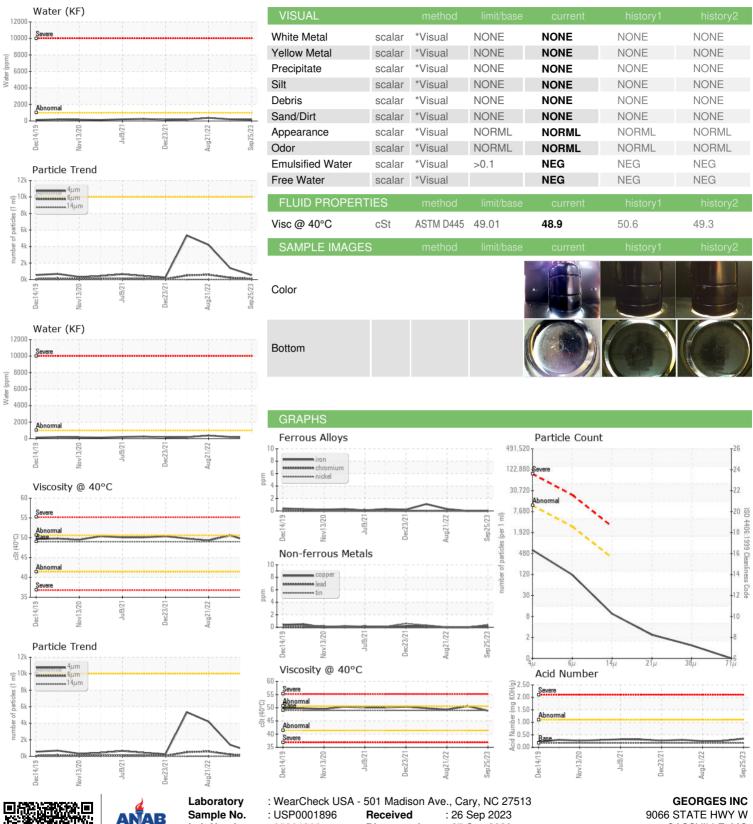



Certificate L2367

Lab Number **Unique Number** 

Test Package

: 05961266 : 10662479

Diagnosed Diagnostician

: 27 Sep 2023 : Doug Bogart

CASSVILLE, MO US 65625

Contact: DANIEL FERGUSON

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: