




Area  
**ULTRA 46**  
Machine Id  
**SULLAIR 201009300044 - JELD WEN**  
Component  
**Compressor**

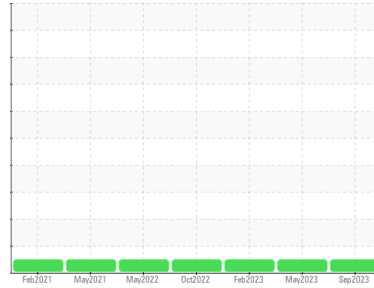

**DIAGNOSIS**

- Recommendation**  
Resample at the next service interval to monitor.
- Wear**  
All component wear rates are normal.
- Contamination**  
There is no indication of any contamination in the oil.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS05961327</b>	UCS05871030	UCS05773996
Sample Date	Client Info			<b>20 Sep 2023</b>	31 May 2023	17 Feb 2023
Machine Age	hrs Client Info			<b>18859</b>	16981	15410
Oil Age	hrs Client Info			<b>5884</b>	4006	2435
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>5</b>	4	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>3</b>	3	2
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>1</b>	0	0
Calcium	ppm	ASTM D5185m		<b>16</b>	11	5
Phosphorus	ppm	ASTM D5185m		<b>125</b>	183	162
Zinc	ppm	ASTM D5185m		<b>9</b>	0	3
Sulfur	ppm	ASTM D5185m		<b>455</b>	679	668

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>30</b>	3	3
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.40</b>	0.36	0.41


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT



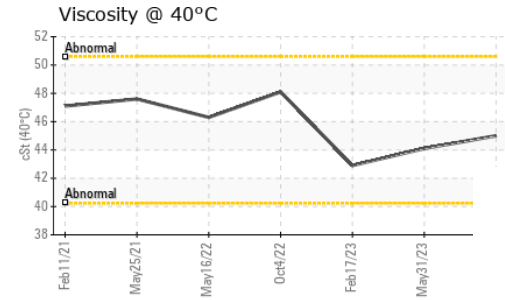
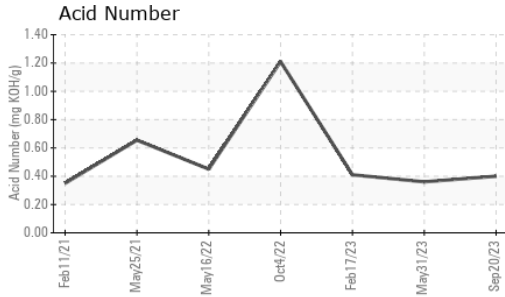


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>45.0</b>	44.1	42.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

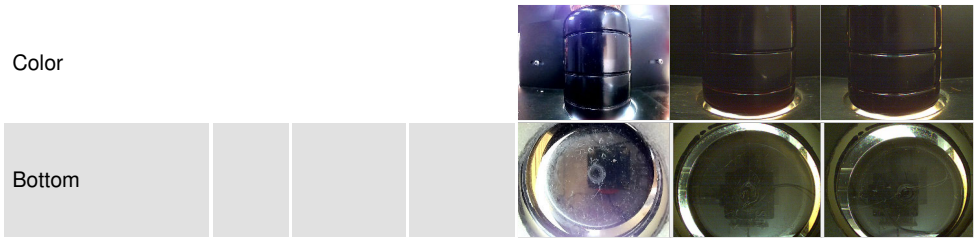

## GRAPHS

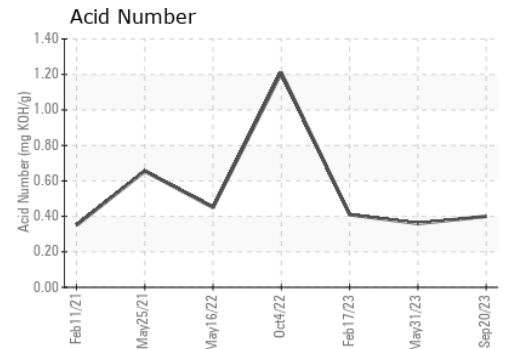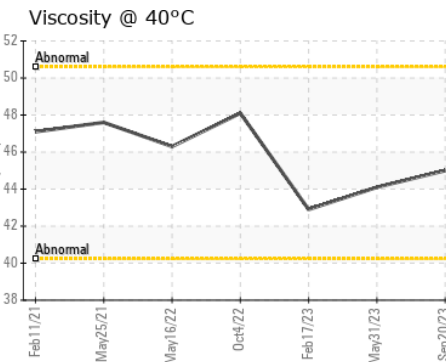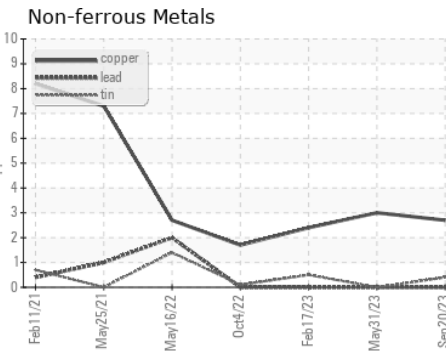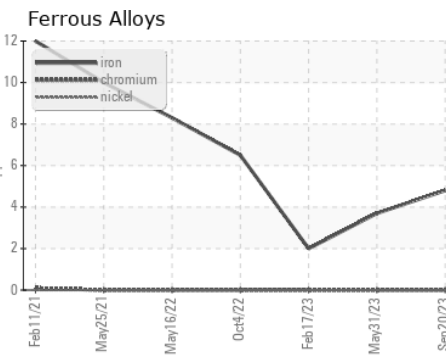

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS05961327  
**Lab Number** : 05961327  
**Unique Number** : 10662540  
**Test Package** : IND 2  
**Received** : 26 Sep 2023  
**Diagnosed** : 27 Sep 2023  
**Diagnostician** : Don Baldrige

**STANLEY HEATING & AIR**  
 1002 DOBBINS MILL RD  
 ELKIN, NC  
 US 28621  
 Contact: DARRYL WEDDLE  
 darryl@stanleyvac.com  
 T: (336)366-4226  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)