




PROBLEM SUMMARY

Sample Rating Trend

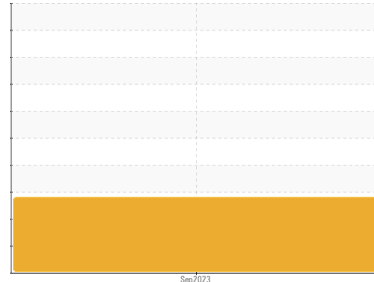

ISO




Machine Id
1413896 (S/N 1010)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

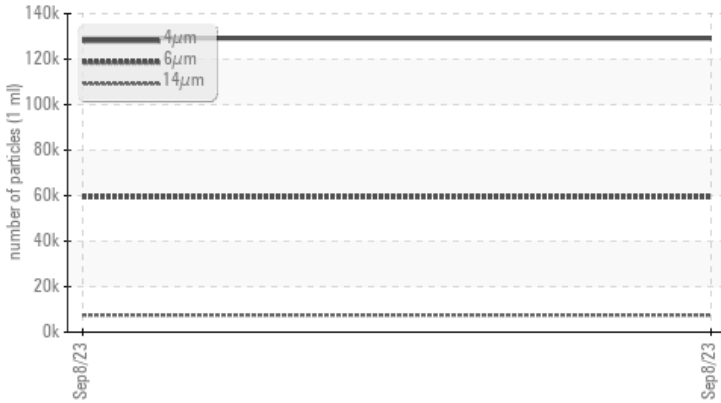

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 59388	---	---	---
Particles >14µm	ASTM D7647	>80	▲ 7473	---	---	---
Particles >21µm	ASTM D7647	>20	▲ 2441	---	---	---
Particles >38µm	ASTM D7647	>4	▲ 136	---	---	---
Particles >71µm	ASTM D7647	>3	▲ 6	---	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 24/23/20	---	---	---
Debris	scalar	*Visual	▲ MODER	---	---	---

Customer Id: DDPGOW
Sample No.: KCPA000694
Lab Number: 05961747
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

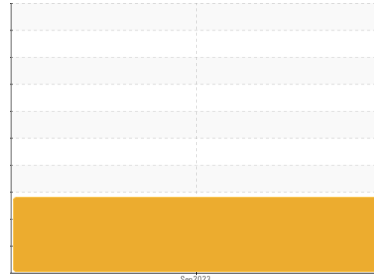

Machine Id
1413896 (S/N 1010)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA000694	---	---
Sample Date	Client Info	08 Sep 2023	---	---
Machine Age	hrs	Client Info	87740	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	1	---	---
Chromium ppm	ASTM D5185m >10	0	---	---
Nickel ppm	ASTM D5185m >3	0	---	---
Titanium ppm	ASTM D5185m >3	<1	---	---
Silver ppm	ASTM D5185m >2	0	---	---
Aluminum ppm	ASTM D5185m >10	3	---	---
Lead ppm	ASTM D5185m >10	0	---	---
Copper ppm	ASTM D5185m >50	16	---	---
Tin ppm	ASTM D5185m >10	<1	---	---
Vanadium ppm	ASTM D5185m	<1	---	---
Cadmium ppm	ASTM D5185m	<1	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	0	---	---
Barium ppm	ASTM D5185m 90	0	---	---
Molybdenum ppm	ASTM D5185m 0	0	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m 100	1	---	---
Calcium ppm	ASTM D5185m 0	3	---	---
Phosphorus ppm	ASTM D5185m 0	18	---	---
Zinc ppm	ASTM D5185m 0	13	---	---
Sulfur ppm	ASTM D5185m 23500	17536	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<1	---	---
Sodium ppm	ASTM D5185m	2	---	---
Potassium ppm	ASTM D5185m >20	2	---	---
Water %	ASTM D6304 >0.05	0.005	---	---
ppm Water	ASTM D6304 >500	56.6	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	129174	---	---
Particles >6µm	ASTM D7647 >1300	▲ 59388	---	---
Particles >14µm	ASTM D7647 >80	▲ 7473	---	---
Particles >21µm	ASTM D7647 >20	▲ 2441	---	---
Particles >38µm	ASTM D7647 >4	▲ 136	---	---
Particles >71µm	ASTM D7647 >3	▲ 6	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 24/23/20	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	0.52	---	---

OIL ANALYSIS REPORT

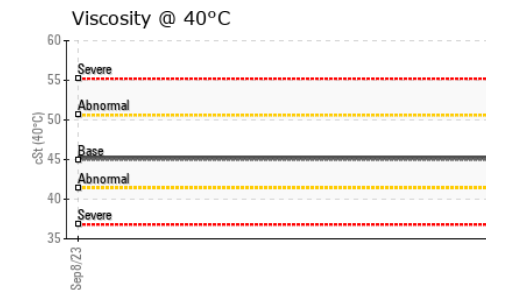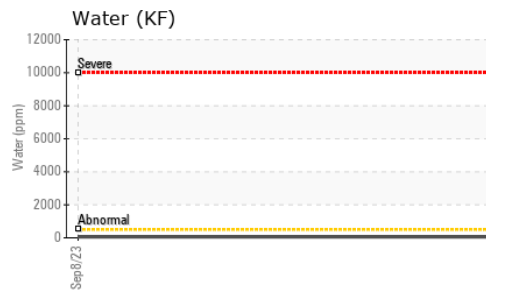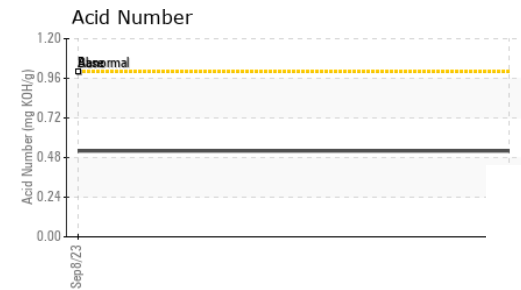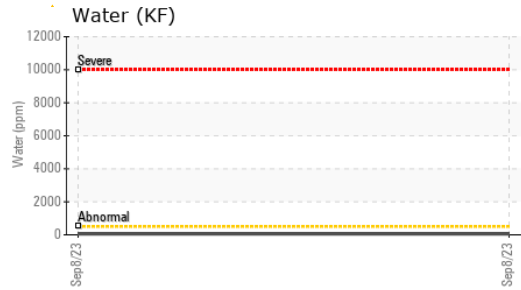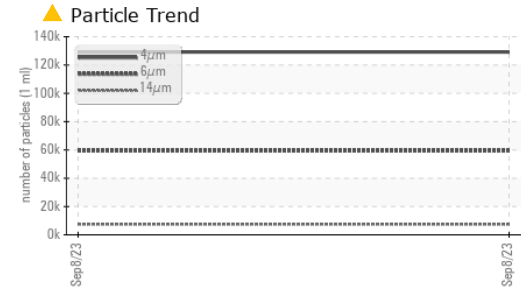





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

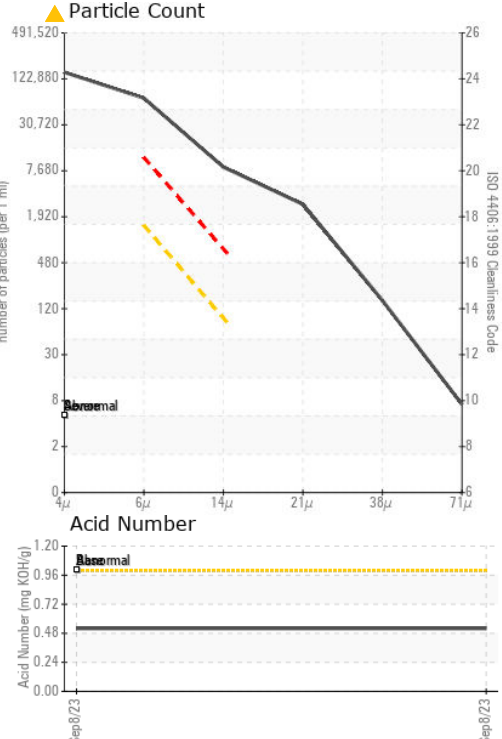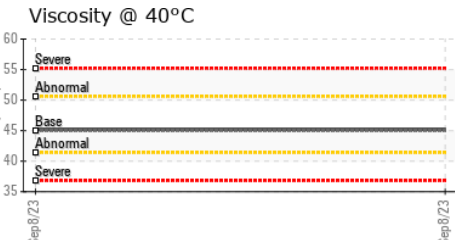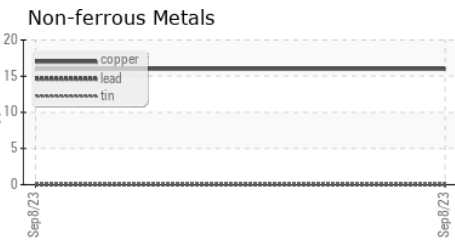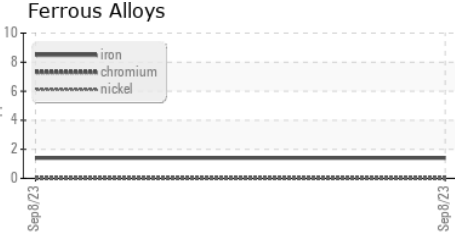

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000694 **Received** : 26 Sep 2023
Lab Number : 05961747 **Diagnosed** : 28 Sep 2023
Unique Number : 10668298 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

D & D PALLET SERVICE
 9230 NW 316TH ST
 GOWER, MO
 US 64454
 Contact: OFFICE
 office@dd-pallet.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)