


# **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



# Machine Id **7174177 (S/N 1265)**

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### DIAGNOSIS

# Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

# Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May2020	Nov2020 May2021	Dec2021 Aug2022	Sep 2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126177	KC98290	KC95306
Sample Date		Client Info		11 Sep 2023	03 Aug 2022	21 Dec 2021
Machine Age	hrs	Client Info		25968	16598	11582
Oil Age	hrs	Client Info		0	3000	0
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	5	5	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	50	25	56
Calcium	ppm	ASTM D5185m	2	1	0	<1
Phosphorus	ppm	ASTM D5185m		3	4	4
Zinc	ppm	ASTM D5185m		0	<1	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		11	9	11
Potassium	ppm	ASTM D5185m	>20	3	1	<1
Water	%	ASTM D6304	>0.05	0.020	0.025	0.012
ppm Water	ppm	ASTM D6304	>500	203.0	259.0	126.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1077	2042	25297
Particles >6µm		ASTM D7647	>1300	324	869	<b>4951</b>
Particles >14µm		ASTM D7647	>80	29	8	<u> </u>
Particles >21µm		ASTM D7647	>20	8	2	<b>△</b> 33
Particles >38µm		ASTM D7647	>4	2	0	4
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12	18/17/10	<b>△</b> 19/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.26	0.27



# **OIL ANALYSIS REPORT**

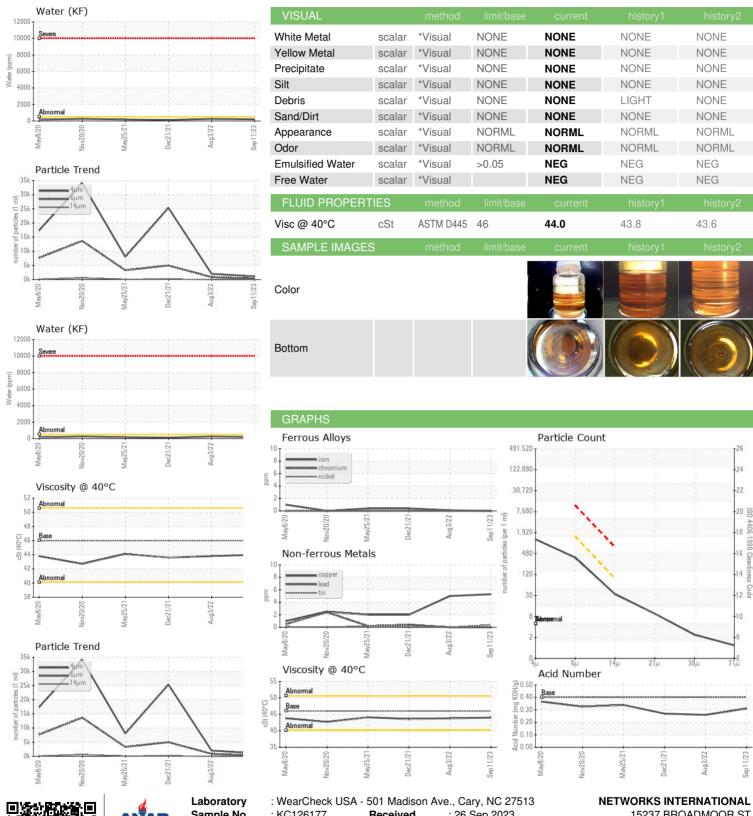





Sample No. Lab Number **Unique Number** 

: 05961753

: KC126177 : 10668304 : IND 2

Received : 26 Sep 2023 : 28 Sep 2023 Diagnosed

: Don Baldridge Diagnostician

Test Package Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

15237 BROADMOOR ST OVERLAND PARK, KS

US 66223 Contact: LAWRENCE

lawrence@nckc.com

T: F: