




PROBLEM SUMMARY


Sample Rating Trend

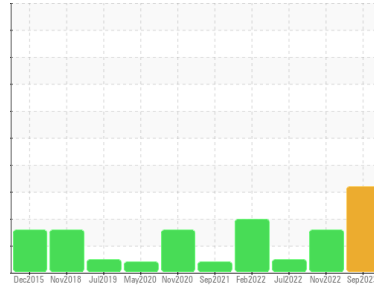


Machine Id
KAESER SM 10 4394402 (S/N 1189)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Silicon (ppm)

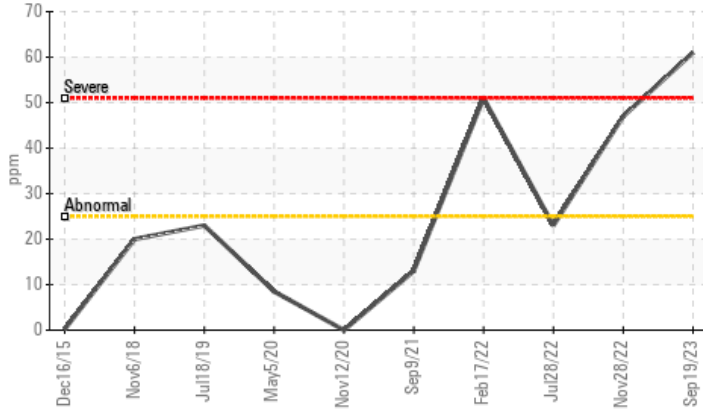

▲ Particle Trend

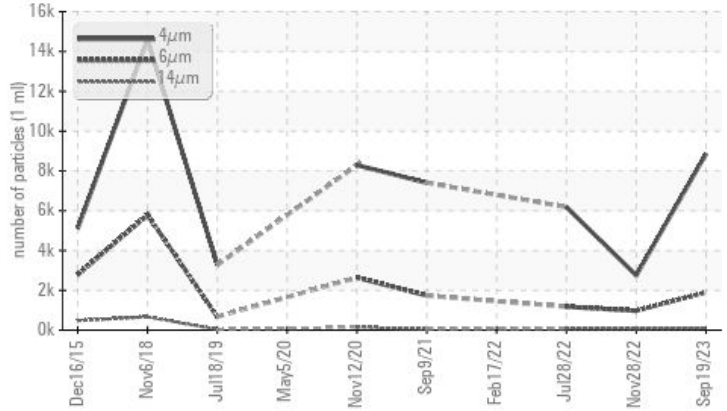

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Silicon	ppm	ASTM D5185m >25	▲ 61	▲ 47	23
Particles >6µm		ASTM D7647 >1300	▲ 1901	974	1178
Particles >14µm		ASTM D7647 >80	▲ 99	79	77
Particles >21µm		ASTM D7647 >20	▲ 24	19	20
Oil Cleanliness		ISO 4406 (c) >17/13	▲ 18/14	17/13	17/13

Customer Id: HMUCHA
 Sample No.: KCPA000954
 Lab Number: 05961755
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 Nov 2022 Diag: Jonathan Hester

DIRT



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. Elemental level of silicon (Si) above normal indicating ingress of seal material. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



28 Jul 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Feb 2022 Diag: Angela Borella

DIRT



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Elemental level of silicon (Si) above normal indicating ingress of seal material. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

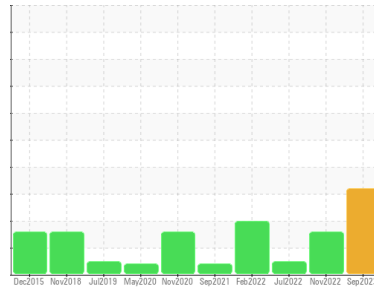

DIRT



Machine Id
KAESER SM 10 4394402 (S/N 1189)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA000954	KCP52285	KCP51839
Sample Date	Client Info		19 Sep 2023	28 Nov 2022	28 Jul 2022
Machine Age	hrs	Client Info	82092	79862	78503
Oil Age	hrs	Client Info	0	2000	500
Oil Changed	Client Info		N/A	Not Changd	Changed
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	3	1	1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	3	2	<1
Tin	ppm	ASTM D5185m >10	<1	<1	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	2
Barium	ppm	ASTM D5185m 90	39	53	68
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	80	82	89
Calcium	ppm	ASTM D5185m 0	4	<1	5
Phosphorus	ppm	ASTM D5185m 0	2	9	3
Zinc	ppm	ASTM D5185m 0	2	3	2
Sulfur	ppm	ASTM D5185m 23500	20670	24237	22127

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	▲ 61	▲ 47	23
Sodium	ppm	ASTM D5185m	28	14	18
Potassium	ppm	ASTM D5185m >20	5	2	1
Water	%	ASTM D6304 >0.05	0.031	0.021	0.027
ppm Water	ppm	ASTM D6304 >500	317.2	214.7	273.2

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8862	2753	6185
Particles >6µm	ASTM D7647	>1300	▲ 1901	974	1178
Particles >14µm	ASTM D7647	>80	▲ 99	79	77
Particles >21µm	ASTM D7647	>20	▲ 24	19	20
Particles >38µm	ASTM D7647	>4	2	1	2
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>17/13	▲ 18/14	17/13	17/13

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.35	0.36	0.41

OIL ANALYSIS REPORT


▲ Silicon (ppm)

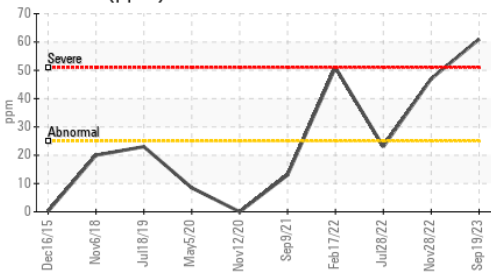


▲ Particle Trend

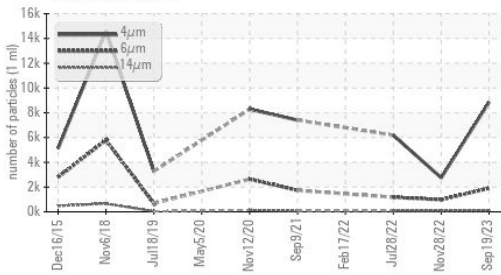


▲ Water (KF)

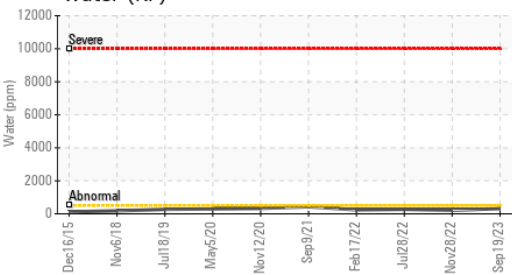

▲ Acid Number

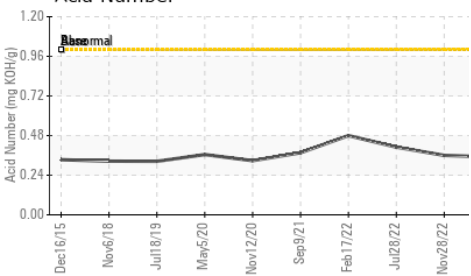


▲ Water (KF)

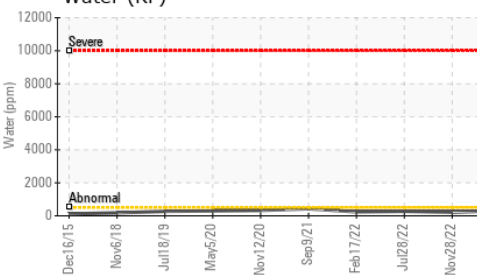





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.1	47.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

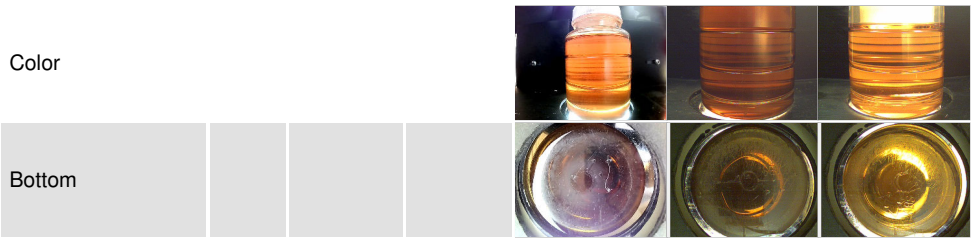

GRAPHS

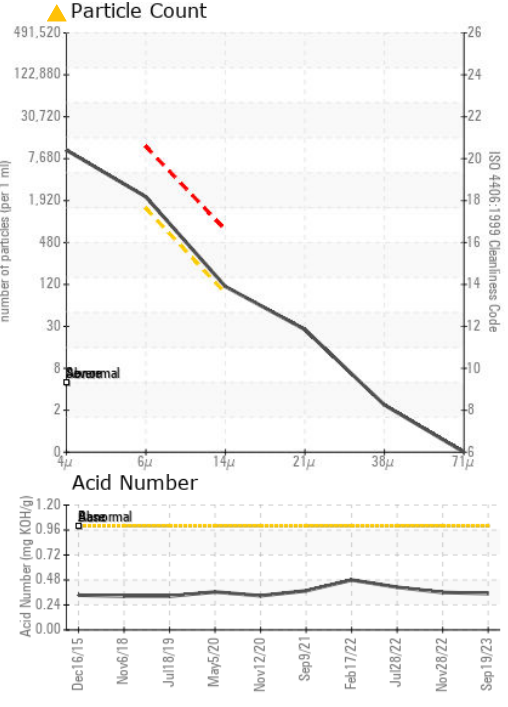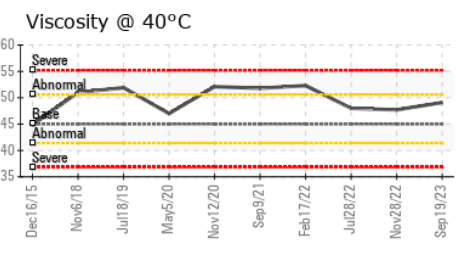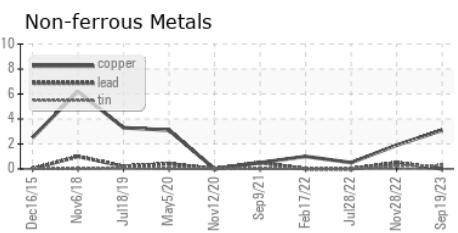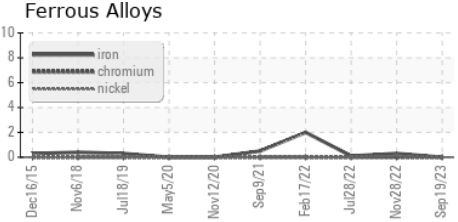

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000954 **Received** : 26 Sep 2023
Lab Number : 05961755 **Diagnosed** : 28 Sep 2023
Unique Number : 10668306 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

H&M USA
 2020 STARITA RD
 CHARLOTTE, NC
 US 28206
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)