PROBLEM SUMMARY

Sample Rating Trend

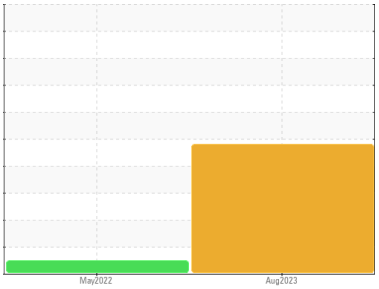

DEGRADATION

Machine Id
KAESER DSG 290-2W 7905777 (S/N 1315)
Component
Compressor
Fluid
G-680 (--- GAL)

COMPONENT CONDITION SUMMARY

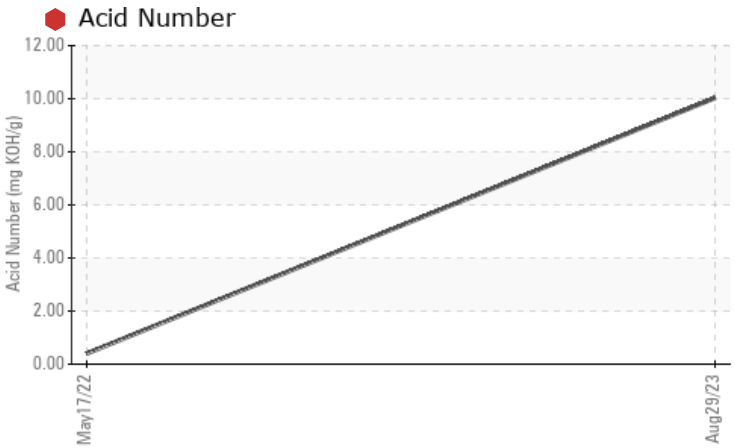

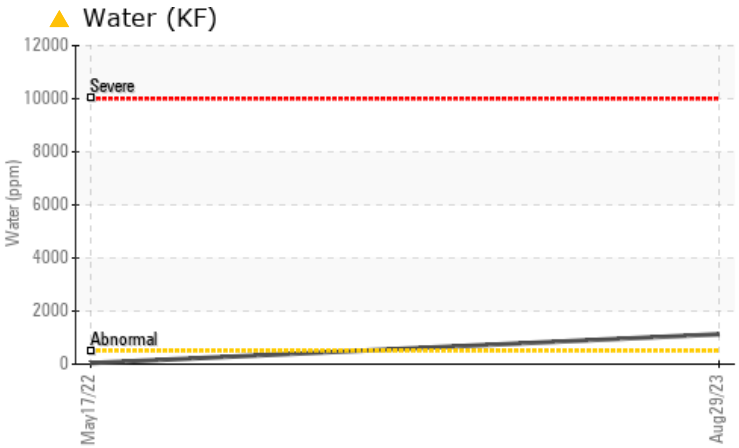

RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				**SEVERE**	NORMAL	---
Water	%	ASTM D6304	>0.05	▲ **0.112**	0.003	---
ppm Water	ppm	ASTM D6304	>500	▲ **1126.0**	39.9	---
Acid Number (AN)	mg KOH/g	ASTM D8045		⬢ **10.03**	0.40	---

Customer Id: HUHDES
Sample No.: KC124525
Lab Number: 05961761
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.

HISTORICAL DIAGNOSIS

17 May 2022 Diag: Angela Borella

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. Viscosity of sample indicates oil is within ISO 46 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

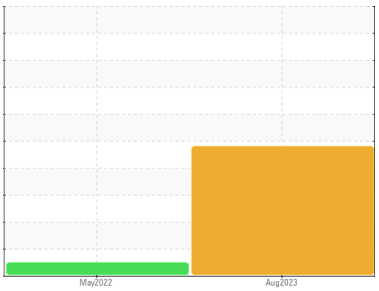

DEGRADATION

Machine Id
KAESER DSG 290-2W 7905777 (S/N 1315)
Component
Compressor
Fluid
G-680 (--- GAL)

DIAGNOSIS

Recommendation
We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample in 500 hours to monitor this condition.

Wear
All component wear rates are normal.

Contamination
There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is above the recommended limit. Confirm oil type.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC124525**	KC96818	---
Sample Date		Client Info		**29 Aug 2023**	17 May 2022	---
Machine Age	hrs	Client Info		**10982**	4904	---
Oil Age	hrs	Client Info		**0**	4904	---
Oil Changed		Client Info		**N/A**	Not Changd	---
Sample Status				**SEVERE**	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	---
Chromium	ppm	ASTM D5185m	>10	**0**	0	---
Nickel	ppm	ASTM D5185m	>3	**0**	0	---
Titanium	ppm	ASTM D5185m	>3	**<1**	0	---
Silver	ppm	ASTM D5185m	>2	**0**	<1	---
Aluminum	ppm	ASTM D5185m	>10	**3**	0	---
Lead	ppm	ASTM D5185m	>10	**2**	0	---
Copper	ppm	ASTM D5185m	>50	**3**	7	---
Tin	ppm	ASTM D5185m	>10	**<1**	0	---
Vanadium	ppm	ASTM D5185m		**<1**	0	---
Cadmium	ppm	ASTM D5185m		**<1**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	---
Barium	ppm	ASTM D5185m		**0**	0	---
Molybdenum	ppm	ASTM D5185m		**0**	0	---
Manganese	ppm	ASTM D5185m		**<1**	0	---
Magnesium	ppm	ASTM D5185m		**4**	<1	---
Calcium	ppm	ASTM D5185m		**2**	0	---
Phosphorus	ppm	ASTM D5185m		**1366**	1	---
Zinc	ppm	ASTM D5185m		**22**	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**<1**	1	---
Sodium	ppm	ASTM D5185m		**2**	0	---
Potassium	ppm	ASTM D5185m	>20	**3**	<1	---
Water	%	ASTM D6304	>0.05	▲ **0.112**	0.003	---
ppm Water	ppm	ASTM D6304	>500	▲ **1126.0**	39.9	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**1504**	301	---
Particles >6µm		ASTM D7647	>1300	**422**	81	---
Particles >14µm		ASTM D7647	>80	**22**	12	---
Particles >21µm		ASTM D7647	>20	**6**	3	---
Particles >38µm		ASTM D7647	>4	**1**	0	---
Particles >71µm		ASTM D7647	>3	**0**	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**18/16/12**	15/14/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		● **10.03**	0.40	---

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

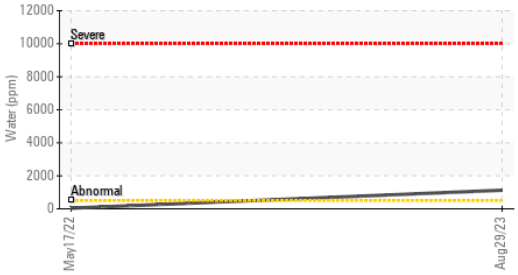

Particle Trend

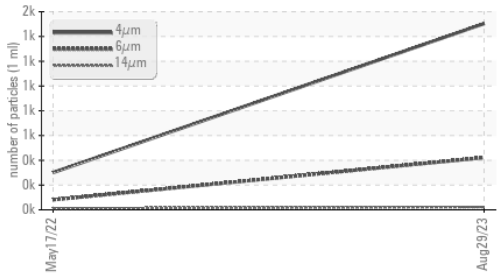

Particle Count

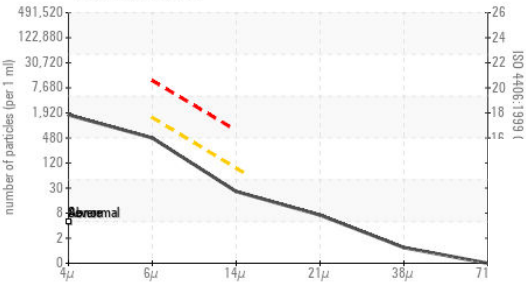

Viscosity @ 40°C

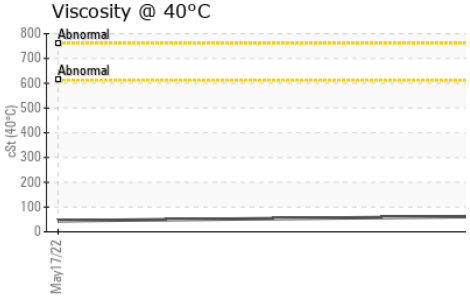

Particle Trend

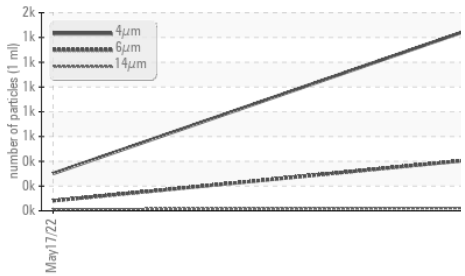

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	**NONE**	NONE	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	**NORML**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**62.2**	44.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

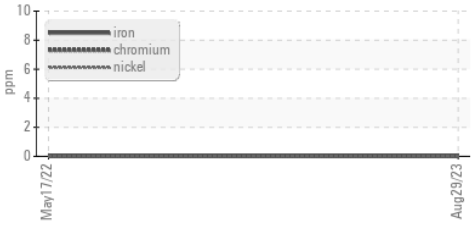

Non-ferrous Metals

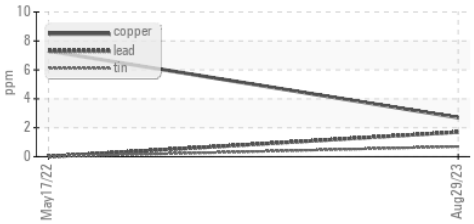

Viscosity @ 40°C

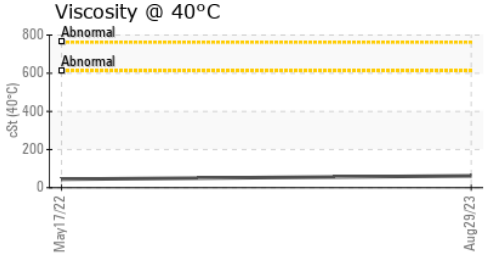

Particle Count

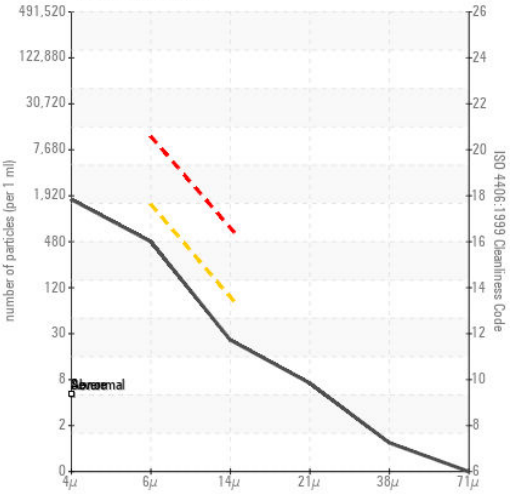

Acid Number

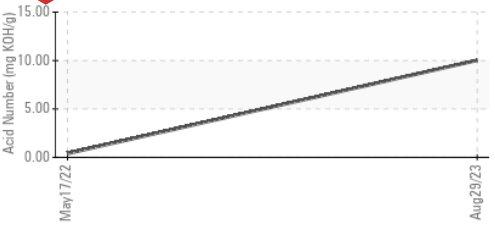

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124525
Lab Number : 05961761
Unique Number : 10668312
Test Package : IND 2

Received : 26 Sep 2023
Diagnosed : 28 Sep 2023
Diagnostician : Doug Bogart

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HUHTAMAKI PACKAGING
9201 PACKAGING DR
DESOTO, KS
US 66018
Contact: TRENTON ST JOHN
trenton.stjohn@huhtamaki.com
T:
F: