




# OIL ANALYSIS REPORT

Sample Rating Trend

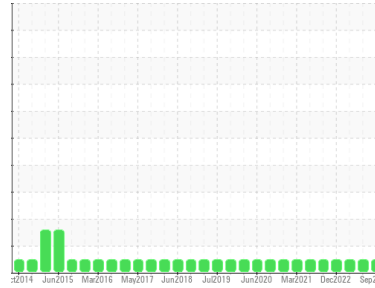

**NORMAL**



Area  
**[W116500]**  
 Machine Id  
**GENERAC RALEIGH BURWELL 400**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (12 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0812706</b>	WC0812715	WC0770481
Sample Date	Client Info		<b>11 Sep 2023</b>	09 Jun 2023	15 Mar 2023
Machine Age	hrs	Client Info	<b>214</b>	212	210
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >250	<b>&lt;1</b>	25	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>25</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >35	<b>3</b>	2	2
Lead	ppm	ASTM D5185m >100	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >60	<b>1</b>	<1	2
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>112</b>	6	86
Barium	ppm	ASTM D5185m 10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 100	<b>57</b>	66	47
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	1
Magnesium	ppm	ASTM D5185m 450	<b>208</b>	1024	318
Calcium	ppm	ASTM D5185m 3000	<b>2006</b>	1255	1850
Phosphorus	ppm	ASTM D5185m 1150	<b>1060</b>	1118	1006
Zinc	ppm	ASTM D5185m 1350	<b>1272</b>	1399	1262
Sulfur	ppm	ASTM D5185m 4250	<b>4218</b>	3962	4261

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>6</b>	3	6
Sodium	ppm	ASTM D5185m >158	<b>1</b>	3	2
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	3

## INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>6.7</b>	6.4	6.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.5</b>	18.3	17.4

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>12.9</b>	14.3	11.9
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.3</b>	7.8	8.7











# OIL ANALYSIS REPORT

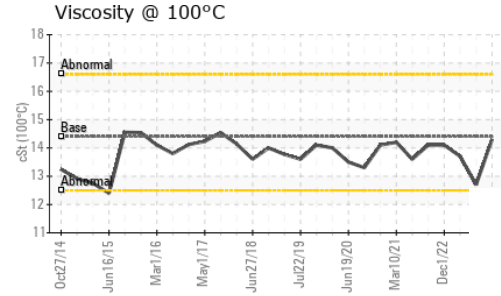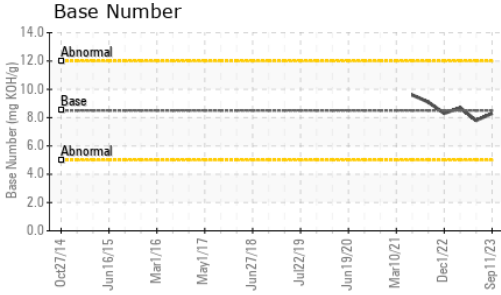

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.3	12.7

## GRAPHS

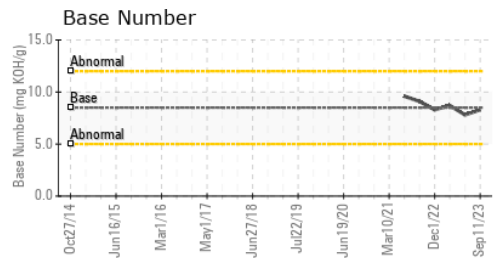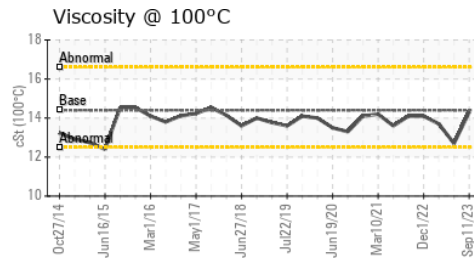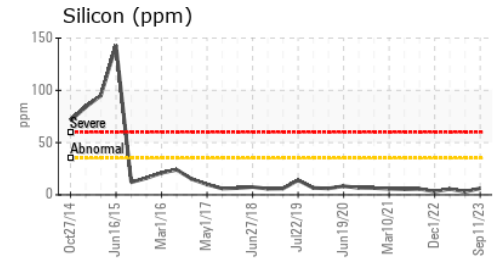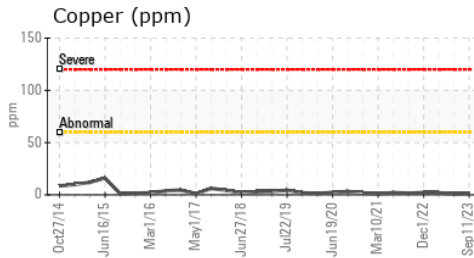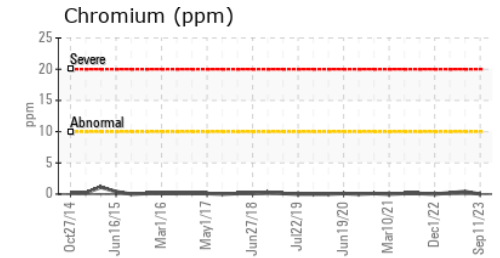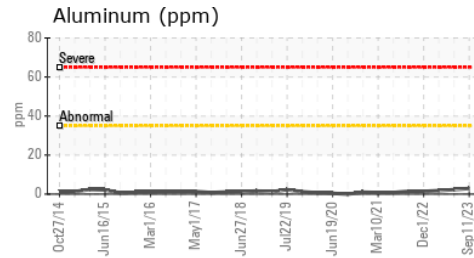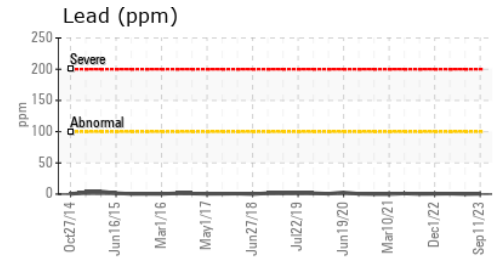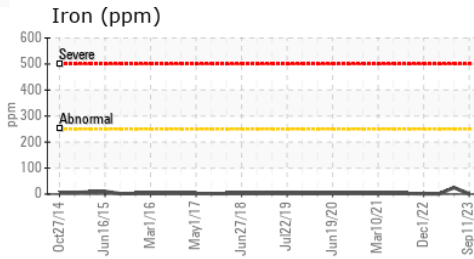

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0812706 Received : 27 Sep 2023  
 Lab Number : 05961960 Diagnosed : 28 Sep 2023  
 Unique Number : 10668511 Diagnostician : Wes Davis  
 Test Package : MOB 1 ( Additional Tests: TBN )

**NATIONAL POWER CORP**  
 4541 PRESLYN DR  
 RALEIGH, NC  
 US 27616  
 Contact: BRANDON RICE  
 brandon.rice@natpow.com  
 T:  
 F: (919)790-9714

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)