




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

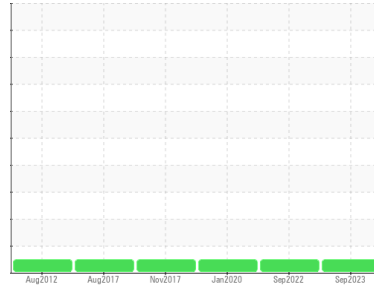

Area
[W116488]
 Machine Id
GENERAC RALEIGH 222 UNIT B
 Component
Diesel Engine
 Fluid
DISEL ENGINE OIL SAE 15W40 (6 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	WC0408814	WC0682965	WC0408797	
Sample Date	Client Info	13 Sep 2023	14 Sep 2022	08 Jan 2020	
Machine Age	hrs	Client Info	512	0	435
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	Not Changd	
Sample Status		NORMAL	NORMAL	NORMAL	

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<1.0	<1.0	<1.0
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	1	2	2
Chromium	ppm ASTM D5185m >20	0	0	<1
Nickel	ppm ASTM D5185m >4	0	0	<1
Titanium	ppm ASTM D5185m	12	<1	1
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >20	3	2	<1
Lead	ppm ASTM D5185m >40	2	1	1
Copper	ppm ASTM D5185m >330	2	4	5
Tin	ppm ASTM D5185m >15	<1	<1	0
Antimony	ppm ASTM D5185m	---	---	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 250	97	83	71
Barium	ppm ASTM D5185m 10	0	1	0
Molybdenum	ppm ASTM D5185m 100	74	55	12
Manganese	ppm ASTM D5185m	0	<1	<1
Magnesium	ppm ASTM D5185m 450	123	314	683
Calcium	ppm ASTM D5185m 3000	2098	1836	1435
Phosphorus	ppm ASTM D5185m 1150	1092	1087	998
Zinc	ppm ASTM D5185m 1350	1282	1208	1098
Sulfur	ppm ASTM D5185m 4250	4233	4609	2976

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	3	4	4
Sodium	ppm ASTM D5185m >158	<1	0	2
Potassium	ppm ASTM D5185m >20	<1	2	9

INFRA-RED



method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	0.1	0.1	0
Nitration	Abs/cm *ASTM D7624 >20	7.2	7.8	5.6
Sulfation	Abs/.1mm *ASTM D7415 >30	17.5	19.4	18.5

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	13.3	14.4	13
Base Number (BN)	mg KOH/g ASTM D2896 8.5	8.1	9.6	---











OIL ANALYSIS REPORT

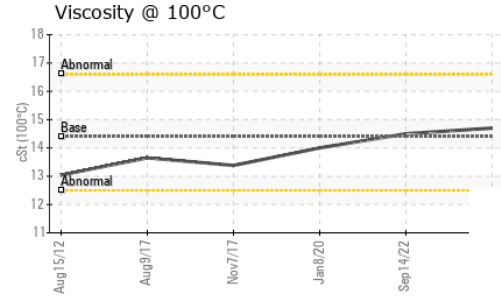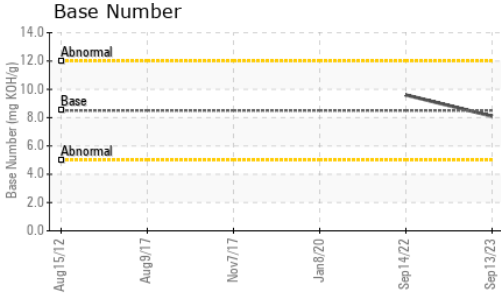

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.7	14.5

GRAPHS

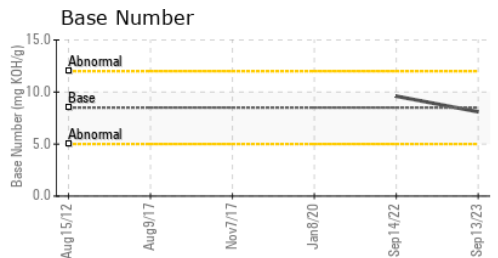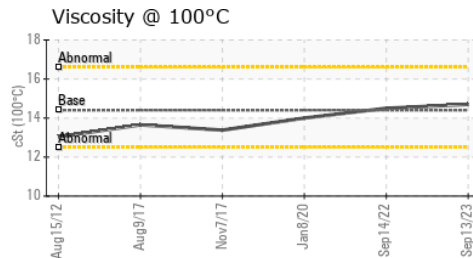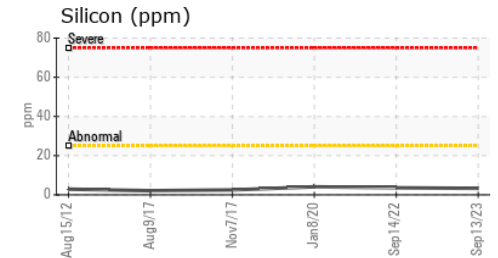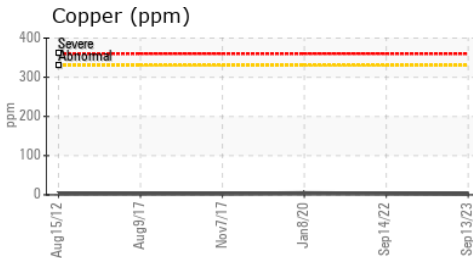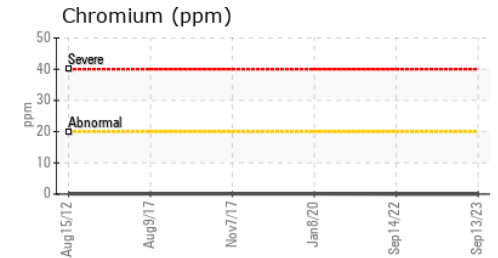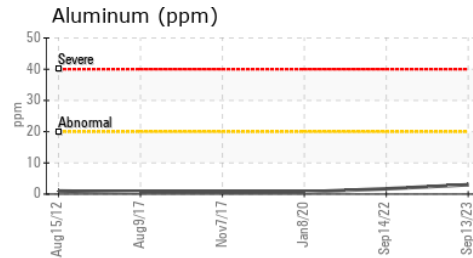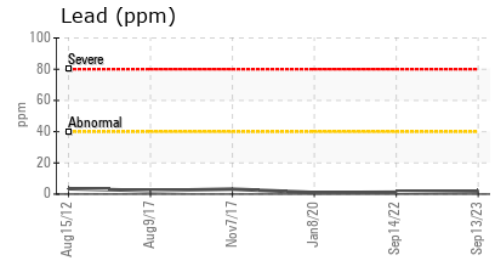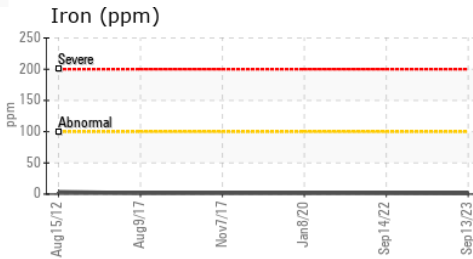

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0408814 Received : 27 Sep 2023
 Lab Number : 05961963 Diagnosed : 28 Sep 2023
 Unique Number : 10668514 Diagnostician : Wes Davis
 Test Package : MOB 1 (Additional Tests: TBN)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616
 Contact: BRANDON RICE
 brandon.rice@natpow.com
 T:
 F: (919)790-9714

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)