

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER ASD 25T 2273365 (S/N 1539)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

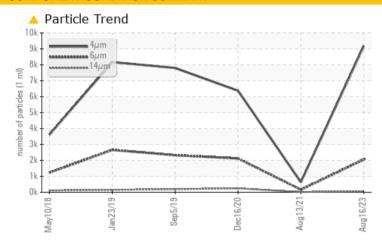

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TI	EST RESULTS				
Sample Status			ATTENTION	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	^ 2055	162	<u>^</u> 2125
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/18/13	15/11	▲ 18/15

Customer Id: REDMEM Sample No.: KCPA006713 Lab Number: 05962230 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

13 Aug 2021 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Dec 2020 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



05 Sep 2019 Diag: Angela Borella

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid.





OIL ANALYSIS REPORT

Sample Rating Trend



ISO

Machine Id

KAESER ASD 25T 2273365 (S/N 1539)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May2018	Jan 2019 Sep 2019	Dec2020 Aug2021	Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006713	KCP41710	KCP273008
Sample Date		Client Info		16 Aug 2023	13 Aug 2021	16 Dec 2020
Machine Age	hrs	Client Info		45201	43680	42188
Oil Age	hrs	Client Info		0	2838	1346
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ATTENTION	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	4	1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	36	14	32
Calcium	ppm	ASTM D5185m	0	3	0	0
Phosphorus	ppm	ASTM D5185m	0	0	3	1
Zinc	ppm	ASTM D5185m	0	11	7	14
Sulfur	ppm	ASTM D5185m	23500	19912	17959	20095
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	2	2
Sodium	ppm	ASTM D5185m		16	4	10
Potassium	ppm	ASTM D5185m	>20	2	<1	2
Water	%	ASTM D6304		0.013	0.018	0.011
ppm Water	ppm	ASTM D6304	>500	137.7	189.0	111.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		9178	635	6378
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2055	162	<u>△</u> 2125
Particles >14μm		ASTM D7647	>80	61	16	<u> </u>
Particles >21µm		ASTM D7647	>20	8	3	△ 79
Particles >38µm		ASTM D7647	>4	0	0	1 1
Particles >71µm		ASTM D7647	>3	0	0	<u>4</u>
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/13	15/11	<u> </u>
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT





Certificate L2367

Lab Number **Unique Number**

: 05962230 : 10668781

Diagnosed Diagnostician : Don Baldridge

: 28 Sep 2023 Test Package : IND 2 (Additional Tests: KF, PrtCount)

US 38118 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: