


# **OIL ANALYSIS REPORT**

# M-460 [6521] KAESER 1307 - MARK-IT EXPRESS

Compressor



### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Sep 2023		
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05962314		
Sample Date		Client Info		13 Sep 2023		
Machine Age	hrs	Client Info		7259		
Oil Age	hrs	Client Info		5273		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	11		
Tin		ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	>10	0		
	ppm			-		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base		history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	4		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	36		
Sulfur	ppm	ASTM D5185m	23500	13866		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		4		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.46		
VISUAL	_	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
1·27·49) Ray: 1			Cont		CHAEL EERRI	C LICDEL DOV



## **OIL ANALYSIS REPORT**

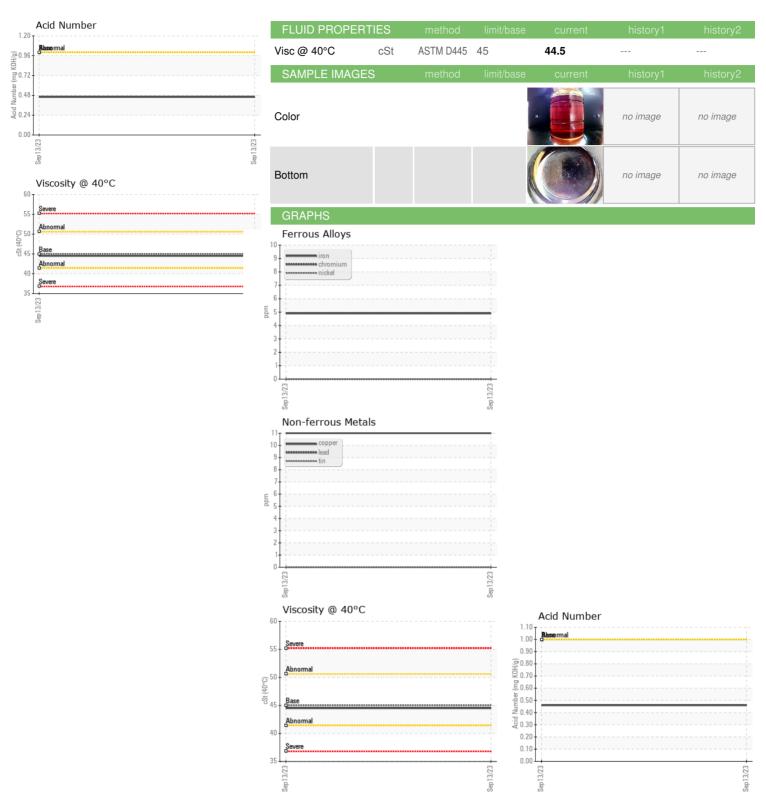





Certificate L2367

Laboratory Sample No. Lab Number

Unique Number : 10668865

: UCH05962314 : 05962314 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 27 Sep 2023 Diagnosed : 28 Sep 2023

Diagnostician : Don Baldridge

**DELTA INDUSTRIES - DOWNERS GROVE** 

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931 Contact/Location: MICHAEL FERRIS - UCDELDOW