


OIL ANALYSIS REPORT

S-460 [6431] Machine Id KAESER 1595 - SPORTS AWARDS

Component

Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Moor

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2021	Sep 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05962320	UCH05342705	
Sample Date		Client Info		08 Sep 2023	25 Aug 2021	
Machine Age	hrs	Client Info		44714	35896	
Oil Age	hrs	Client Info		4023	4885	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead		ASTM D5185m	>10	0	0	
	ppm			5	11	
Copper	ppm	ASTM D5185m	>50	_	0	
Tin	ppm	ASTM D5185m	>10	0		
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	<1	2	
Calcium	ppm	ASTM D5185m	2	2	0	
Phosphorus	ppm	ASTM D5185m		0	3	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		16577	14342	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	5	
Sodium	ppm	ASTM D5185m		3	0	
Potassium	ppm	ASTM D5185m	>20	0	0	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38	0.316	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	LIGHT	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	CHANTEGERRIS	
1 100 Wale	Scalai	visual		INLG	O. I/NALO LI II IIO	JODELDOVV



OIL ANALYSIS REPORT

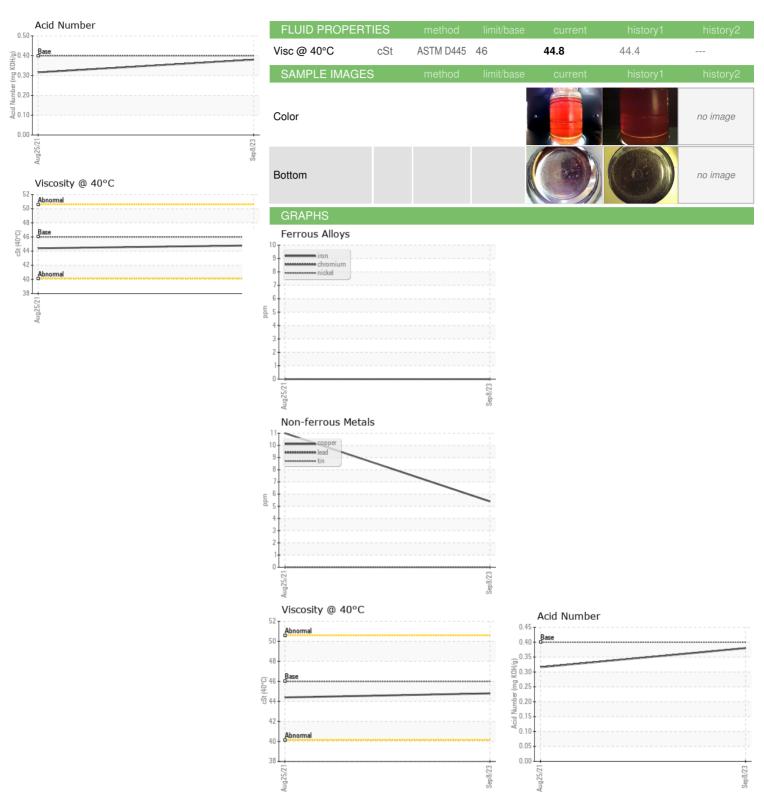





Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10668871

: UCH05962320 : 05962320 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 27 Sep 2023

: 28 Sep 2023 Diagnosed Diagnostician : Don Baldridge

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL

US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931