




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

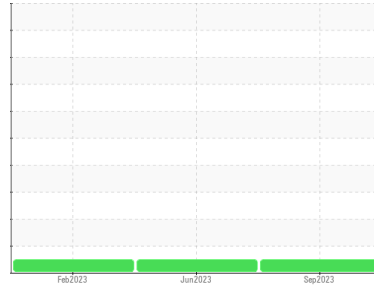

Machine Id  
**2513011**

Component  
**Refrigeration Compressor**

Fluid  
**FRICK COMPRESSOR OIL #3 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0001851</b>	USP244542	USP250576
Sample Date	Client Info	<b>26 Sep 2023</b>	13 Jun 2023	28 Feb 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >8	<b>&lt;1</b>	<1	0
Chromium	ppm ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm ASTM D5185m	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm ASTM D5185m	<b>0</b>	0	0
Calcium	ppm ASTM D5185m	<b>1</b>	1	<1
Phosphorus	ppm ASTM D5185m	<b>0</b>	0	0
Zinc	ppm ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m	<b>24</b>	23	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>&lt;1</b>	0	<1
Sodium	ppm ASTM D5185m	<b>0</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>0</b>	1	0
Water	% ASTM D6304 >0.01	<b>0.004</b>	0.002	0.003
ppm Water	ppm ASTM D6304 >100	<b>41.7</b>	22.3	33.1

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>1491</b>	4554	1166
Particles >6µm	ASTM D7647 >2500	<b>431</b>	1713	240
Particles >14µm	ASTM D7647 >320	<b>26</b>	75	14
Particles >21µm	ASTM D7647 >80	<b>6</b>	8	4
Particles >38µm	ASTM D7647 >20	<b>1</b>	1	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>18/16/12</b>	19/18/13	17/15/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974	<b>0.014</b>	0.014	0.014




# OIL ANALYSIS REPORT

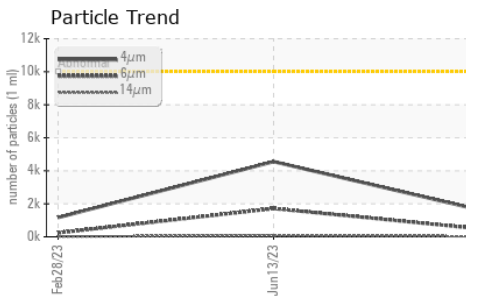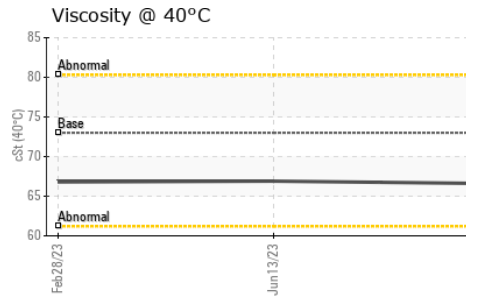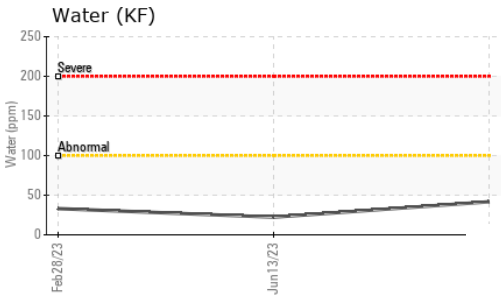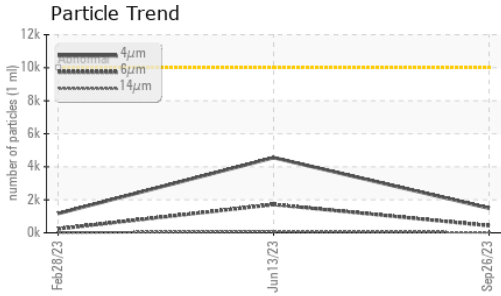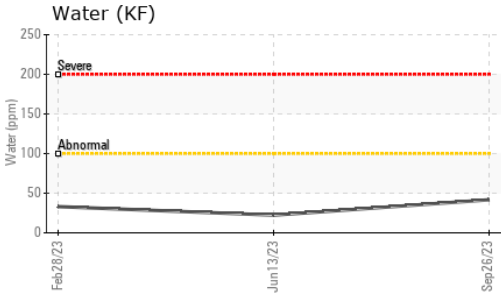






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	66.6	66.9	66.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

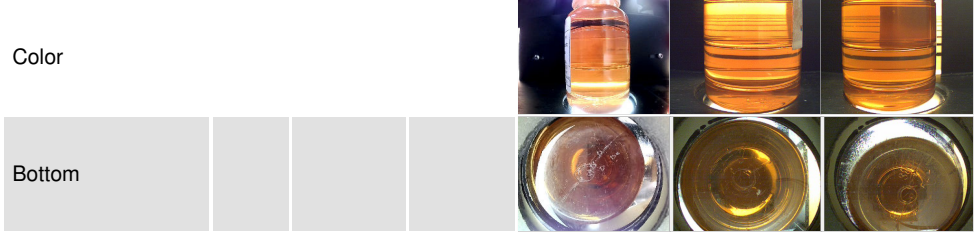

## GRAPHS

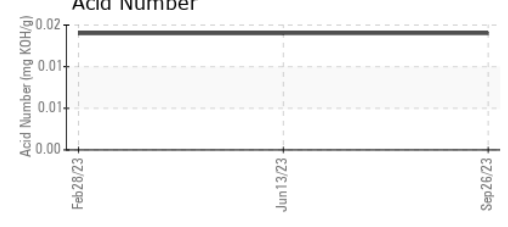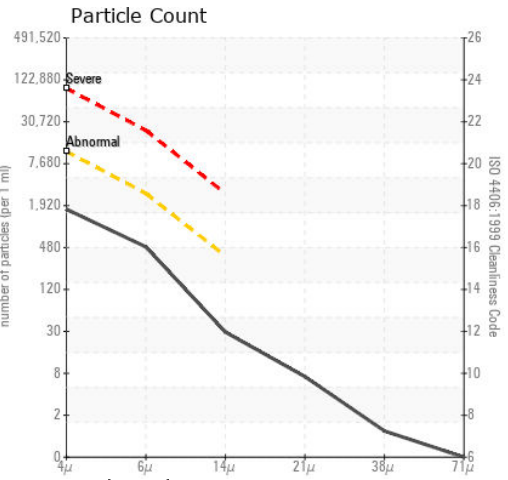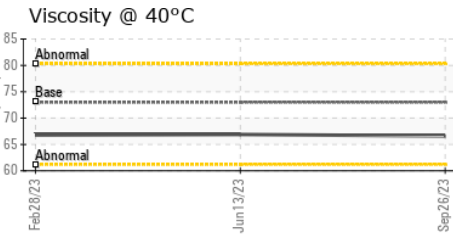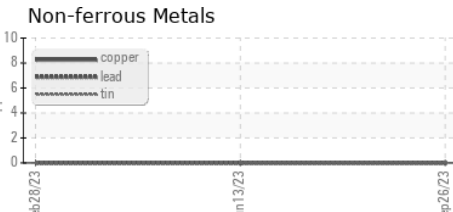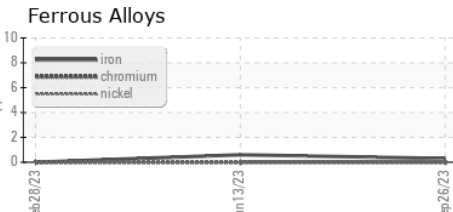

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0001851 **Received** : 27 Sep 2023  
**Lab Number** : 05962934 **Diagnosed** : 28 Sep 2023  
**Unique Number** : 10669485 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**AMEICA'S CATCH INC**  
 46623 COUNTY RD 523  
 ITTA BENA, MS  
 US 38941  
 Contact: SHANE CARPENTER

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (870)692-7712  
 F: