

# **PROBLEM SUMMARY**

## Sample Rating Trend




<sup>Machine Id</sup> **5 (S/N 1613628)** 

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

## COMPONENT CONDITION SUMMARY

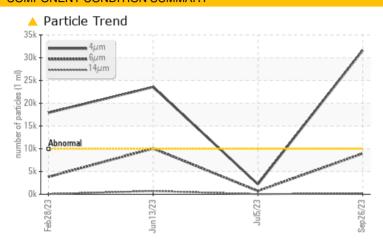

### RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	NORMAL	ABNORMAL				
Particles >4µm	ASTM D7647 >	>10000	<u> </u>	2206	<u>23549</u>				
Particles >6µm	ASTM D7647 >	>2500	<b>8952</b>	720	<u> </u>				
Oil Cleanliness	ISO 4406 (c) >	>20/18/15	<b>22/20/15</b>	18/17/12	<u>^</u> 22/21/17				

Customer Id: AMEITT Sample No.: USP0001853 Lab Number: 05962935 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 05 Jul 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 13 Jun 2023 Diag: Doug Bogart

150



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 28 Feb 2023 Diag: Doug Bogart

ISO




Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend





Machine Id **5 (S/N 1613628)** 

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)

# **DIAGNOSIS**

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 202	3 Jun2023	Jul2023 Se	p2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0001853	USP242384	USP244544
Sample Date		Client Info		26 Sep 2023	05 Jul 2023	13 Jun 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	1
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	18	<1
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	1
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	1	1
Water	%	ASTM D6304	>0.01	0.004	0.002	0.001
ppm Water	ppm	ASTM D6304	>100	45.8	20.4	9.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>A</b> 31617	2206	<u>23549</u>
Particles >6µm		ASTM D7647	>2500	<u></u> 8952	720	<u> </u>
Particles >14µm		ASTM D7647	>320	189	34	<u></u> 712
Particles >21µm		ASTM D7647	>80	21	6	75
Particles >38µm		ASTM D7647	>20	0	1	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>22/20/15</u>	18/17/12	<u>22/21/17</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.015



# OIL ANALYSIS REPORT

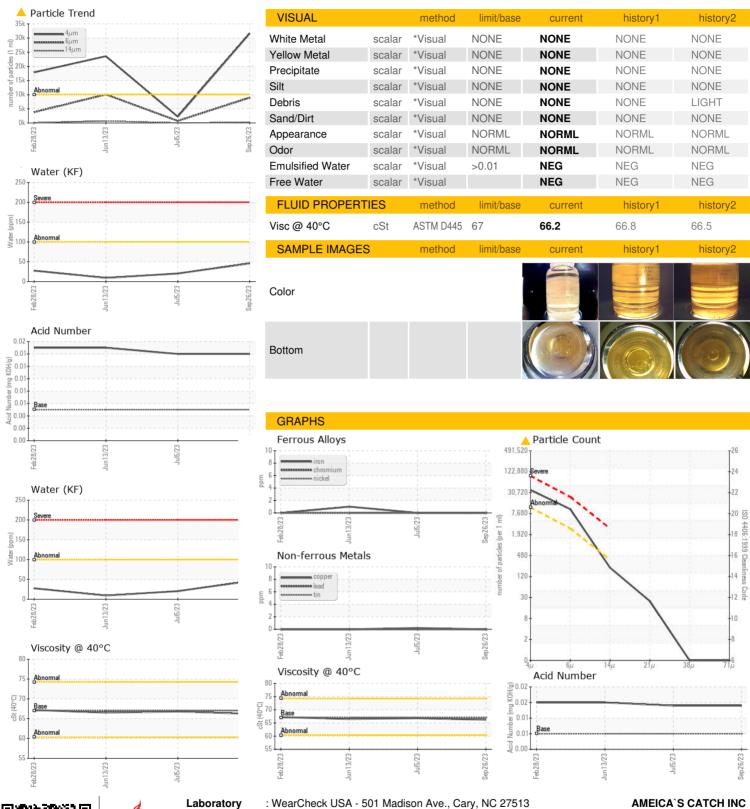





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: USP0001853 : 05962935

: 10669486 Test Package : IND 2

: 27 Sep 2023 Received Diagnosed : 28 Sep 2023

Diagnostician : Doug Bogart

**AMEICA'S CATCH INC** 46623 COUNTY RD 523

ITTA BENA, MS US 38941

Contact: SHANE CARPENTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (870)692-7712 F: