




PROBLEM SUMMARY

Sample Rating Trend

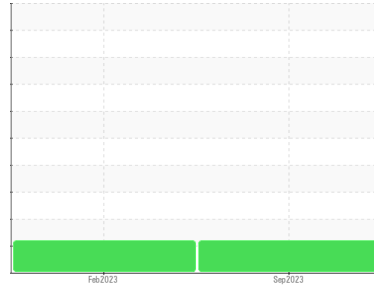


ISO



Machine Id
8 (S/N TDSH163L22733B)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #3 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

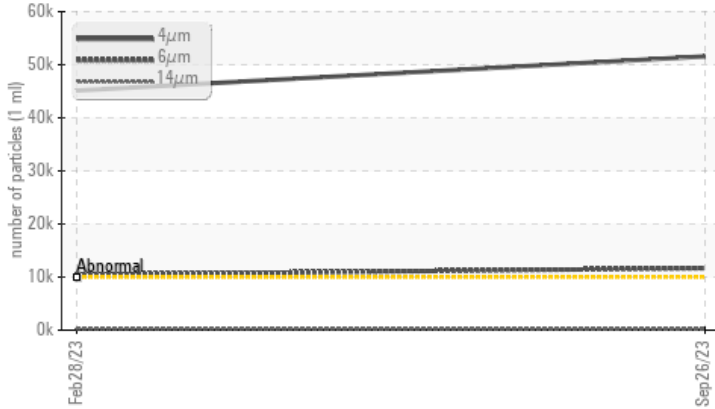

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >4µm	ASTM D7647	>10000	▲ 51572	▲ 45141	---
Particles >6µm	ASTM D7647	>2500	▲ 11663	▲ 10445	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/15	▲ 23/21/15	---

Customer Id: AMEITT
 Sample No.: USP0001854
 Lab Number: 05962936
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 Feb 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

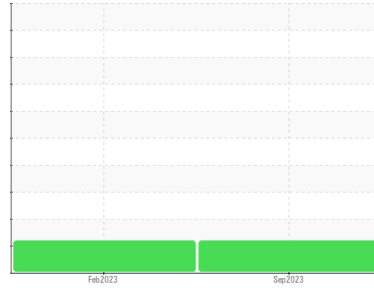

ISO



Machine Id
8 (S/N TDSH163L22733B)

Component
Refrigeration Compressor

Fluid
FRICK COMPRESSOR OIL #3 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP0001854	USP250581	---
Sample Date	Client Info	26 Sep 2023	28 Feb 2023	---
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ABNORMAL	ABNORMAL	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	0
Chromium	ppm	ASTM D5185m >2	0	0
Nickel	ppm	ASTM D5185m	0	0
Titanium	ppm	ASTM D5185m	<1	0
Silver	ppm	ASTM D5185m >2	0	0
Aluminum	ppm	ASTM D5185m >3	0	0
Lead	ppm	ASTM D5185m >2	0	0
Copper	ppm	ASTM D5185m >8	1	0
Tin	ppm	ASTM D5185m >4	0	0
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0
Barium	ppm	ASTM D5185m	0	0
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	<1	<1
Magnesium	ppm	ASTM D5185m	0	0
Calcium	ppm	ASTM D5185m	0	0
Phosphorus	ppm	ASTM D5185m	0	0
Zinc	ppm	ASTM D5185m	0	0
Sulfur	ppm	ASTM D5185m	0	0

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	<1
Sodium	ppm	ASTM D5185m	<1	0
Potassium	ppm	ASTM D5185m >20	0	0
Water	%	ASTM D6304 >0.01	0.003	0.003
ppm Water	ppm	ASTM D6304 >100	29.0	27.3

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 51572	▲ 45141	---
Particles >6µm	ASTM D7647 >2500	▲ 11663	▲ 10445	---
Particles >14µm	ASTM D7647 >320	186	284	---
Particles >21µm	ASTM D7647 >80	26	37	---
Particles >38µm	ASTM D7647 >20	2	0	---
Particles >71µm	ASTM D7647 >4	0	0	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 23/21/15	▲ 23/21/15	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.014	0.014




OIL ANALYSIS REPORT

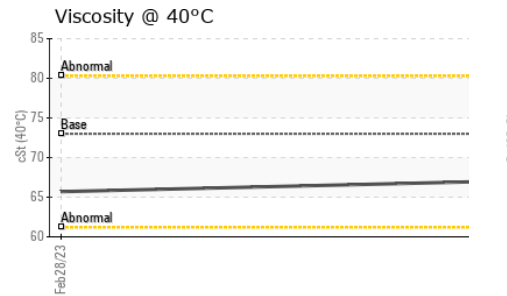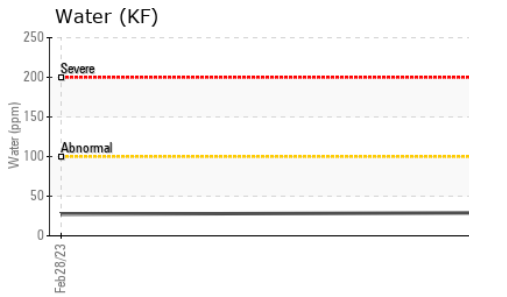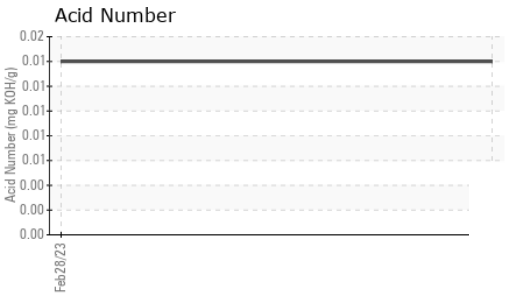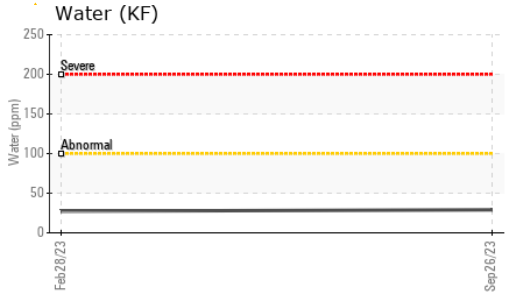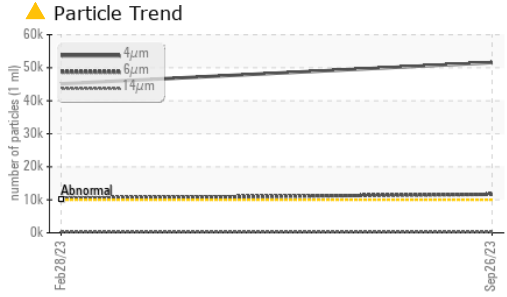





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	67.0	65.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

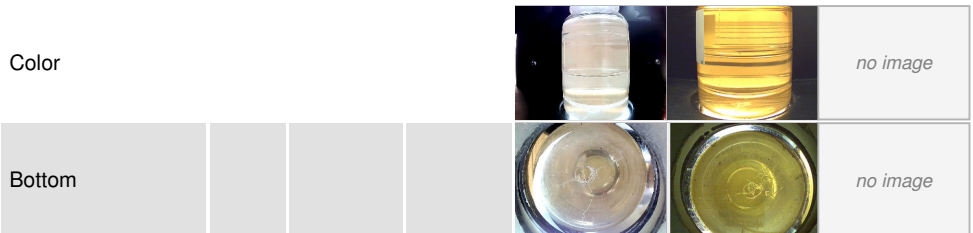

GRAPHS

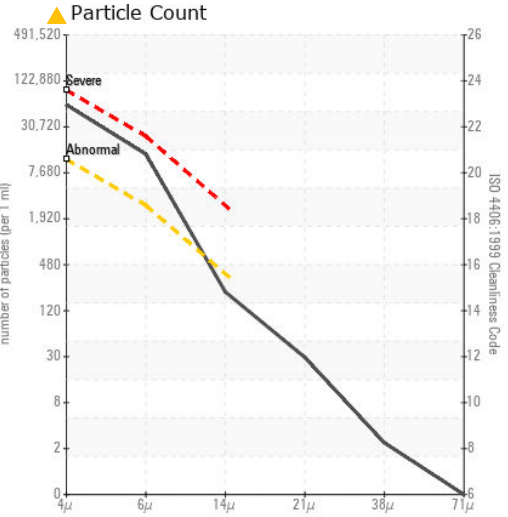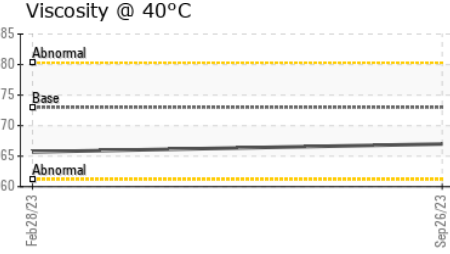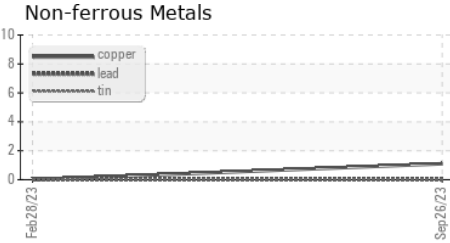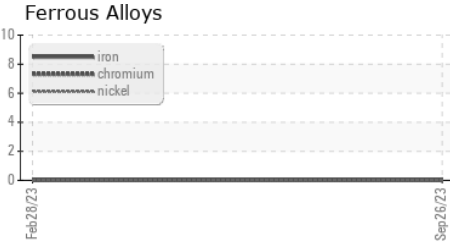

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0001854 **Received** : 27 Sep 2023
Lab Number : 05962936 **Diagnosed** : 28 Sep 2023
Unique Number : 10669487 **Diagnostician** : Doug Bogart
Test Package : IND 2

AMEICA'S CATCH INC
 46623 COUNTY RD 523
 ITTA BENA, MS
 US 38941
 Contact: SHANE CARPENTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (870)692-7712
F: