




OIL ANALYSIS REPORT

Sample Rating Trend

GLYCOL



Machine Id
JENBACHER GM01 (S/N 1144754)
 Component
Biogas Engine
 Fluid
MAHLER Q8 Mahler G8 SAE 40 (--- GAL)

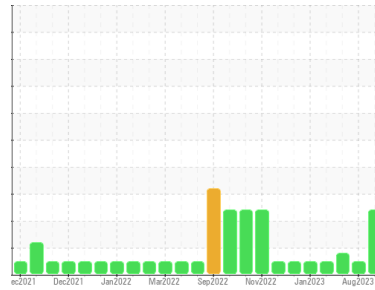

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Sodium and/or potassium levels are high. Test for glycol is negative.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0852893 | WC0835634 | WC0772444 |
| Sample Date | Client Info | | 11 Sep 2023 | 02 Aug 2023 | 19 Apr 2023 |
| Machine Age | hrs | Client Info | 40832 | 40437 | 38522 |
| Oil Age | hrs | Client Info | 907 | 512 | 2293 |
| Oil Changed | Client Info | | Not Chngd | Not Chngd | Not Chngd |
| Sample Status | | | ABNORMAL | NORMAL | ABNORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|----------|--------|-------------|---------|--------------|----------|------|
| Iron | ppm | ASTM D5185m | >20 | 17 | 6 | ▲ 23 |
| Chromium | ppm | ASTM D5185m | >5 | <1 | <1 | 1 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | >5 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >15 | 2 | 4 | 10 |
| Lead | ppm | ASTM D5185m | >20 | 1 | 0 | 2 |
| Copper | ppm | ASTM D5185m | >15 | 7 | 3 | 11 |
| Tin | ppm | ASTM D5185m | >5 | 7 | 3 | 6 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|-------------|---------|--------------|----------|------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 2 | 1 | 1 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | | 7 | 11 | 10 |
| Calcium | ppm | ASTM D5185m | | 2310 | 2324 | 2499 |
| Phosphorus | ppm | ASTM D5185m | | 444 | 413 | 454 |
| Zinc | ppm | ASTM D5185m | | 505 | 465 | 568 |
| Sulfur | ppm | ASTM D5185m | | 2605 | 2617 | 2516 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|-------------|---------|-------------|----------|-----|
| Silicon | ppm | ASTM D5185m | >200 | 61 | 51 | 155 |
| Sodium | ppm | ASTM D5185m | >20 | ▲ 88 | 0 | 2 |
| Potassium | ppm | ASTM D5185m | >20 | ▲ 32 | 0 | 2 |

INFRA-RED

| | method | limit/base | current | history1 | history2 | |
|-----------|----------|-------------|---------|-------------|----------|------|
| Soot % | % | *ASTM D7844 | >2 | 0 | 0.1 | 0 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 8.7 | 7.3 | 9.0 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 17.6 | 16.6 | 20.5 |


FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 | |
|------------------|----------|-------------|---------|-------------|----------|-------|
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 12.9 | 12.0 | 16.7 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.83 | 0.844 | 1.751 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 8.0 | 6.60 | 6.78 | 5.90 |



OIL ANALYSIS REPORT

Glycol Contamination

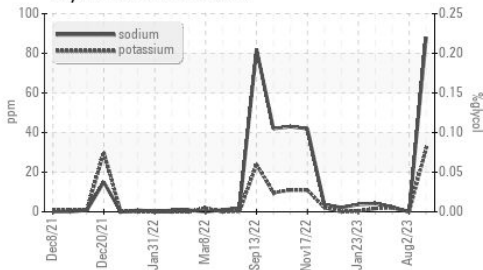

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |


Acid Number




| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C | cSt | ASTM D445 | 13.2 | 13.8 | 13.5 |

GRAPHS


Base Number

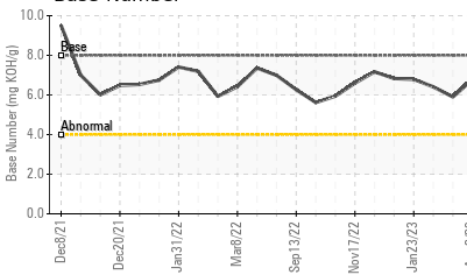


Iron (ppm)

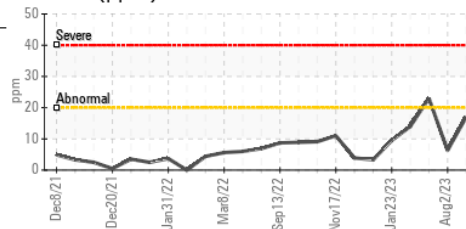


Lead (ppm)

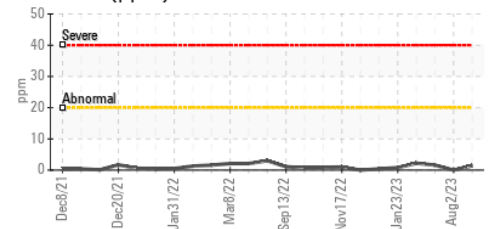


Aluminum (ppm)

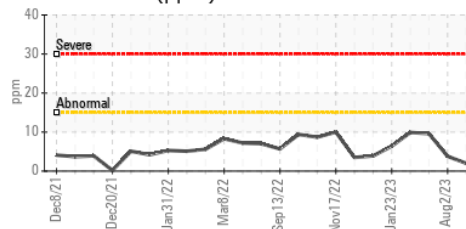


Chromium (ppm)

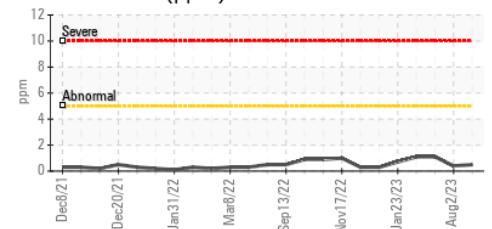


Viscosity @ 100°C

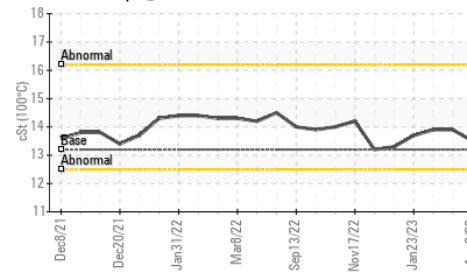


Copper (ppm)

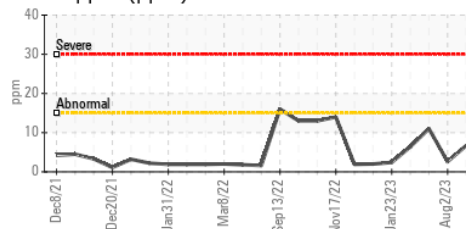


Silicon (ppm)

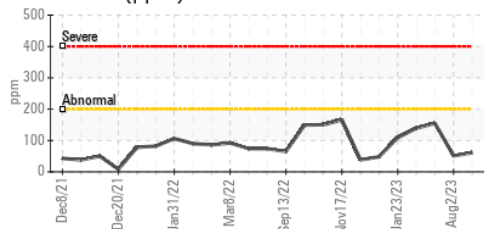

Viscosity @ 100°C

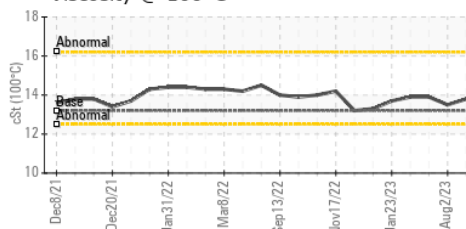

Base Number

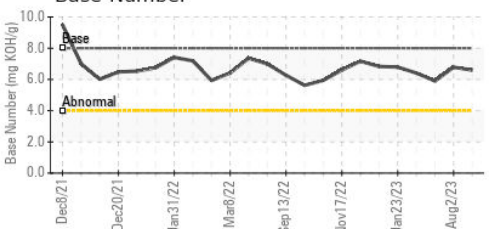

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0852893
 Lab Number : 05963011
 Unique Number : 10669562
 Test Package : MOB 2
 Received : 27 Sep 2023
 Diagnosed : 29 Sep 2023
 Diagnostician : Jonathan Hester

RICHLAND CREEK
 5691 S RICHLAND CREEK RD
 BUFORD, GA
 US 30518
 Contact: ZACK GRAVES
 zack.graves@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: