



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
AF12-250-M82384 COOLING WHEEL 3 TURNING MOTOR 2

Component
Gear Drive

Fluid
MOBIL MOBILGEAR SHC 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0848200	---	---
Sample Date	Client Info			12 Sep 2023	---	---
Machine Age	mths	Client Info		60	---	---
Oil Age	mths	Client Info		12	---	---
Oil Changed	Client Info			Changed	---	---
Sample Status				NORMAL	---	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		12	---	---
Iron	ppm	ASTM D5185m	>150	4	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>10	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>100	0	---	---
Copper	ppm	ASTM D5185m	>50	<1	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		6	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		24	---	---
Phosphorus	ppm	ASTM D5185m		468	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		3659	---	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	14	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	0.002	---	---
ppm Water	ppm	ASTM D6304	>1000	24.1	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	9746	---	---
Particles >6µm		ASTM D7647	>5000	1259	---	---
Particles >14µm		ASTM D7647	>640	42	---	---
Particles >21µm		ASTM D7647	>160	9	---	---
Particles >38µm		ASTM D7647	>40	1	---	---
Particles >71µm		ASTM D7647	>10	1	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	20/17/13	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.89	---	---



OIL ANALYSIS REPORT

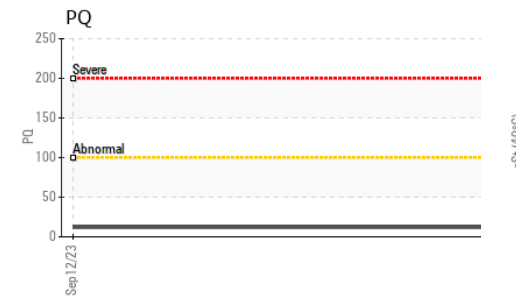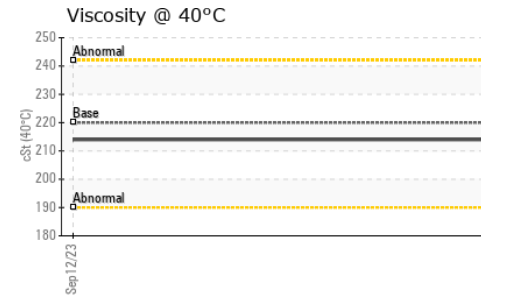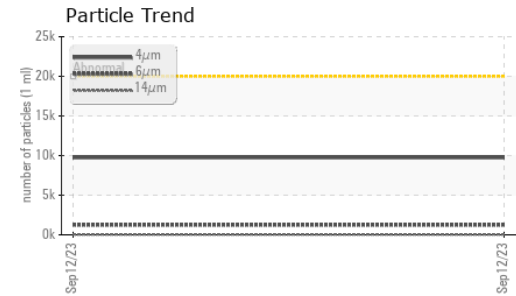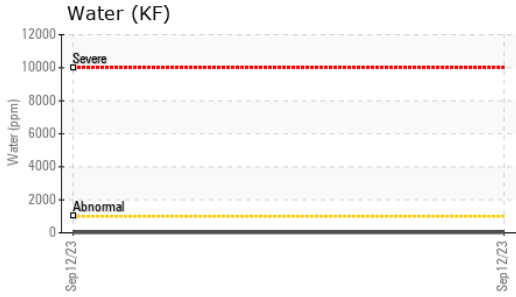






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	214	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

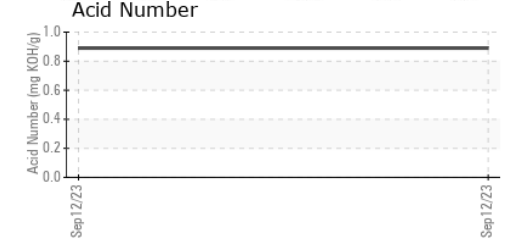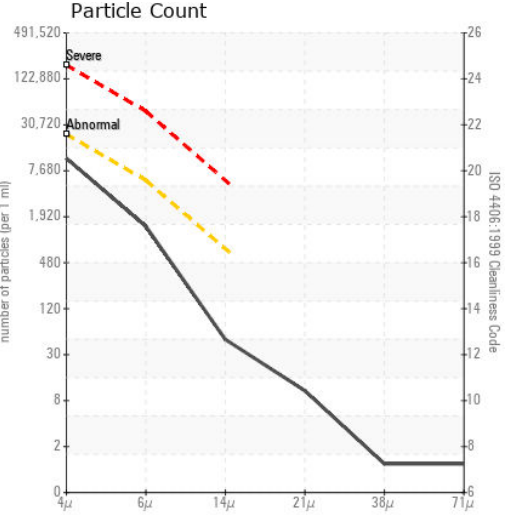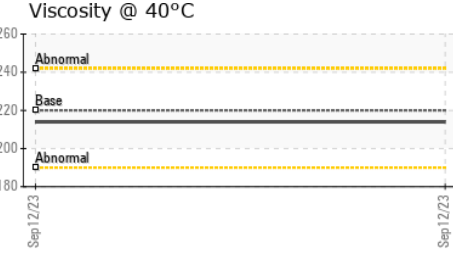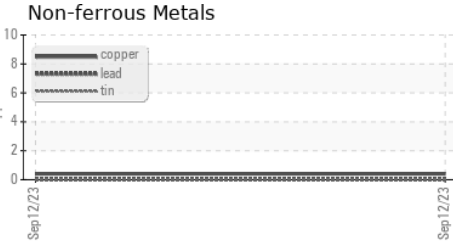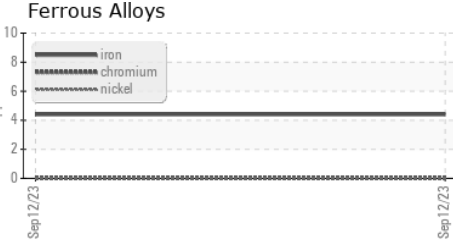

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0848200 **Received** : 28 Sep 2023
Lab Number : 05963542 **Diagnosed** : 04 Oct 2023
Unique Number : 10670093 **Diagnostician** : Wes Davis
Test Package : PLANT

ARAUCO - GRAYLING
 5851 ARAUCO ROAD
 GRAYLING, MI
 US 49738
 Contact: JOSEPH GREEN
 joseph.green@arauco.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)