

## **PROBLEM SUMMARY**

Sample Rating Trend

ISO


# AF12-140-2325-2100 DRYER 2 MAIN DRIVE GEAR BOX

Component

**Gear Drive** 

MOBIL MOBILGEAR SHC 320 (--- GAL)

## **COMPONENT CONDITION SUMMARY**

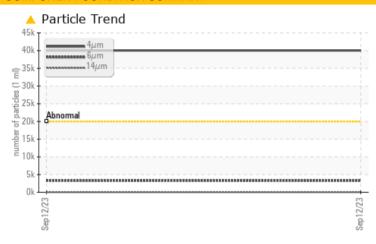

## RECOMMENDATION

The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TE	EST RESULTS				
Sample Status			ABNORMAL	 	
Particles >4µm	ASTM D7647	>20000	<b>40036</b>	 	
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>23/19/12</b>	 	

**Customer Id: ARAGRAUS Sample No.:** WC0824136 Lab Number: 05963547 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Wes Davis +1 905-569-8600 x223 wesd@wearcheck.ca

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Resample			?	We recommend an early resample to monitor this condition.		
Information Required			?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.		

# HISTORICAL DIAGNOSIS



## **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO

Machine Id

# **AF12-140-2325-2100 DRYER 2 MAIN DRIVE GEAR BOX**

Component

**Gear Drive** 

**MOBIL MOBILGEAR SHC 320 (--- GAL)** 

## DIAGNOSIS

#### Recommendation

The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

## **Fluid Condition**


The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

				Sep 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0824136		
Sample Date		Client Info		12 Sep 2023		
Machine Age	mths	Client Info		60		
Oil Age	mths	Client Info		12		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		16		
Iron	ppm	ASTM D5185m	>150	3		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m	7.0	<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m		0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	Je Je	method	limit/base	-	historyd	history ()
			IIIIII/Dase		history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		472		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		2323		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		29		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.1	0.001		
ppm Water	ppm	ASTM D6304	>1000	4.9		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>40036</b>		
Particles >6µm		ASTM D7647	>5000	3266		
Particles >14µm		ASTM D7647	>640	26		
Particles >21µm		ASTM D7647	>160	6		
Particles >38µm		ASTM D7647	>40	1		
Particles >71µm		ASTM D7647	>10	1		
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<u>^</u> 23/19/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

0.82



## **OIL ANALYSIS REPORT**

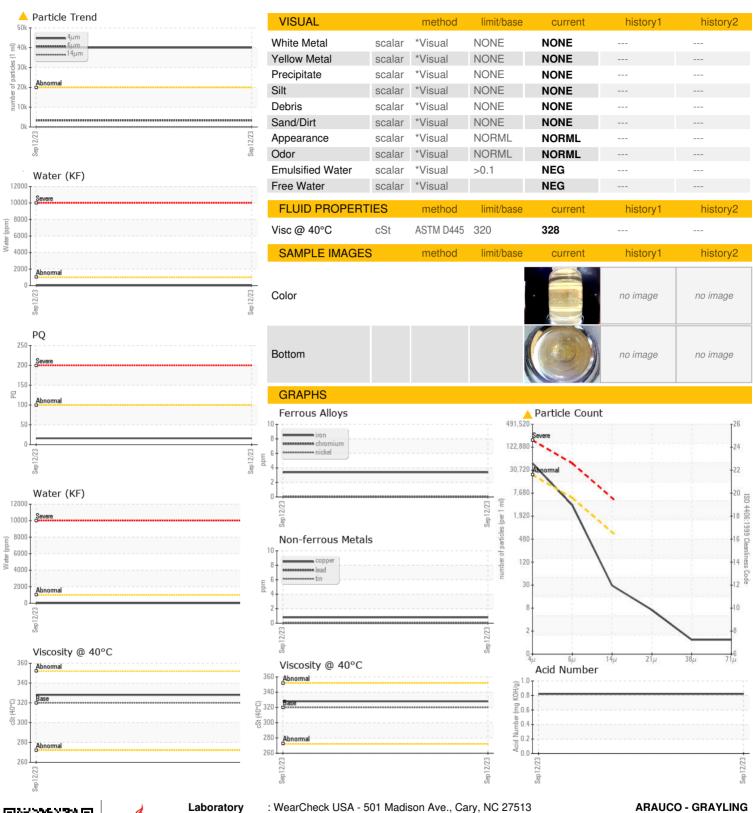



Certificate L2367

Report Id: ARAGRAUS [WUSCAR] 05963547 (Generated: 10/04/2023 23:34:13) Rev: 1

Laboratory Sample No. Lab Number **Unique Number** 

Test Package

: WC0824136 : 05963547 : 10670098

: 28 Sep 2023 Received : 29 Sep 2023 Diagnosed : Wes Davis Diagnostician

GRAYLING, MI US 49738 Contact: JOSEPH GREEN joseph.green@arauco.com

5851 ARAUCO ROAD

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: PLANT

T: F: