




# PROBLEM SUMMARY

Sample Rating Trend

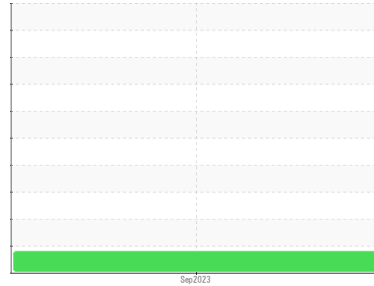


ISO



Machine Id  
**Af12-140-M31107 Wet Flake Silo disch to dryer 1 south**  
 Component  
**Gear Drive**  
 Fluid  
**MOBIL MOBILGEAR SHC 150 (75 LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

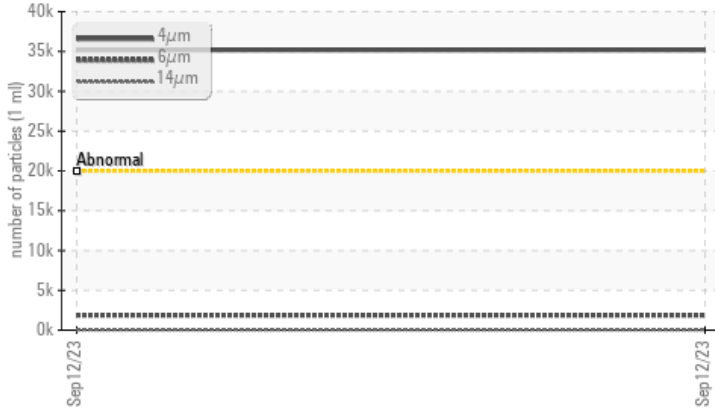

## RECOMMENDATION

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ATTENTION	---	---
Particles >4µm	ASTM D7647 >20000 ▲ <b>35179</b>	---	---
Oil Cleanliness	ISO 4406 (c) >21/19/16 ▲ <b>22/18/13</b>	---	---

Customer Id: ARAGRAUS  
 Sample No.: WC0824137  
 Lab Number: 05963562  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

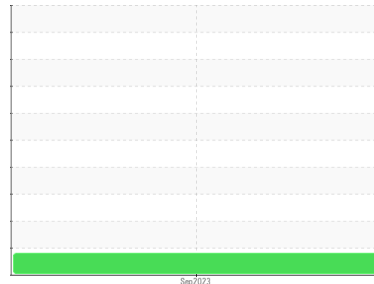

ISO



Machine Id  
**Af12-140-M31107 Wet Flake Silo disch to dryer 1 south**  
 Component  
**Gear Drive**  
 Fluid  
**MOBIL MOBILGEAR SHC 150 (75 LTR)**

## DIAGNOSIS

### Recommendation

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0824137</b>	---	---
Sample Date	Client Info		<b>12 Sep 2023</b>	---	---
Machine Age	mths	Client Info	<b>60</b>	---	---
Oil Age	mths	Client Info	<b>12</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

WEAR METALS	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>20</b>	---	---
Iron	ppm	ASTM D5185m >150	<b>7</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >10	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>111</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>456</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>1385</b>	---	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>25</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.1	<b>0.014</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>148.1</b>	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 35179</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>1868</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>51</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>10</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>1</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 22/18/13</b>	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.54</b>	---	---




# OIL ANALYSIS REPORT


## Particle Trend




## Water (KF)

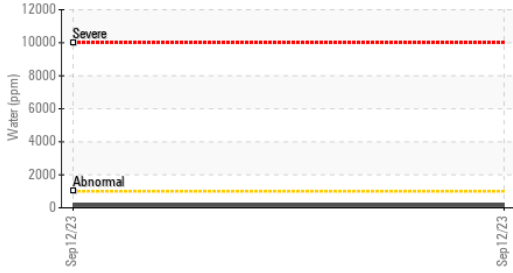


## PQ

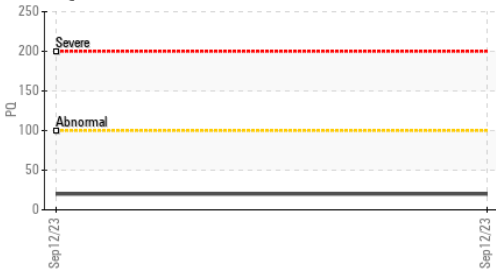

## Water (KF)

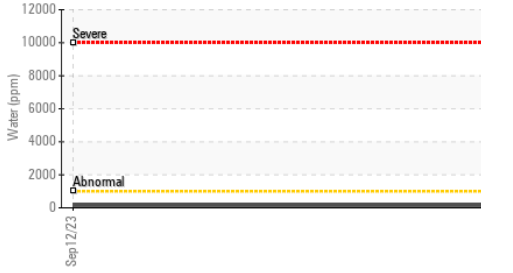

## Viscosity @ 40°C

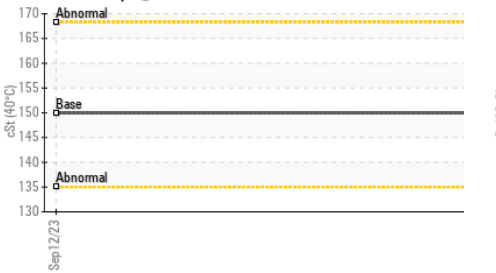

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	150	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

### Ferrous Alloys

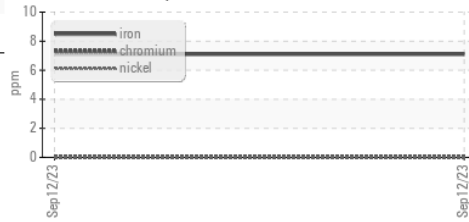


### Non-ferrous Metals



### Viscosity @ 40°C



### Particle Count

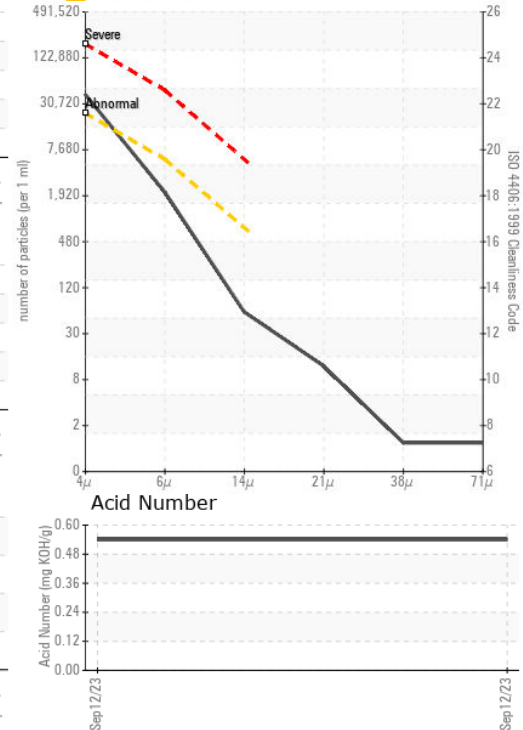

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0824137  
 Lab Number : 05963562  
 Unique Number : 10670113  
 Test Package : PLANT

Received : 28 Sep 2023  
 Diagnosed : 29 Sep 2023  
 Diagnostician : Don Baldrige

**ARAUCO - GRAYLING**  
 5851 ARAUCO ROAD  
 GRAYLING, MI  
 US 49738  
 Contact: JOSEPH GREEN  
 joseph.green@arauco.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: