




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

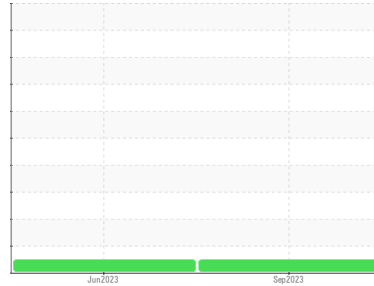

Machine Id
AF12-150-8025-0100 SL SILO HYDRAULIC UNIT

Component
Hydraulic System

Fluid
MOBIL DTE 10 EXCEL 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0824143	WC0818984	---
Sample Date	Client Info			18 Sep 2023	27 Jun 2023	---
Machine Age	mths	Client Info		60	60	---
Oil Age	mths	Client Info		9	24	---
Oil Changed	Client Info			Filtered	Filtered	---
Sample Status				NORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		11	9	---
Iron	ppm	ASTM D5185m	>20	<1	<1	---
Chromium	ppm	ASTM D5185m	>20	0	0	---
Nickel	ppm	ASTM D5185m	>20	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>20	<1	<1	---
Lead	ppm	ASTM D5185m	>20	<1	1	---
Copper	ppm	ASTM D5185m	>20	<1	<1	---
Tin	ppm	ASTM D5185m	>20	0	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		115	114	---
Phosphorus	ppm	ASTM D5185m		478	457	---
Zinc	ppm	ASTM D5185m		6	13	---
Sulfur	ppm	ASTM D5185m		1644	1778	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	---
Sodium	ppm	ASTM D5185m		1	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.029	0.006	---
ppm Water	ppm	ASTM D6304	>500	298.6	60.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	332	388	---
Particles >6µm		ASTM D7647	>1300	79	94	---
Particles >14µm		ASTM D7647	>160	14	20	---
Particles >21µm		ASTM D7647	>40	7	11	---
Particles >38µm		ASTM D7647	>10	1	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/13/11	16/14/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.091	---	---




OIL ANALYSIS REPORT

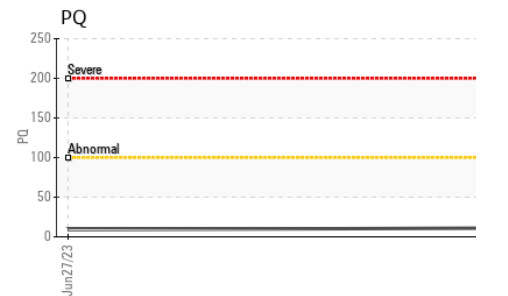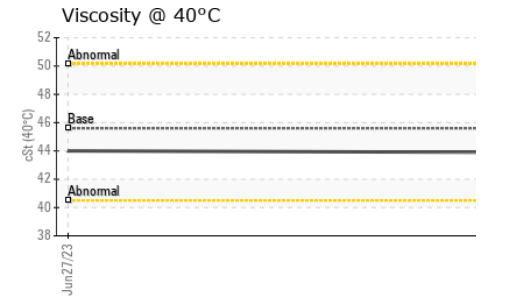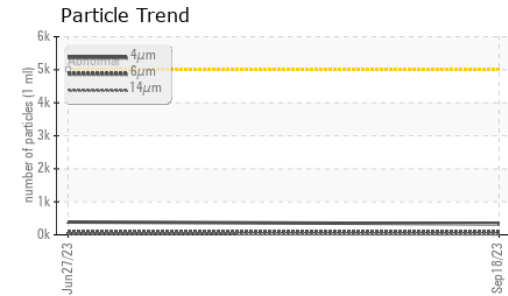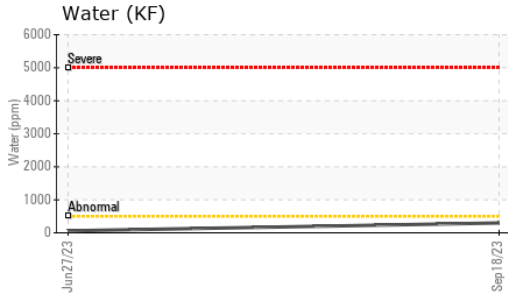



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.6	43.9	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

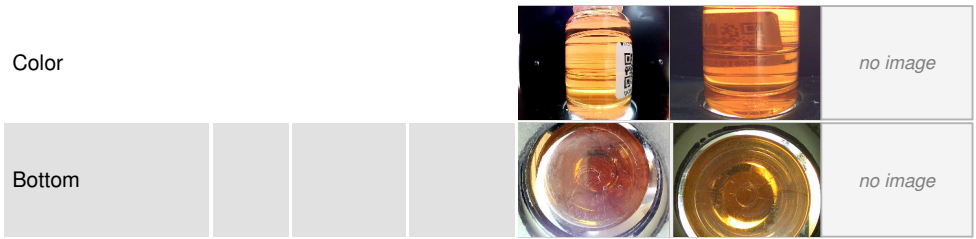

GRAPHS

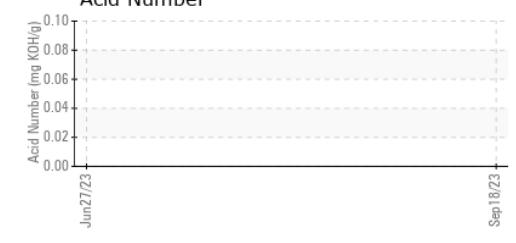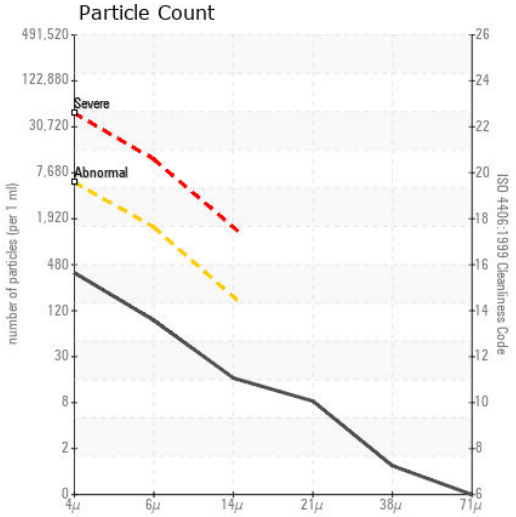

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0824143 **Received** : 28 Sep 2023
Lab Number : 05963571 **Diagnosed** : 29 Sep 2023
Unique Number : 10670122 **Diagnostician** : Don Baldrige
Test Package : PLANT

ARAUCO - GRAYLING
 5851 ARAUCO ROAD
 GRAYLING, MI
 US 49738
 Contact: JOSEPH GREEN
 joseph.green@arauco.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)