




# OIL ANALYSIS REPORT

Sample Rating Trend

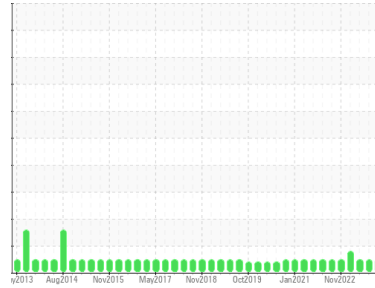

**NORMAL**



Area  
**HIGH SIDE**  
 Machine Id  
**RECO HIGH BAY COMPRESSOR 1 (S/N M741-260B)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP244504</b>	USP233591	USP233565
Sample Date	Client Info		<b>27 Sep 2023</b>	12 Apr 2023	24 Feb 2023
Machine Age	hrs	Client Info	<b>0</b>	43916	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>1</b>	0	3
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 5	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m 12	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 12	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m 12	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 1000	<b>18</b>	0	27

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	3	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.003</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >100	<b>28.0</b>	10.1	18.6

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>649</b>	1577	1890
Particles >6µm	ASTM D7647	>2500	<b>192</b>	416	339
Particles >14µm	ASTM D7647	>320	<b>13</b>	33	13
Particles >21µm	ASTM D7647	>80	<b>4</b>	6	2
Particles >38µm	ASTM D7647	>20	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>17/15/11</b>	18/16/12	18/16/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.10	<b>0.013</b>	0.015	0.162




# OIL ANALYSIS REPORT

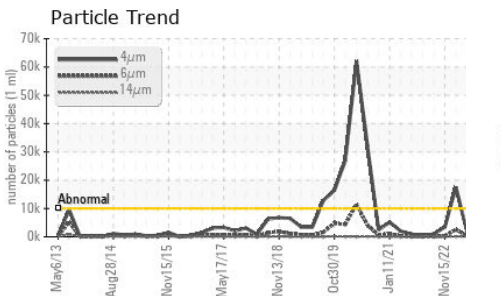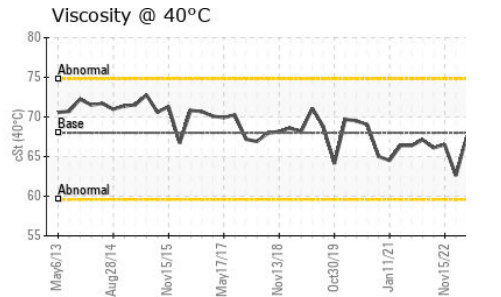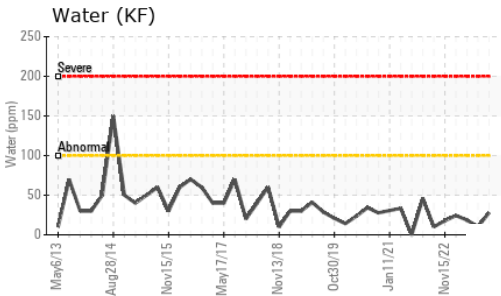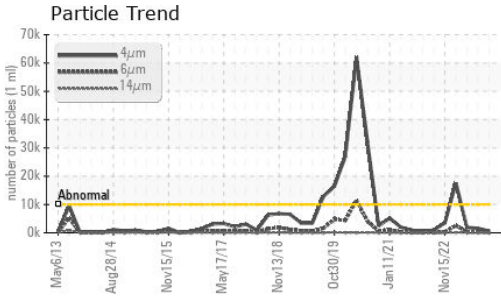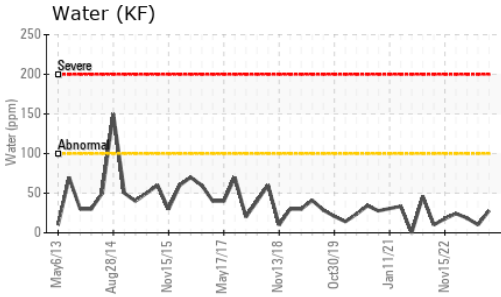






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>68.0</b>	66.4	67.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

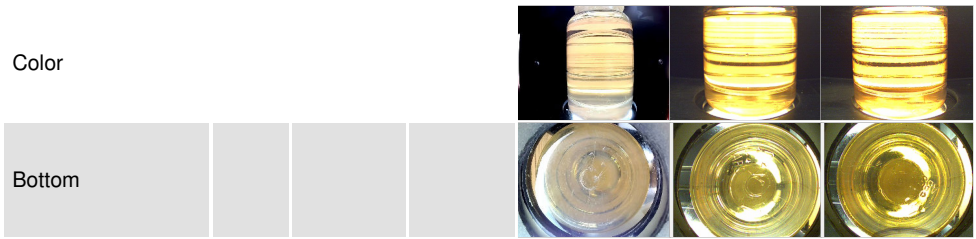

## GRAPHS

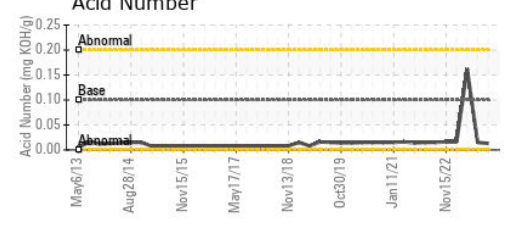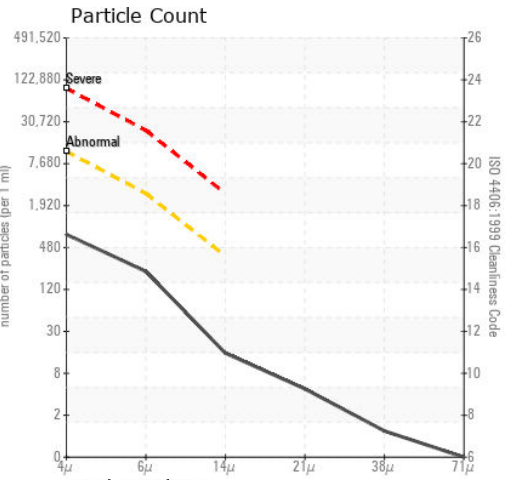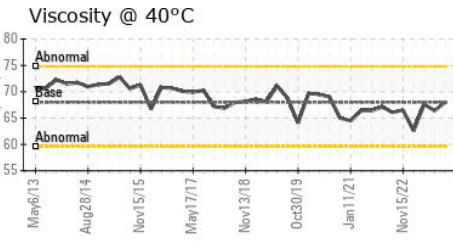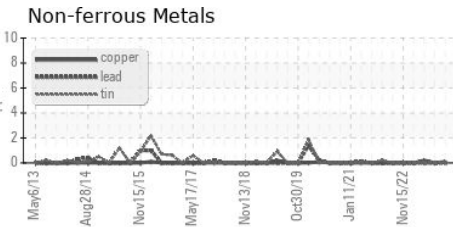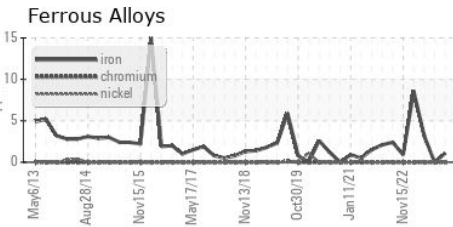

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP244504 **Received** : 28 Sep 2023  
**Lab Number** : **05963605** **Diagnosed** : 29 Sep 2023  
**Unique Number** : 10670156 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JR SIMPLOT CO**  
 3630 GATEWAY DR.  
 GRAND FORKS, ND  
 US 58201  
 Contact: GREG HUDERLE  
 greg.huderle@simplot.com  
 T:  
 F: (701)780-7880

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)