

OIL ANALYSIS REPORT

Sample Rating Trend NO

NORMAL



EISENBEISS BSAC II GEAR PUMP

Component

Gearbox

NOT GIVEN (2 GAL)

D	lΑ	G1	ИO	SI	IS	

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

				Sep 2023		
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO60001358		
Sample Date		Client Info		22 Sep 2023		
Machine Age	yrs	Client Info		4		
Oil Age	yrs	Client Info		4		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		38		
Iron	ppm	ASTM D5185m	>200	87		
Chromium	ppm	ASTM D5185m	>10	1		
Nickel	ppm	ASTM D5185m	>10	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m		0		
	ppm	ASTM D5185m	>200	2		
	ppm	ASTM D5185m	>10	0		
	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		29		
Barium	ppm	ASTM D5185m		4		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
	ppm	ASTM D5185m		<1		
	ppm	ASTM D5185m		7		
	ppm	ASTM D5185m		429		
	ppm	ASTM D5185m		60		
Sulfur	ppm	ASTM D5185m		6150		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	10		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	<1		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulaified Meter		*\ /:	0.0	NIEO		

>0.2

scalar *Visual

scalar *Visual

NEG


NEG

Emulsified Water

Free Water



OIL ANALYSIS REPORT

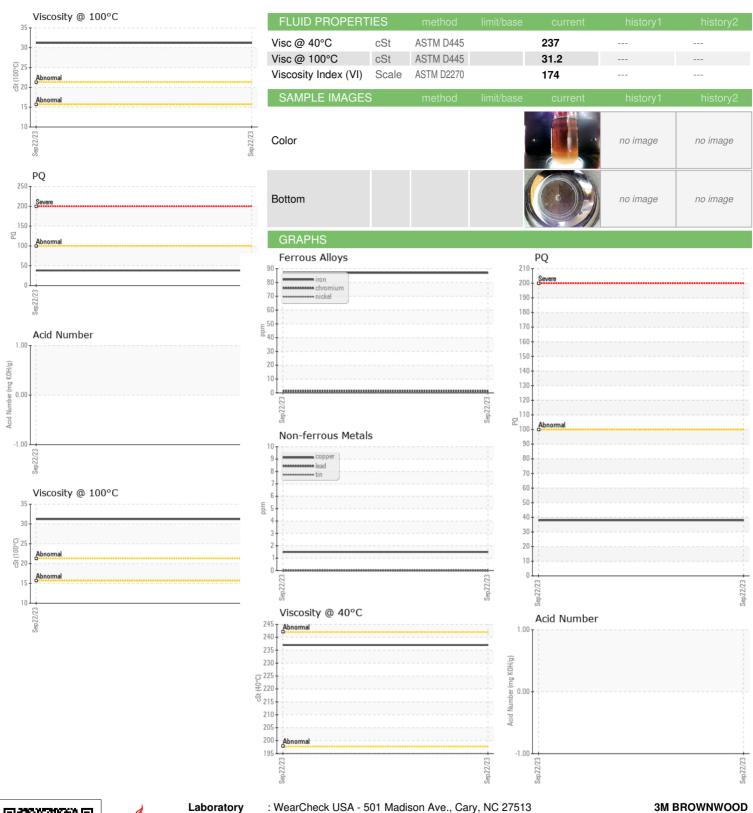





Laboratory

Sample No. Lab Number Unique Number : 10670339

: TO60001358 : 05963788

Received

Diagnosed

: 28 Sep 2023 : 02 Oct 2023 Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KV100, PQ, VI) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

rgotcherjr@mmm.com

US 76801

T: F:

4501 US 377 SOUTH

Contact: RICKY GOTCHER

BROWNWOOD, TX