




PROBLEM SUMMARY

Sample Rating Trend

VISCOSITY




Area
CAMILLE B BARRETT
 Machine Id
[CAMILLE B BARRETT] 007 538801-7
 Component
Port Genset
 Fluid
CHEVRON DELO 400 XLE 15W40 (9 GAL)

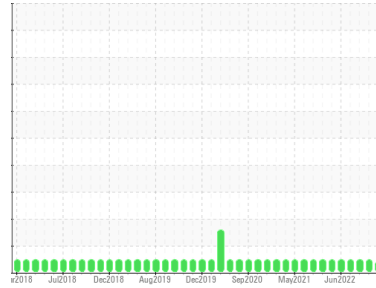

COMPONENT CONDITION SUMMARY

▲ Viscosity @ 100°C

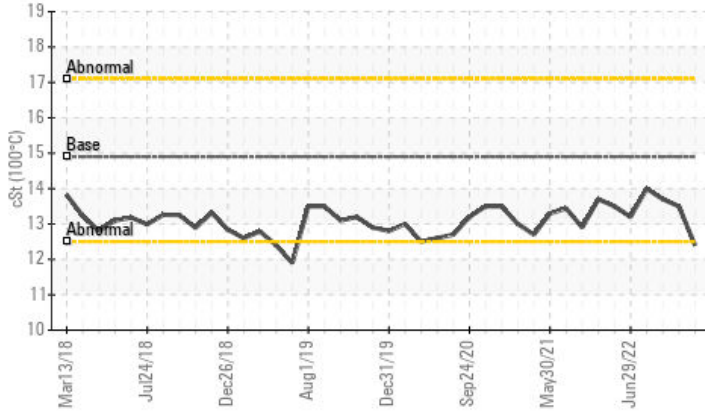

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				MARGINAL	NORMAL	NORMAL
Visc @ 100°C	cSt	ASTM D445	14.9	▲ 12.4	13.5	13.7

Customer Id: INGPAD
 Sample No.: MW0054389
 Lab Number: 05964097
 Test Package: MAR 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

31 Mar 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

[view report](#)



26 Jan 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

[view report](#)



05 Dec 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

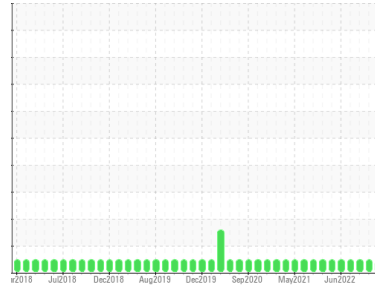

VISCOSITY



Area
CAMILLE B BARRETT
 Machine Id
[CAMILLE B BARRETT] 007 538801-7
 Component
Port Genset
 Fluid
CHEVRON DELO 400 XLE 15W40 (9 GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

▲ Fluid Condition

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		MW0054389	MW0051116	MW0035484
Sample Date	Client Info		01 Sep 2023	31 Mar 2023	26 Jan 2023
Machine Age	hrs	Client Info	30409	29337	28587
Oil Age	hrs	Client Info	336	14	315
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			MARGINAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	5	2	4
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	0	0	<1
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m >5	0	0	0
Aluminum	ppm	ASTM D5185m >12	<1	2	3
Lead	ppm	ASTM D5185m >17	<1	<1	<1
Copper	ppm	ASTM D5185m >70	4	<1	<1
Tin	ppm	ASTM D5185m >15	1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	34	430	338
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	42	83	124
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	538	421	642
Calcium	ppm	ASTM D5185m	1807	1384	1430
Phosphorus	ppm	ASTM D5185m 760	979	1008	659
Zinc	ppm	ASTM D5185m 830	1190	1228	830
Sulfur	ppm	ASTM D5185m 2770	3049	3886	2782

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	5	6
Sodium	ppm	ASTM D5185m	5	<1	0
Potassium	ppm	ASTM D5185m >20	3	1	0
Fuel	%	ASTM D3524 >4.0	0.6	<1.0	<1.0

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.2	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	7.6	4.9	5.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	23.0	20.9	22.8

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	16.9	14.5	16.0
Base Number (BN)	mg KOH/g	ASTM D2896 10.7	8.8	8.5	9.6







OIL ANALYSIS REPORT

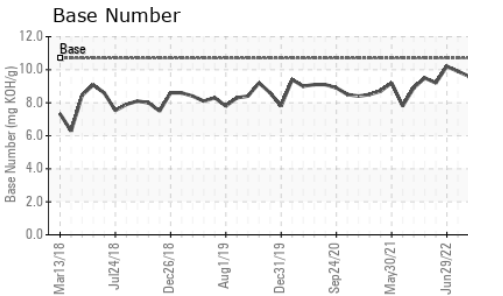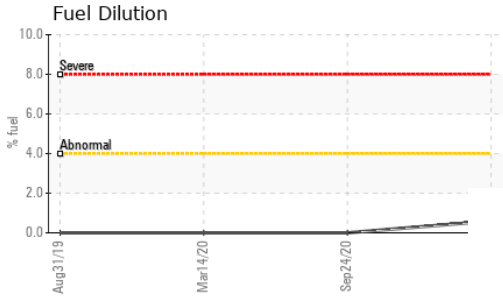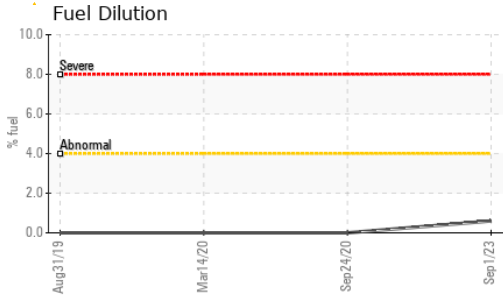

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.9 ▲ 12.4	13.5	13.7

GRAPHS

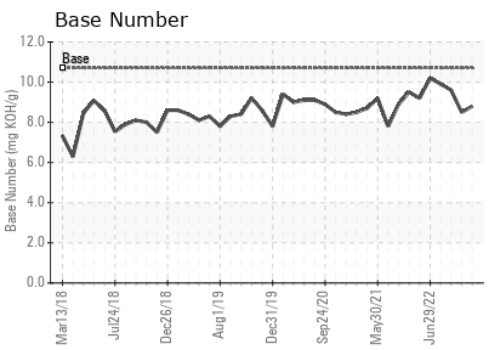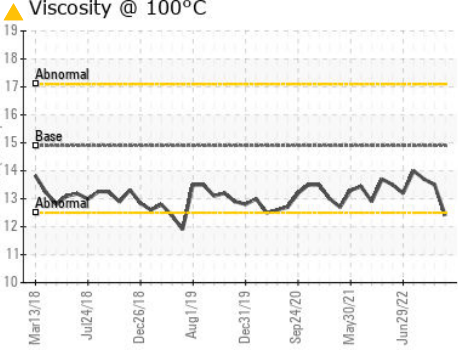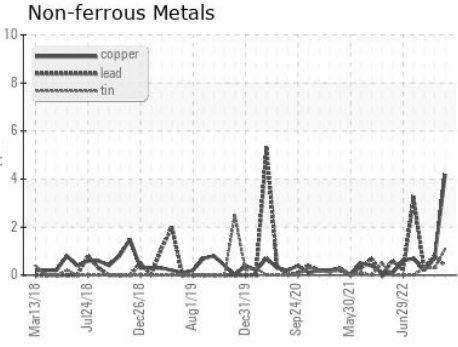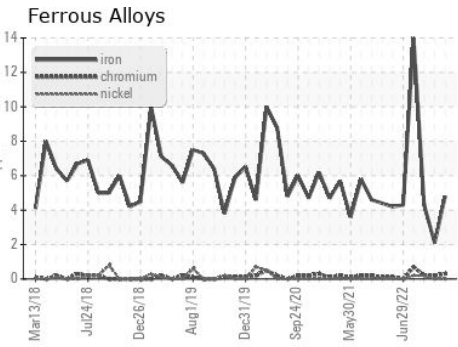

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0054389 **Received** : 28 Sep 2023
Lab Number : 05964097 **Diagnosed** : 02 Oct 2023
Unique Number : 10670648 **Diagnostician** : Jonathan Hester
Test Package : MAR 2 (Additional Tests: FuelDilution, PercentFuel)

INGRAM BARGE
 900 S 3RD ST
 PADUCAH, KY
 US 42003
 Contact: GLENN ELLIS
 glen.ellis@ingrambarge.com
 T: (270)415-4467
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)