




# OIL ANALYSIS REPORT

## Sample Rating Trend

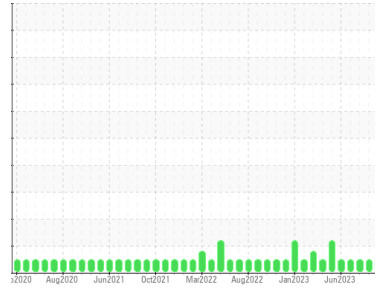

**NORMAL**



Area  
**IRIG [6076679]**  
 Machine Id  
**IRIG-SS-HPU-2301 IRIG-SS-HPU-2301 SUB HYDRAULIC POWER UNIT**  
 Component  
**Hydraulic System**  
 Fluid  
**MOBIL DTE 10 EXCEL 32 (400 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>HLC0002820</b>  | HLC0002810  | HLC0002732  |
| Sample Date        | Client Info |             |            | <b>27 Sep 2023</b> | 08 Sep 2023 | 29 Jul 2023 |
| Machine Age        | days        | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age            | days        | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | Filtered    | N/A         |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | NORMAL      |

| WEAR METALS |     | method      | limit/base | current   | history1 | history2 |
|-------------|-----|-------------|------------|-----------|----------|----------|
| Iron        | ppm | ASTM D5185m | >20        | <b>8</b>  | 8        | 9        |
| Chromium    | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | 0        |
| Nickel      | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | <1       |
| Titanium    | ppm | ASTM D5185m |            | <b>0</b>  | <1       | 0        |
| Silver      | ppm | ASTM D5185m |            | <b>0</b>  | 0        | 0        |
| Aluminum    | ppm | ASTM D5185m | >20        | <b>0</b>  | <1       | 0        |
| Lead        | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | <1       |
| Copper      | ppm | ASTM D5185m | >20        | <b>11</b> | 11       | 11       |
| Tin         | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | 0        |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>  | <1       | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>  | 0        | 0        |

| ADDITIVES  |     | method      | limit/base | current      | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Manganese  | ppm | ASTM D5185m |            | <b>&lt;1</b> | <1       | 0        |
| Magnesium  | ppm | ASTM D5185m |            | <b>0</b>     | 0        | 0        |
| Calcium    | ppm | ASTM D5185m | 120        | <b>94</b>    | 107      | 94       |
| Phosphorus | ppm | ASTM D5185m | 475        | <b>407</b>   | 443      | 392      |
| Zinc       | ppm | ASTM D5185m |            | <b>54</b>    | 35       | 60       |
| Sulfur     | ppm | ASTM D5185m | 1275       | <b>1260</b>  | 1569     | 1395     |


| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >15        | <b>&lt;1</b> | 1        | <1       |
| Sodium       | ppm | ASTM D5185m |            | <b>3</b>     | 4        | 0        |
| Potassium    | ppm | ASTM D5185m | >20        | <b>2</b>     | <1       | <1       |

| FLUID CLEANLINESS |  | method       | limit/base | current        | history1 | history2 |
|-------------------|--|--------------|------------|----------------|----------|----------|
| Particles >4µm    |  | ASTM D7647   | >2500      | <b>718</b>     | 1468     | 556      |
| Particles >6µm    |  | ASTM D7647   | >640       | <b>37</b>      | 91       | 77       |
| Particles >14µm   |  | ASTM D7647   | >160       | <b>3</b>       | 7        | 6        |
| Particles >21µm   |  | ASTM D7647   | >40        | <b>1</b>       | 2        | 2        |
| Particles >38µm   |  | ASTM D7647   | >10        | <b>0</b>       | 0        | 0        |
| Particles >71µm   |  | ASTM D7647   | >3         | <b>0</b>       | 0        | 0        |
| Oil Cleanliness   |  | ISO 4406 (c) | >18/16/14  | <b>17/12/9</b> | 18/14/10 | 16/13/10 |


| FLUID DEGRADATION |          | method     | limit/base | current      | history1 | history2 |
|-------------------|----------|------------|------------|--------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 |            | <b>0.226</b> | 0.157    | 0.07     |

# OIL ANALYSIS REPORT


### Particle Trend

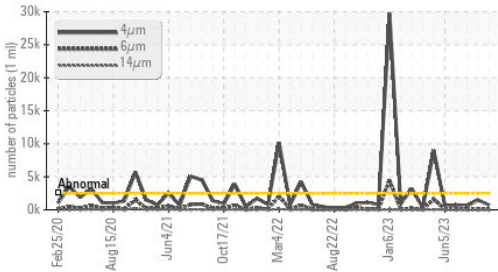


### Acid Number

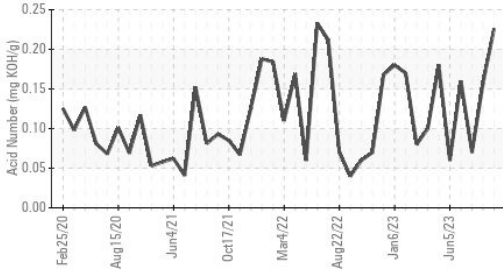

### Viscosity @ 40°C

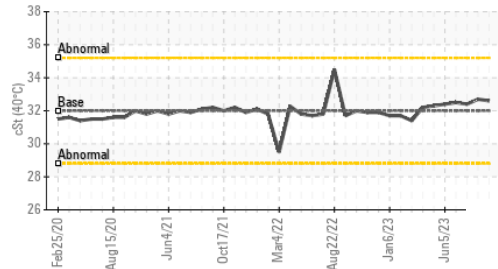

### Particle Trend

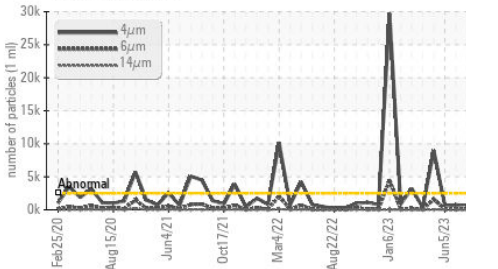


| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.05   | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 32      | 32.6     | 32.7     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|


### Color

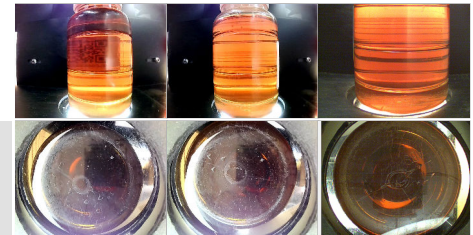


### Bottom

## GRAPHS


### Ferrous Alloys

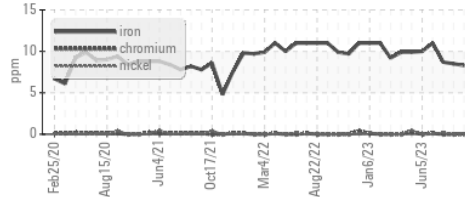


### Non-ferrous Metals

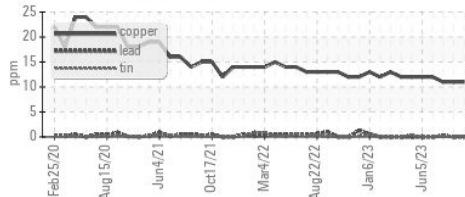


### Viscosity @ 40°C

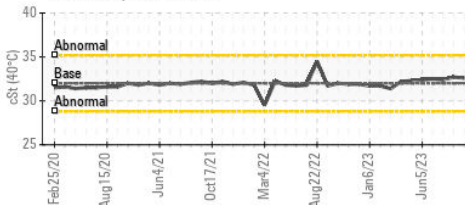

### Particle Count

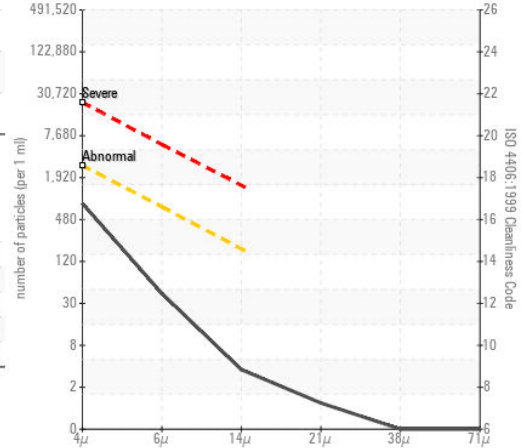

### Acid Number

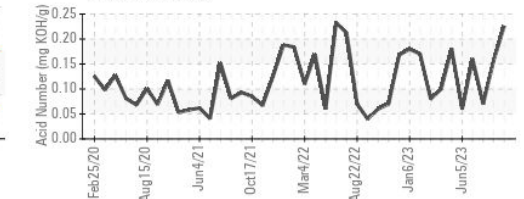

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002820 **Received** : 28 Sep 2023  
**Lab Number** : 05964176 **Diagnosed** : 29 Sep 2023  
**Unique Number** : 10670727 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILNE POINT**  
 1000 MILNE POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)