

### **PROBLEM SUMMARY**

Sample Rating Trend


ISO

# Machine Id KAESER ASD40 5428045 (S/N 1125)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**

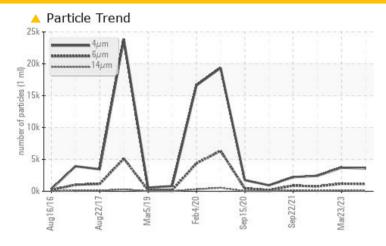

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ATTENTION	ATTENTION				
Particles >14µm	ASTM D7647	>80	<b>4</b> 90	<u> 151</u>	<b>▲</b> 83				
Particles >21µm	ASTM D7647	>20	<b>25</b>	<b>▲</b> 57	<u>^</u> 26				
Oil Cleanliness	ISO 4406 (c)	>17/13	<b>17/14</b>	<b>△</b> 17/14	<b>△</b> 17/14				

Customer Id: EDEQUO Sample No.: KCPA000266 Lab Number: 05964194 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 23 Mar 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 02 Sep 2022 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



### 22 Sep 2021 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





### **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

## KAESER ASD40 5428045 (S/N 1125)

Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2016 Au	rg2017 Mar2019 Feb	2020 Sep2020 Sep2021	Mar2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000266	KCPA001196	KCP50309
Sample Date		Client Info		06 Sep 2023	23 Mar 2023	02 Sep 2022
Machine Age	hrs	Client Info		36284	33771	30349
Oil Age	hrs	Client Info		0	0	3111
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ATTENTION	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	3	2	6
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	3	1	2
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m	500	136	182	145
Zinc	ppm	ASTM D5185m		63	115	57
Sulfur	ppm	ASTM D5185m		1234	1278	1403
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	<1
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	1	<1	0
Water	%	ASTM D6304	>0.05	0.002	0.004	0.001
ppm Water	ppm	ASTM D6304	>500	19.3	41.0	5.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3597	3705	2423
Particles >6µm		ASTM D7647	>1300	1150	1186	764
Particles >14µm		ASTM D7647	>80	<u> </u>	<u> </u>	<b>▲</b> 83
Particles >21µm		ASTM D7647	>20	<u>^</u> 25	<u>▲</u> 57	<u>^</u> 26
Particles >38µm		ASTM D7647	>4	3	2	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>17/14</b>	<b>△</b> 17/14	<b>△</b> 17/14
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2



### **OIL ANALYSIS REPORT**

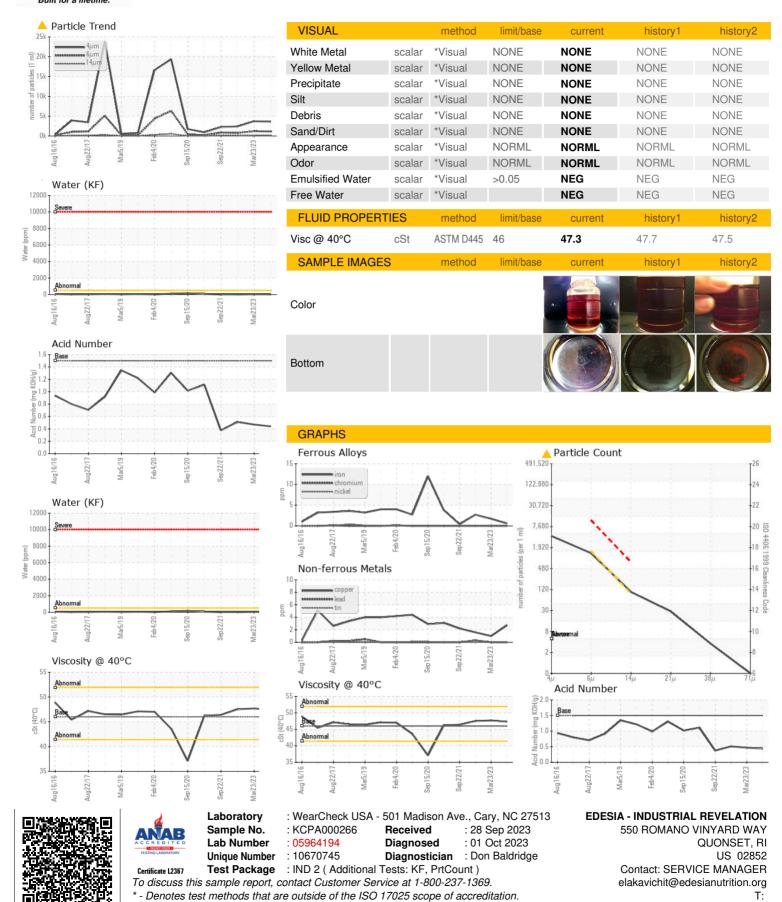

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: