




PROBLEM SUMMARY

Sample Rating Trend

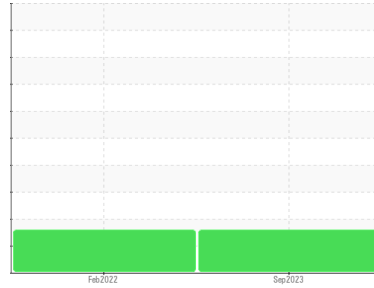

ISO




Machine Id
6290404 (S/N 1418)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

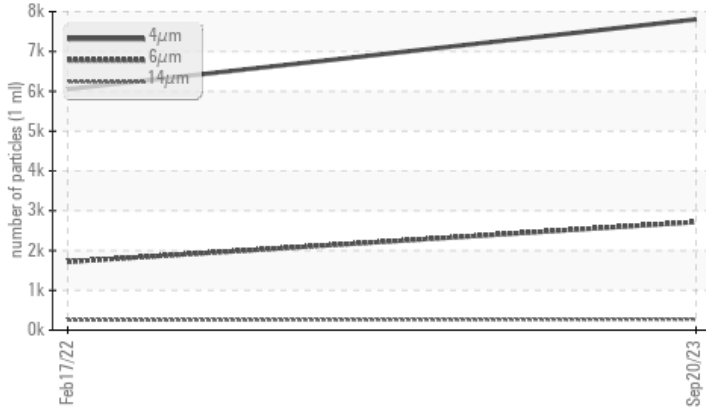

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 2717	▲ 1718	---
Particles >14µm	ASTM D7647	>80	▲ 273	▲ 250	---
Particles >21µm	ASTM D7647	>20	▲ 75	▲ 87	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 18/15	---

Customer Id: TRUGAR
Sample No.: KCPA006245
Lab Number: 05964201
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

17 Feb 2022 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

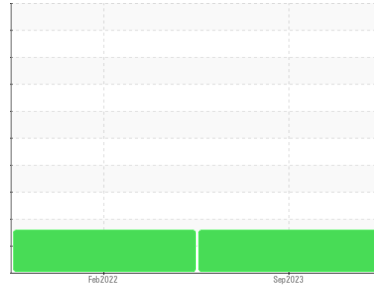

Machine Id
6290404 (S/N 1418)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA006245	KCP36183	---
Sample Date	Client Info		20 Sep 2023	17 Feb 2022	---
Machine Age	hrs	Client Info	27603	17388	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	Not Changd	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	<1	<1	---
Aluminum	ppm	ASTM D5185m >10	0	<1	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	14	6	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	2	---
Barium	ppm	ASTM D5185m 90	0	0	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m 100	0	29	---
Calcium	ppm	ASTM D5185m 0	0	0	---
Phosphorus	ppm	ASTM D5185m 0	<1	2	---
Zinc	ppm	ASTM D5185m 0	0	22	---
Sulfur	ppm	ASTM D5185m 23500	16784	16061	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	---
Sodium	ppm	ASTM D5185m	0	11	---
Potassium	ppm	ASTM D5185m >20	1	<1	---
Water	%	ASTM D6304 >0.05	0.004	0.009	---
ppm Water	ppm	ASTM D6304 >500	41.2	97.2	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7806	6053	---
Particles >6µm	ASTM D7647	>1300	▲ 2717	▲ 1718	---
Particles >14µm	ASTM D7647	>80	▲ 273	▲ 250	---
Particles >21µm	ASTM D7647	>20	▲ 75	▲ 87	---
Particles >38µm	ASTM D7647	>4	1	▲ 18	---
Particles >71µm	ASTM D7647	>3	0	4	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	▲ 18/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.42	0.39	---


OIL ANALYSIS REPORT

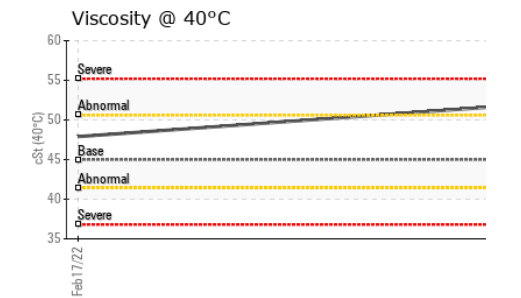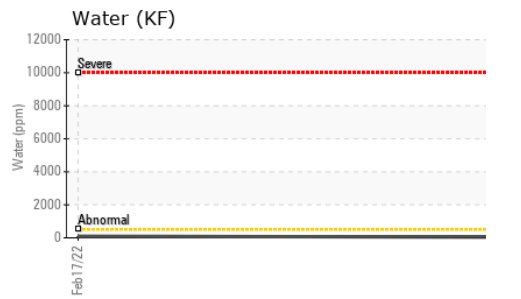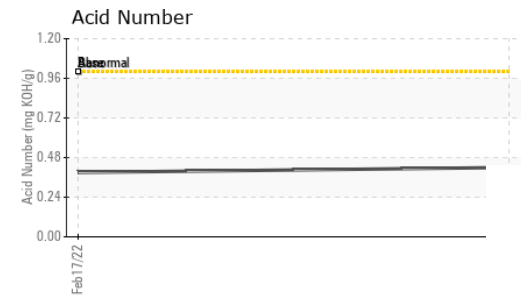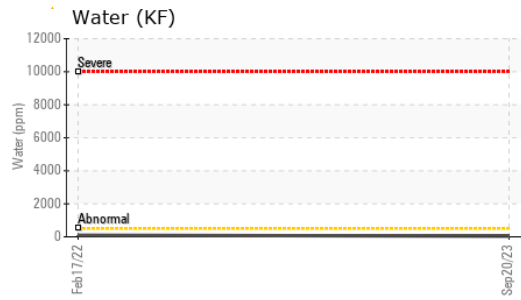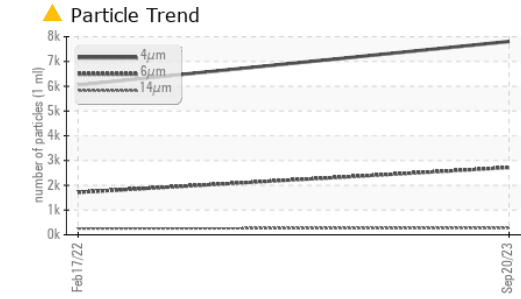





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	51.8	47.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

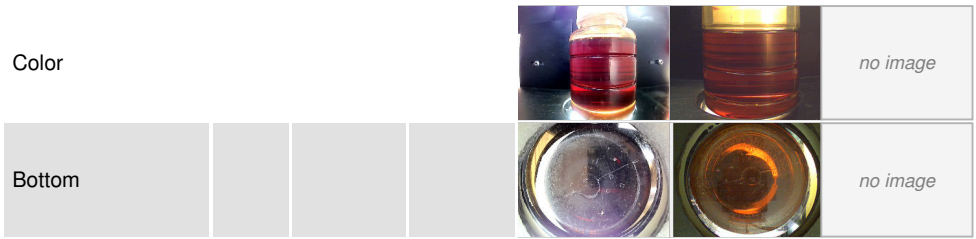

GRAPHS

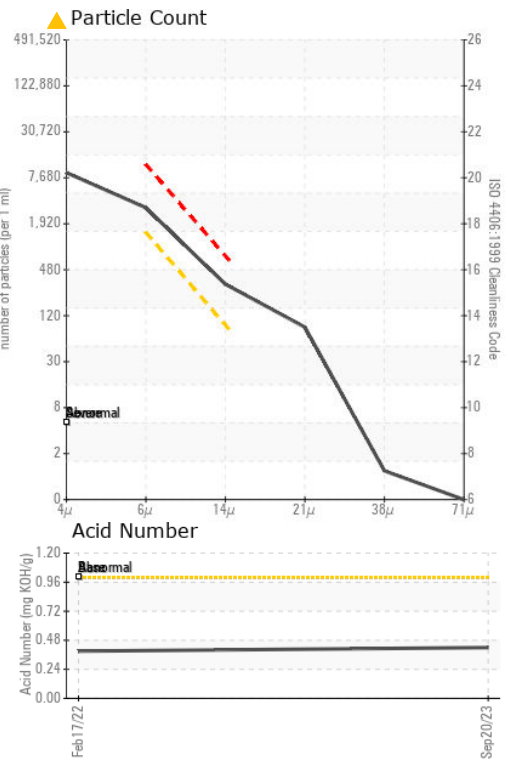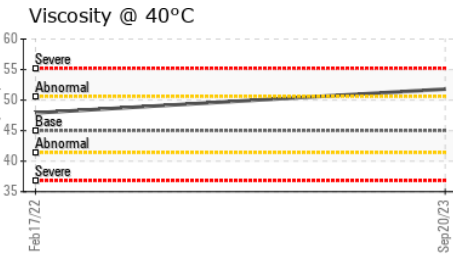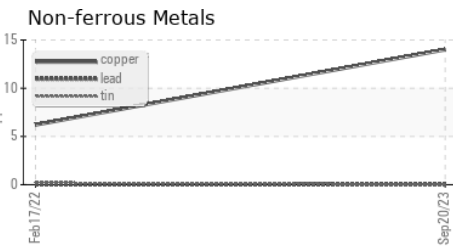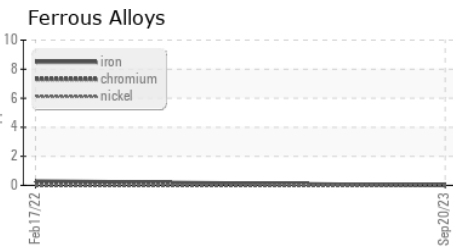

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006245 **Received** : 28 Sep 2023
Lab Number : 05964201 **Diagnosed** : 01 Oct 2023
Unique Number : 10670752 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TRUE VELOCITY
 1036 NICHOLSON RD
 GARLAND, TX
 US 75042
 Contact: B JAQUEZ
 BJAQUEZ@TVAMMO.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)