




# PROBLEM SUMMARY

Sample Rating Trend

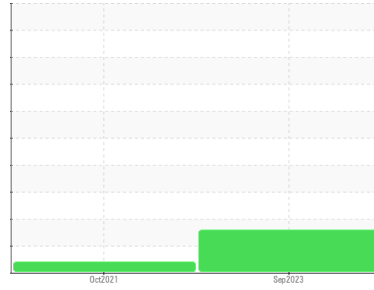

ISO




Machine Id  
**KAESER BS 51 1528362 (S/N 1142)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

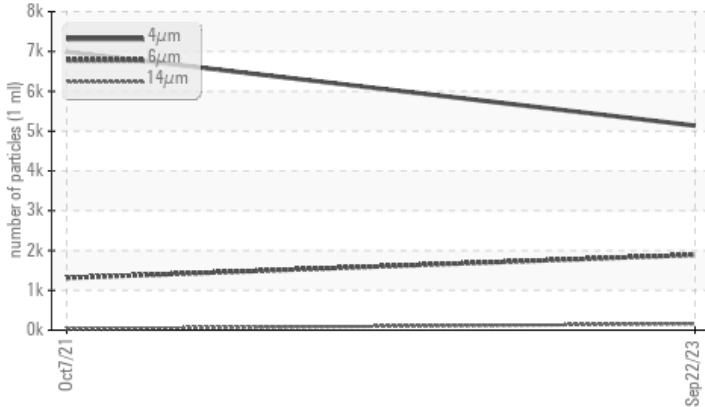

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ATTENTION	---
Particles >6µm	ASTM D7647	>1300	▲ 1890	▲ 1313	---
Particles >14µm	ASTM D7647	>80	▲ 159	34	---
Particles >21µm	ASTM D7647	>20	▲ 32	7	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 18/12	---

Customer Id: SEVMOD  
Sample No.: KCPA006161  
Lab Number: 05964209  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**07 Oct 2021 Diag: Jonathan Hester**

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

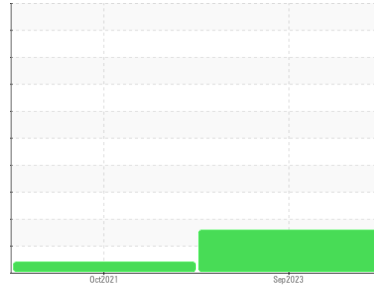

Machine Id  
**KAESER BS 51 1528362 (S/N 1142)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA006161</b>	KCP39078	---
Sample Date	Client Info		<b>22 Sep 2023</b>	07 Oct 2021	---
Machine Age	hrs	Client Info	<b>52281</b>	47449	---
Oil Age	hrs	Client Info	<b>0</b>	3000	---
Oil Changed	Client Info		<b>N/A</b>	Changed	---
Sample Status			<b>ATTENTION</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	26	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	6	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>1</b>	6	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Antimony	ppm	ASTM D5185m	<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 500	<b>8</b>	186	---
Zinc	ppm	ASTM D5185m	<b>0</b>	174	---
Sulfur	ppm	ASTM D5185m	<b>1106</b>	3249	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.00</b>	0.004	---
ppm Water	ppm	ASTM D6304 >500	<b>0.00</b>	41.3	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5137</b>	6990	---
Particles >6µm	ASTM D7647 >1300		<b>▲ 1890</b>	▲ 1313	---
Particles >14µm	ASTM D7647 >80		<b>▲ 159</b>	34	---
Particles >21µm	ASTM D7647 >20		<b>▲ 32</b>	7	---
Particles >38µm	ASTM D7647 >4		<b>1</b>	1	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	▲ 18/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.20</b>	0.538	---


# OIL ANALYSIS REPORT

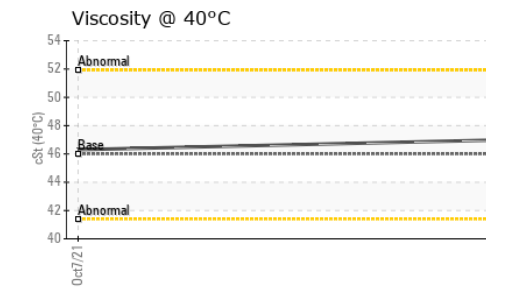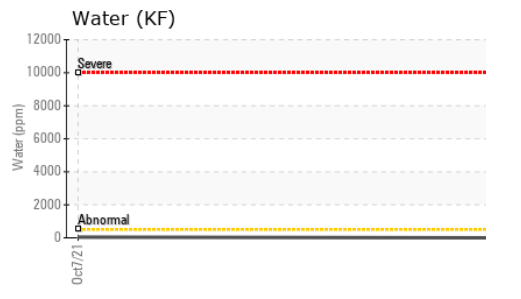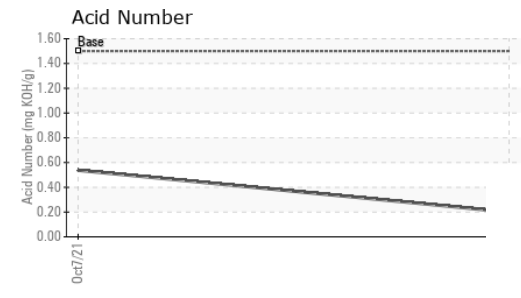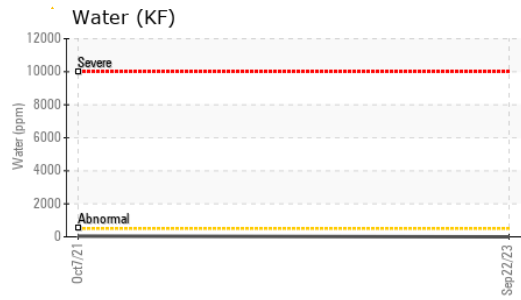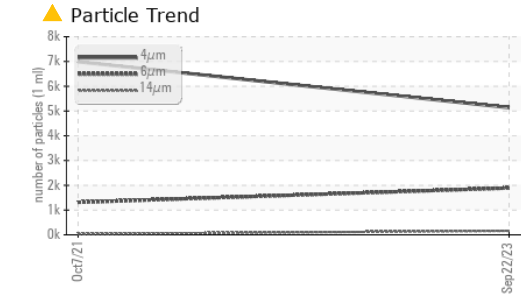






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.0	46.3

**SAMPLE IMAGES**

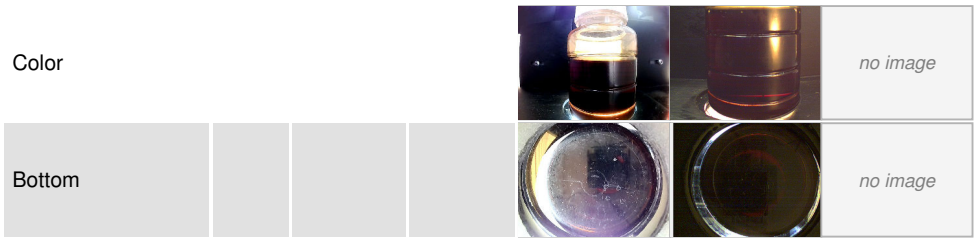

**GRAPHS**

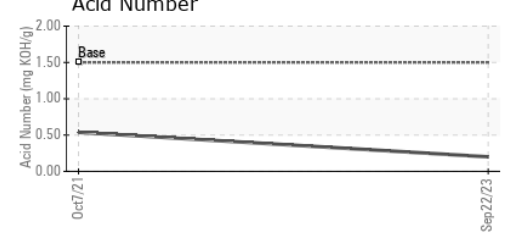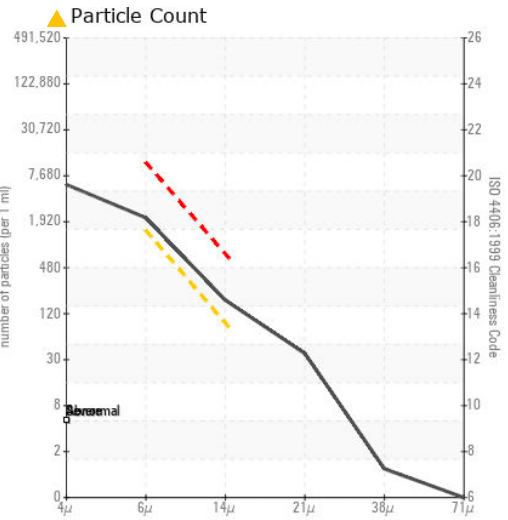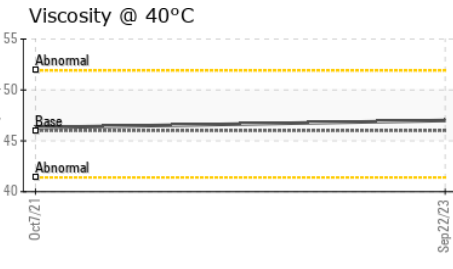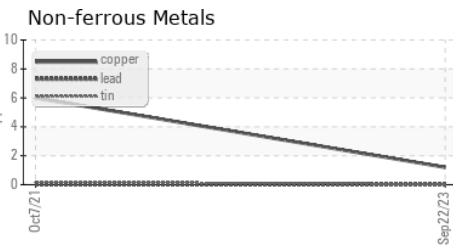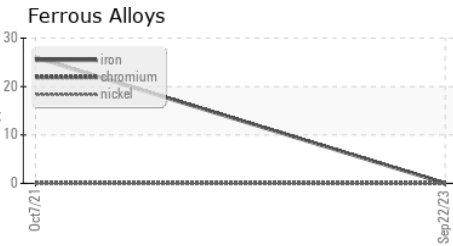

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006161 **Received** : 28 Sep 2023  
**Lab Number** : 05964209 **Diagnosed** : 01 Oct 2023  
**Unique Number** : 10670760 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**SEVEN UP - VARNI BROTHERS CORP**  
 400 HOSMER AVE.  
 MODESTO, CA  
 US 95351  
 Contact: LEANARD L.  
 leonardl@vbcbbottling.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)