




PROBLEM SUMMARY

Sample Rating Trend

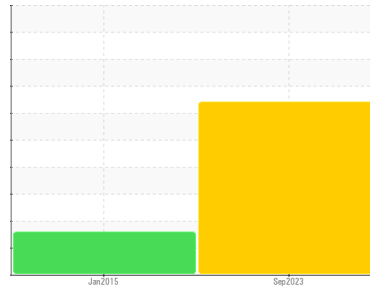

DIRT




Machine Id
KAESER SX 6 2220894 (S/N 2408)

Component
Compressor


Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

Silicon (ppm)

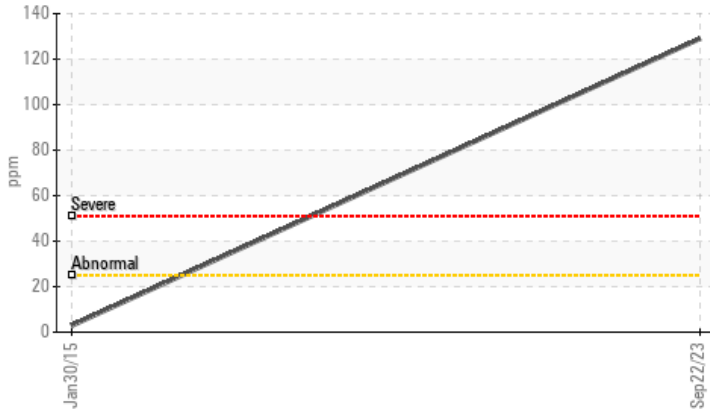

Particle Trend

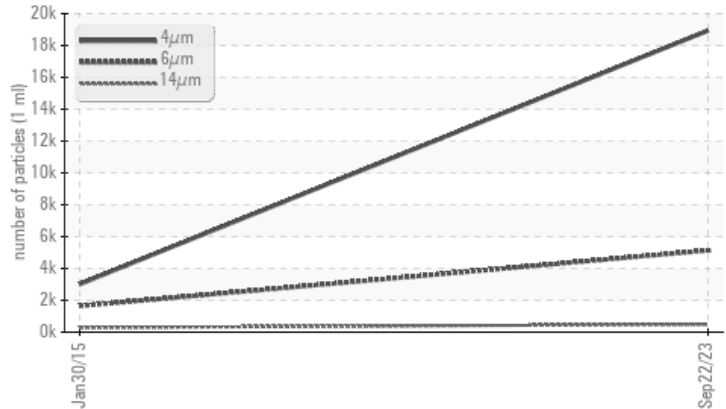

RECOMMENDATION

The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	ABNORMAL	---
Silicon	ppm	ASTM D5185m	>25	129	3	---
Particles >6µm		ASTM D7647	>1300	5126	1641	---
Particles >14µm		ASTM D7647	>80	488	279	---
Particles >21µm		ASTM D7647	>20	107	94	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	21/20/16	18/15	---

Customer Id: PAC CER
Sample No.: KCPA000570
Lab Number: 05964211
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

30 Jan 2015 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

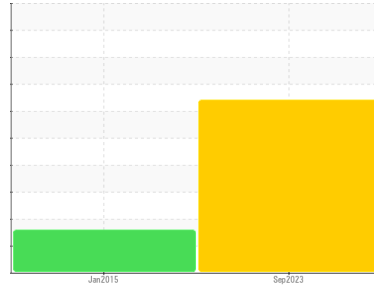

DIRT



Machine Id
KAESER SX 6 2220894 (S/N 2408)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA000570	KC50218	---
Sample Date	Client Info			22 Sep 2023	30 Jan 2015	---
Machine Age	hrs	Client Info		24109	10799	---
Oil Age	hrs	Client Info		0	3074	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				SEVERE	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	6	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	0	<1	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	3	12	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	<1	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	56	1	---
Calcium	ppm	ASTM D5185m	0	<1	0	---
Phosphorus	ppm	ASTM D5185m	0	1	75	---
Zinc	ppm	ASTM D5185m	0	10	55	---
Sulfur	ppm	ASTM D5185m	23500	18641	16002	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	129	3	---
Sodium	ppm	ASTM D5185m		14	<1	---
Potassium	ppm	ASTM D5185m	>20	3	1	---
Water	%	ASTM D6304	>0.05	0.020	0.007	---
ppm Water	ppm	ASTM D6304	>500	207.2	70	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		18939	3012	---
Particles >6µm		ASTM D7647	>1300	5126	1641	---
Particles >14µm		ASTM D7647	>80	488	279	---
Particles >21µm		ASTM D7647	>20	107	94	---
Particles >38µm		ASTM D7647	>4	3	14	---
Particles >71µm		ASTM D7647	>3	0	1	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	21/20/16	18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.566	---


OIL ANALYSIS REPORT

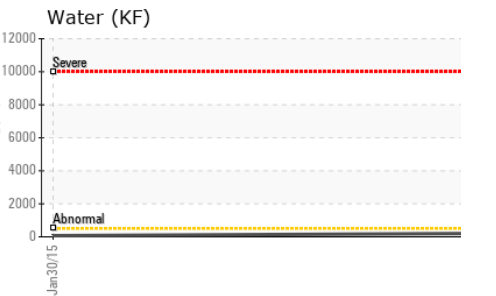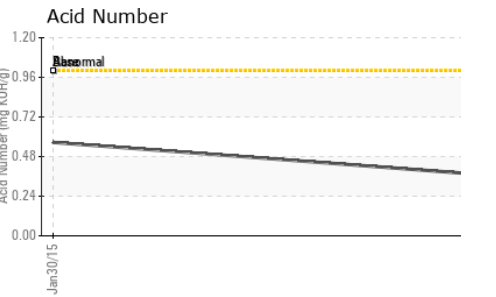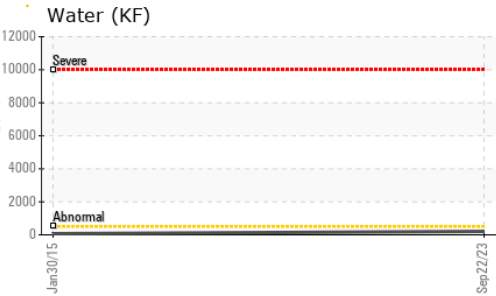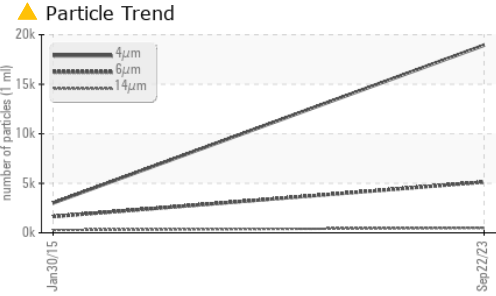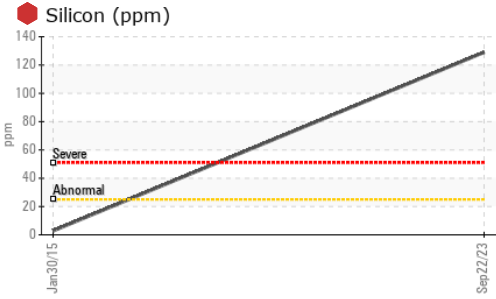





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.2	46.13

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

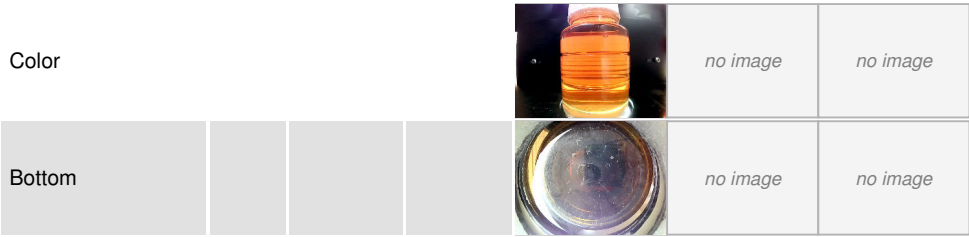

GRAPHS

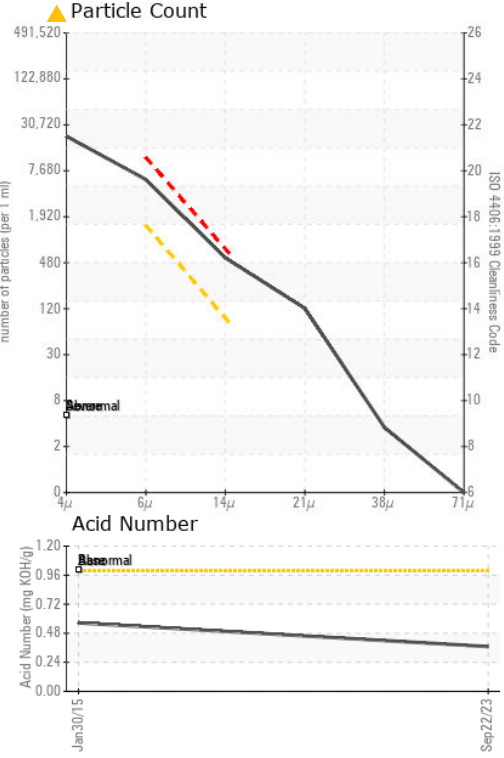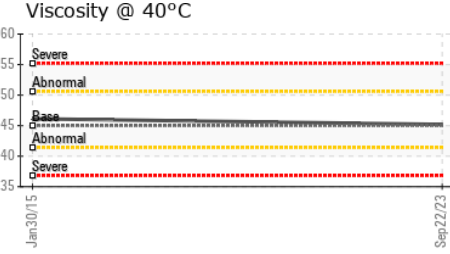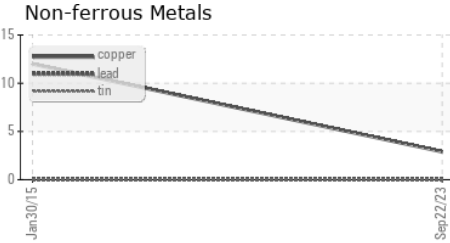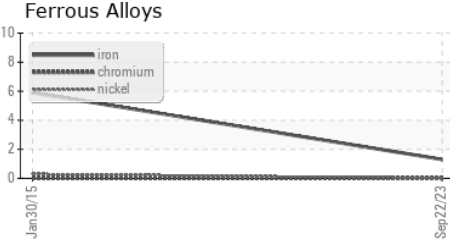

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA000570 **Received** : 28 Sep 2023
Lab Number : 05964211 **Diagnosed** : 03 Oct 2023
Unique Number : 10670762 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PACIFIC ELEMENTS
 501 PRAIRIE FLOWER RD
 CERES, CA
 US 95307
 Contact: S CAZARES
 SCAZARES@PACIFICELEMENTS.NET
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)