


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

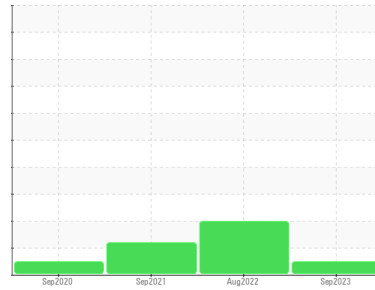

Machine Id  
**6977209 (S/N 1267)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC124251</b>	KC100290	KC92464
Sample Date	Client Info			<b>22 Sep 2023</b>	15 Aug 2022	30 Sep 2021
Machine Age	hrs	Client Info		<b>8340</b>	5441	2935
Oil Age	hrs	Client Info		<b>0</b>	2505	1769
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>6</b>	3	5
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	1
Barium	ppm	ASTM D5185m	90	<b>0</b>	4	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	90	<b>41</b>	47	55
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>1</b>	0	2
Zinc	ppm	ASTM D5185m		<b>0</b>	6	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	3	0
Sodium	ppm	ASTM D5185m		<b>18</b>	17	20
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.012</b>	0.019	0.024
ppm Water	ppm	ASTM D6304	>500	<b>122.9</b>	197.2	240.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1972</b>	84337	5609
Particles >6µm		ASTM D7647	>1300	<b>592</b>	▲ 23855	▲ 1881
Particles >14µm		ASTM D7647	>80	<b>34</b>	▲ 1895	▲ 149
Particles >21µm		ASTM D7647	>20	<b>7</b>	▲ 288	▲ 26
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 11	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/12</b>	▲ 24/22/18	▲ 18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.33</b>	0.33	0.334


# OIL ANALYSIS REPORT

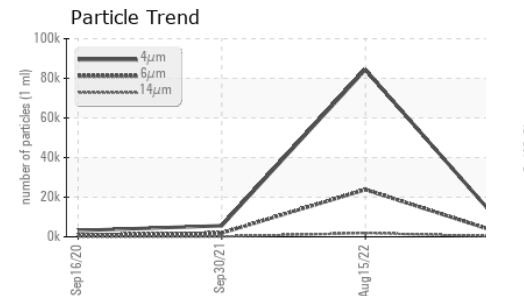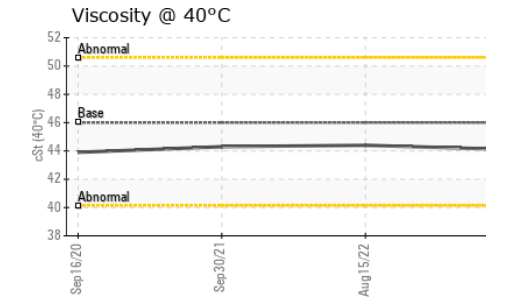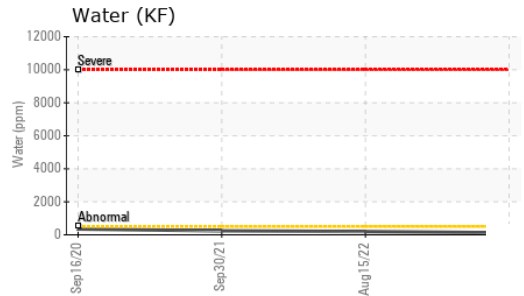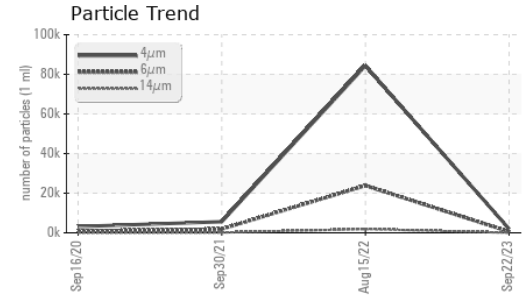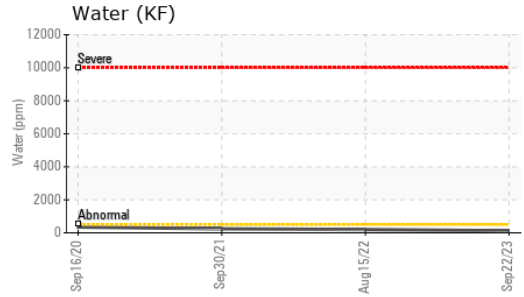






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	44.4	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

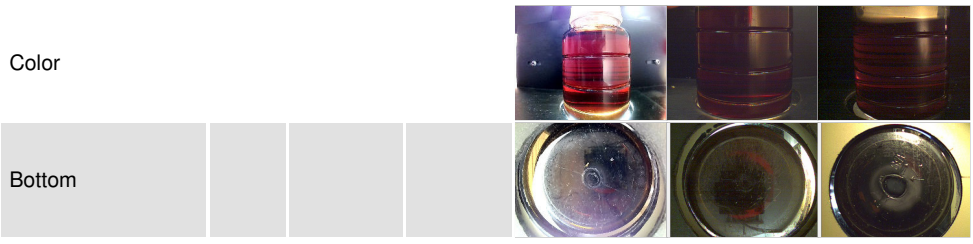

## GRAPHS

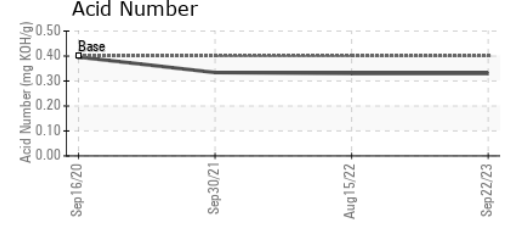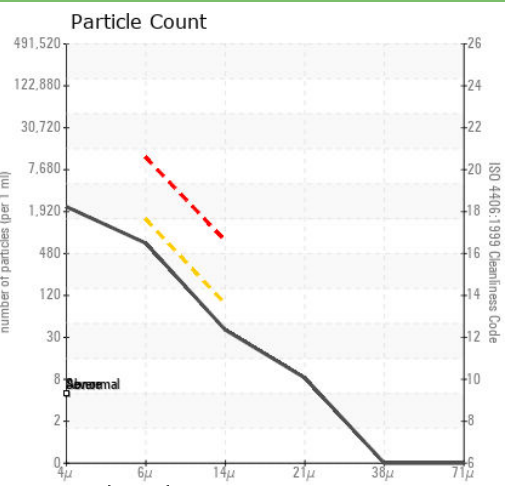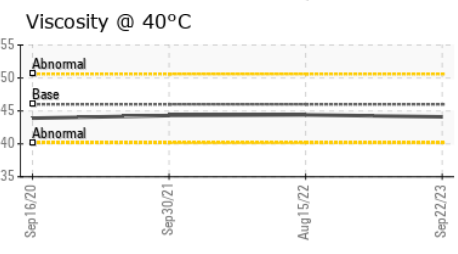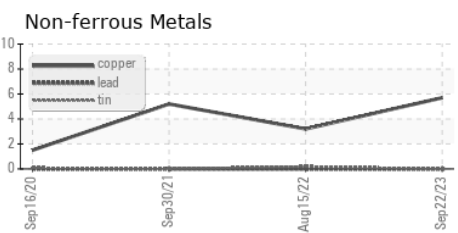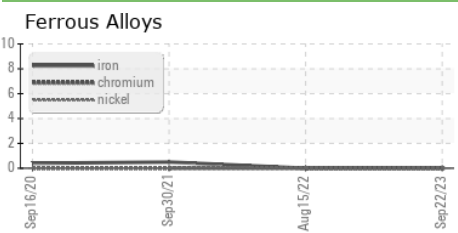

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC124251 **Received** : 28 Sep 2023  
**Lab Number** : 05964216 **Diagnosed** : 01 Oct 2023  
**Unique Number** : 10670767 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ALL CUSTOM FABRICATING**  
 1200 BROOKPARK RD  
 CLEVELAND, OH  
 US 44109  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: