




# PROBLEM SUMMARY

## Sample Rating Trend

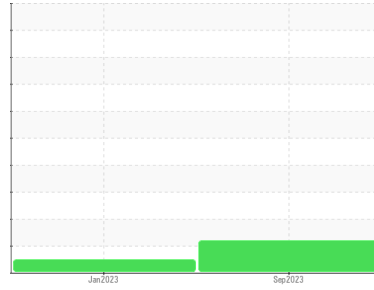


ISO



Machine Id  
**BOOSTER 2 - 920481**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 68 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

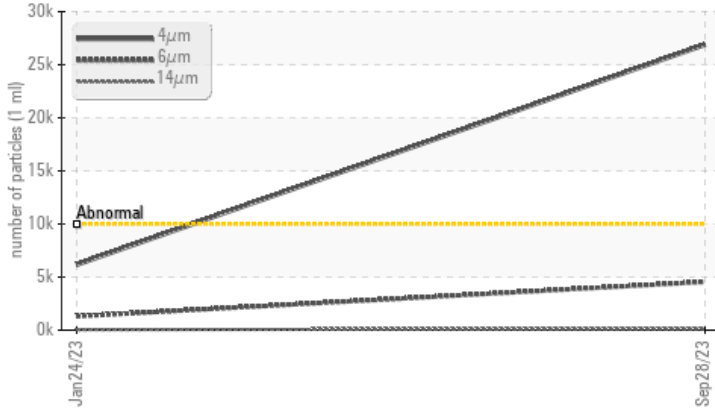

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	---
Particles >4µm	ASTM D7647	>10000	▲ 26886	6154	---
Particles >6µm	ASTM D7647	>2500	▲ 4543	1301	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 22/19/14	20/18/12	---

Customer Id: AMEEAS\_USP  
 Sample No.: USP0001816  
 Lab Number: 05964228  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**24 Jan 2023 Diag: Doug Bogart**

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

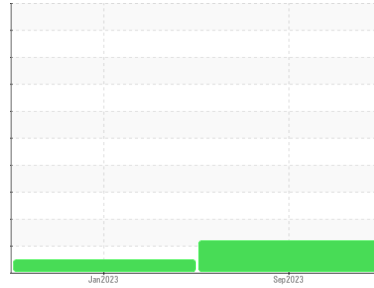

ISO



Machine Id  
**BOOSTER 2 - 920481**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0001816</b>	USP246515	---
Sample Date	Client Info		<b>28 Sep 2023</b>	24 Jan 2023	---
Machine Age	hrs	Client Info	<b>0</b>	86460	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>Not Changed</b>	Not Changed	---
Sample Status			<b>ABNORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>8</b>	8	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m 5	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m 12	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 12	<b>0</b>	0	---
Zinc	ppm	ASTM D5185m 12	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m 1000	<b>10</b>	0	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	---
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.004	---
ppm Water	ppm	ASTM D6304 >100	<b>0.00</b>	45.1	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 26886</b>	6154	---
Particles >6µm	ASTM D7647	>2500	<b>▲ 4543</b>	1301	---
Particles >14µm	ASTM D7647	>320	<b>127</b>	38	---
Particles >21µm	ASTM D7647	>80	<b>21</b>	6	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	1	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 22/19/14</b>	20/18/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.10	<b>0.012</b>	0.013	---




# OIL ANALYSIS REPORT

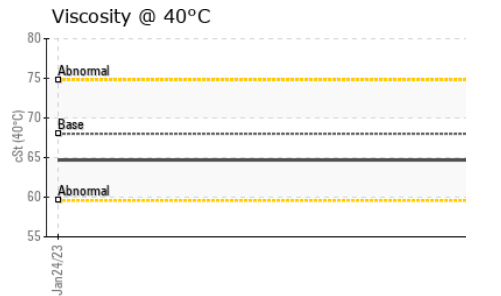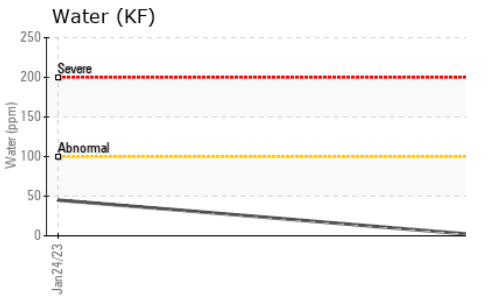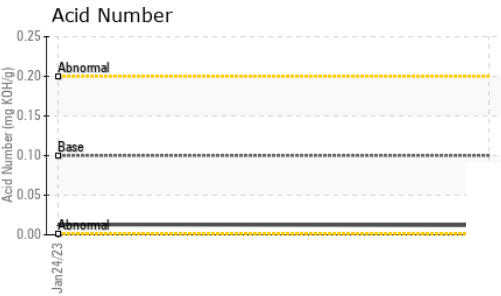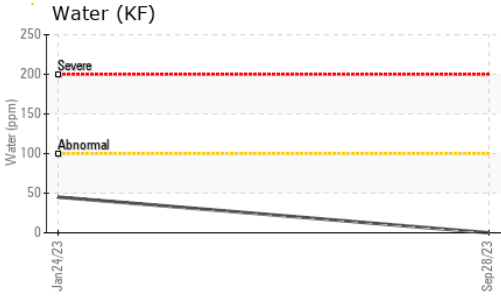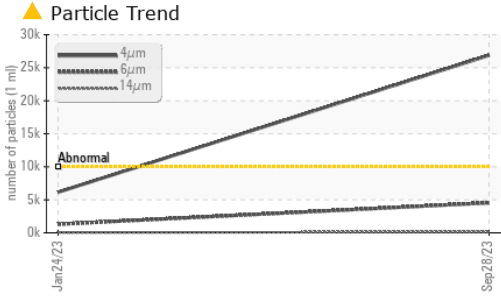





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>64.7</b>	64.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

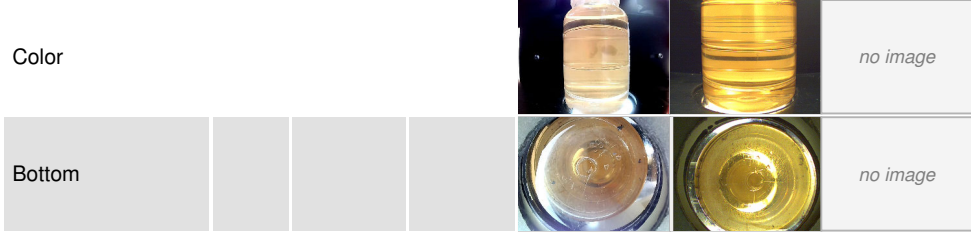

### GRAPHS

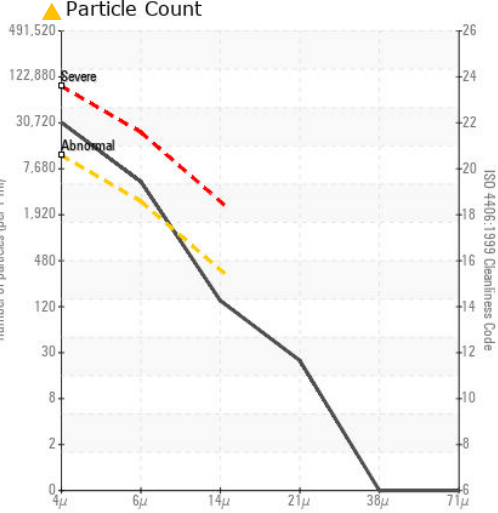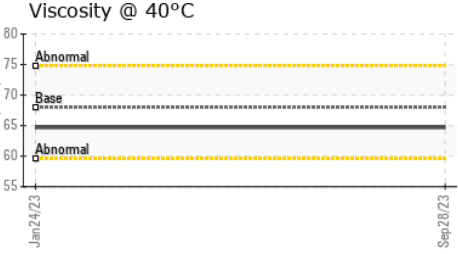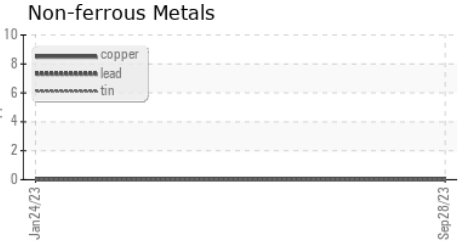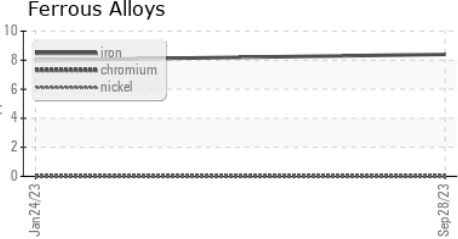

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0001816 **Received** : 28 Sep 2023  
**Lab Number** : 05964228 **Diagnosed** : 29 Sep 2023  
**Unique Number** : 10670779 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**AMERICOLD**  
 18531 US HWY 20 W  
 EAST DUBUQUE, IL  
 US 61025  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: